


OIL ANALYSIS REPORT

DIAMOND BLUE

SULLAIR 200801260031 - DOE RUN

Component

Compressor



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2023		
OAMBLE INTORN	44 TION					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05903362		
Sample Date		Client Info		10 Jul 2023		
Machine Age	hrs	Client Info		62678		
Oil Age	hrs	Client Info		2000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	15		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	13		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	2		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
					•	•
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	350		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m	_	0		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	10	0		
Phosphorus	ppm	ASTM D5185m	250	<1		
Zinc	ppm	ASTM D5185m	100	0		
Sulfur	ppm	ASTM D5185m	400	188		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.35		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.8	NEG		
Free Water	scalar	*Visual		NEG		



OIL ANALYSIS REPORT

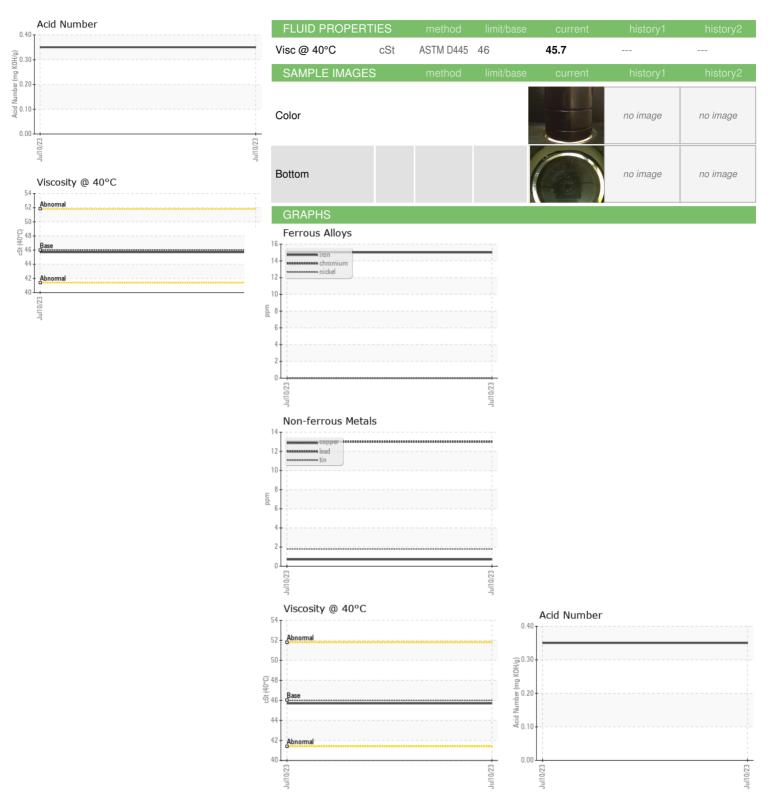





Certificate L2367

Laboratory Sample No. Lab Number

: UCH05903362 : 05903362 Unique Number : 10564718 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 20 Jul 2023 : 24 Jul 2023 Diagnosed Diagnostician : Don Baldridge

JOHN HENRY FOSTER COMPANY

4700 LEBOURGET STREET SAINT LOUIS, MO

US 63134

Contact: RACHEL VON HATTEN

rvonhatten@jhf.com

T: (314)593-1267 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)