




# OIL ANALYSIS REPORT

Sample Rating Trend

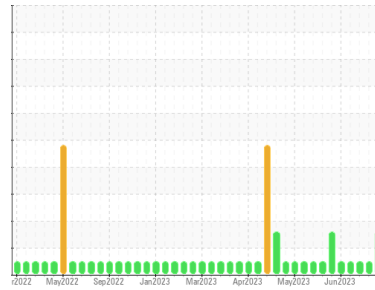

Machine Id  
**HBKM02BE**  
Component  
**Biogas Engine**  
Fluid  
**SHELL MYSELLA S5 S (48 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition. ( Customer Sample Comment: Top Up Amount: 30 )

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0775346</b>	WC0775343	WC0775325
Sample Date	Client Info		<b>17 Jul 2023</b>	13 Jul 2023	06 Jul 2023
Machine Age	hrs	Client Info	<b>100569</b>	100472	100320
Oil Age	hrs	Client Info	<b>566</b>	469	457
Oil Changed	Client Info		<b>Oil Added</b>	Oil Added	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>15	<b>5</b>	5	3
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>6	<b>3</b>	4	3
Lead	ppm	ASTM D5185m	>9	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>6	<b>1</b>	1	<1
Tin	ppm	ASTM D5185m	>4	<b>4</b>	3	3
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>4</b>	3	3
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>8</b>	8	8
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>27</b>	28	29
Calcium	ppm	ASTM D5185m		<b>1691</b>	1675	1508
Phosphorus	ppm	ASTM D5185m	300	<b>356</b>	353	330
Zinc	ppm	ASTM D5185m		<b>427</b>	443	402
Sulfur	ppm	ASTM D5185m		<b>3599</b>	3782	3519

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	<b>▲ 184</b>	153	131
Sodium	ppm	ASTM D5185m		<b>1</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0

## INFRA-RED





	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.4</b>	5.4	5.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.5</b>	21.6	20.8

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.0</b>	14.6	14.8
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.20</b>	1.01	0.97
Base Number (BN)	mg KOH/g	ASTM D2896	5.3	<b>3.80</b>	4.81	4.28











# OIL ANALYSIS REPORT

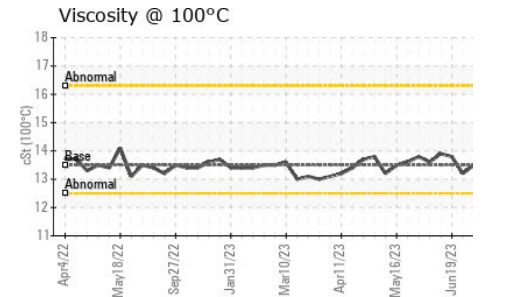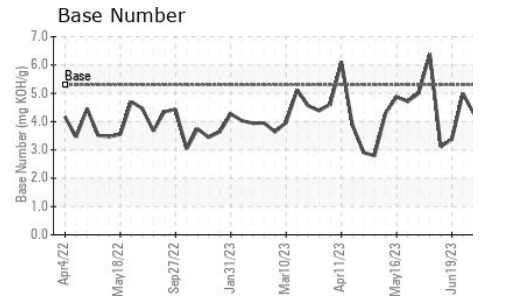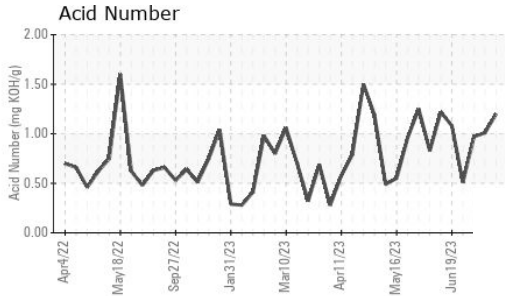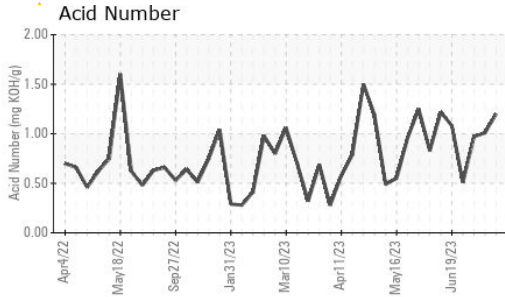

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	13.7	13.6

## GRAPHS

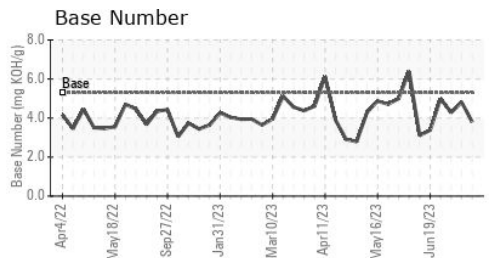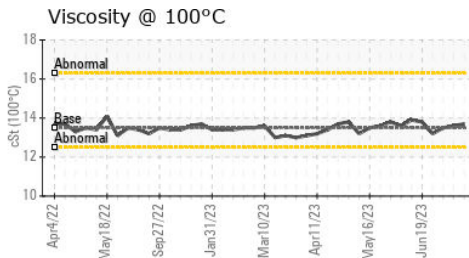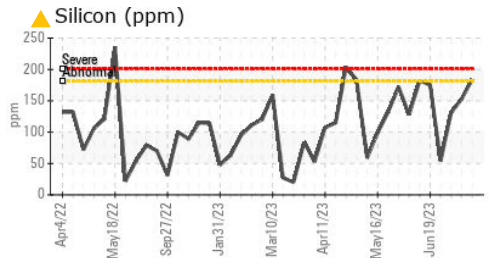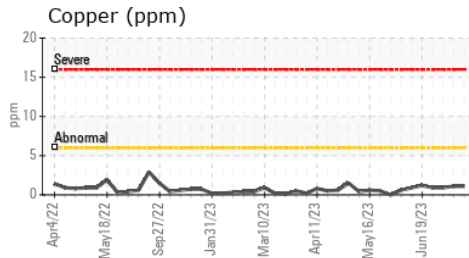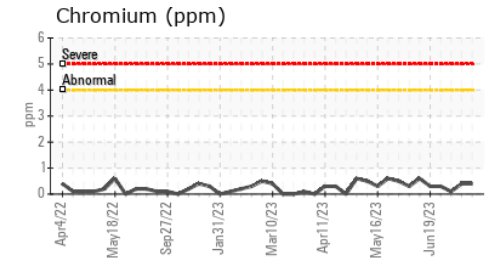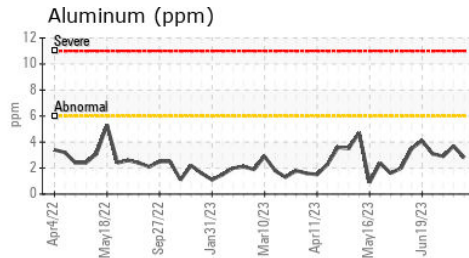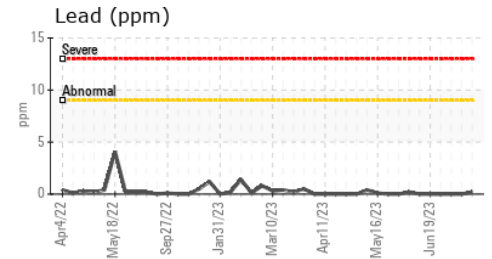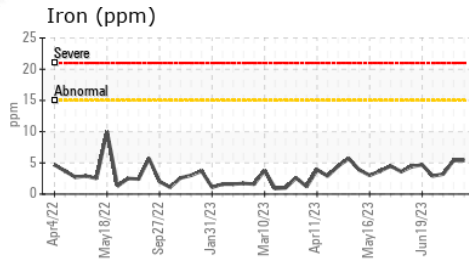

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0775346 Received : 20 Jul 2023  
 Lab Number : 05903415 Diagnosed : 25 Jul 2023  
 Unique Number : 10564771 Diagnostician : Doug Bogart  
 Test Package : MOB 2

**EDL NA Recips-Honeybrook**  
 Honey Brook Powerstation, 481 S. Churchtown Road  
 Narvon, PA  
 US 17555-9574  
 Contact: Christian Adames  
 Christian.Adames@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: