

PROBLEM SUMMARY

Sample Rating Trend


ISO

Refrigeration Compressor FRICK TYSLEX 0 FRK (S/N S02890)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

COMPONENT CONDITION SUMMARY

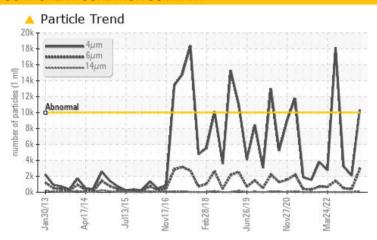

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ATTENTION	NORMAL	NORMAL			
Particles >4µm	ASTM D7647 >1	0000 A 10342	2090	3247			
Particles >6µm	ASTM D7647 >2	500 A 2872	378	503			
Oil Cleanliness	ISO 4406 (c) >2	0/18/15 🔺 21/19/14	18/16/10	19/16/11			

Customer Id: IBPLEX01 Sample No.: USP183529 Lab Number: 05903757 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

23 Feb 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



19 Sep 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Jun 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Vanadium

Sample Rating Trend

ISO

Refrigeration Compressor FRICK TYSLEX 0 FRK (S/N S

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

S02890)		2013 Apr20	14 Ju2015 Nov2016	Feb2016 Jun2019 Nov2020 1	Mac/072	1
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP183529	USP241161	USP234233
Sample Date		Client Info		18 Jul 2023	23 Feb 2023	19 Sep 2022
Machine Age	hrs	Client Info		39604	36243	32507
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	2	1	<1
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	<1	<1
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	<1

Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	7	14	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	4	3
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	<1

ppm Water	ppm	ASTM D6304	>100	59.0	53.6	31.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	10342	2090	3247
Particles >6µm		ASTM D7647	>2500	2872	378	503
Particles >14µm		ASTM D7647	>320	140	9	19
Particles >21µm		ASTM D7647	>80	20	1	4
Particles >38μm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>21/19/14</u>	18/16/10	19/16/11
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D974 0.005

ASTM D6304 > 0.01

%

0.014

0.005

0.014


0.014

0.003

0.005



OIL ANALYSIS REPORT

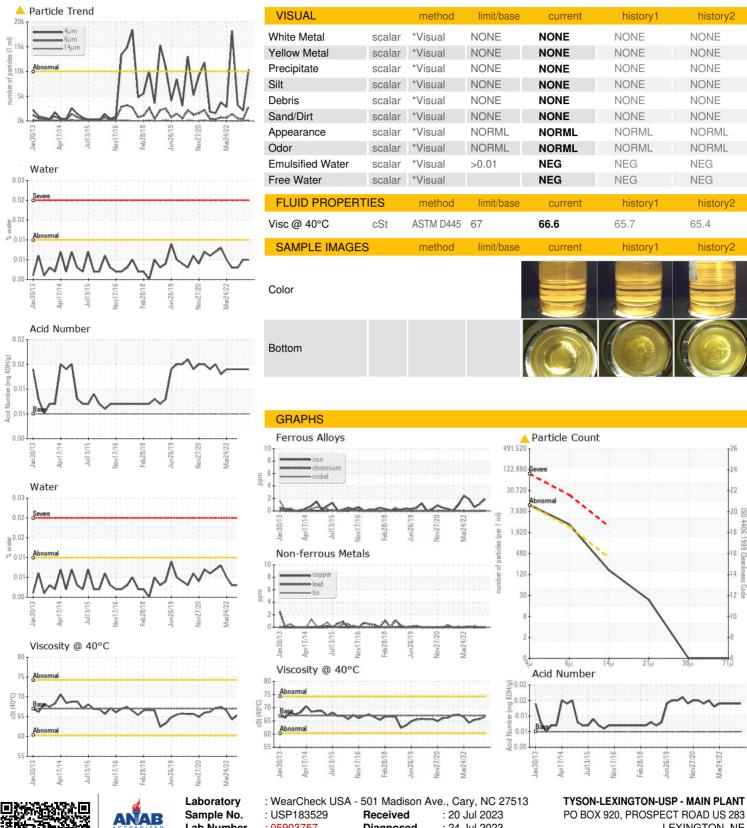



Certificate L2367

Lab Number **Unique Number**

: 05903757 : 10565113 Test Package : IND 2

: 24 Jul 2023 Diagnosed

Diagnostician : Doug Bogart LEXINGTON, NE US 68850

Contact: SCOTT NIERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (308)324-8221

F: (308)324-8233