




# OIL ANALYSIS REPORT

Sample Rating Trend

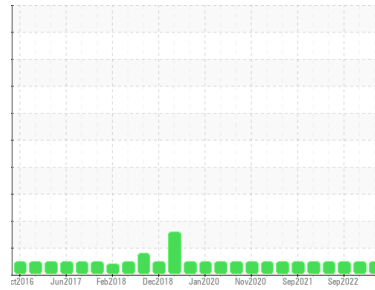

**NORMAL**



Machine Id  
**ATLAS COPCO AIR COMP 6 (S/N ARP861290)**

Component  
**Air Compressor**

Fluid  
**USPI MAX FG AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USPM25355</b>	USPM23396	USPR000886
Sample Date	Client Info			<b>18 Jul 2023</b>	23 Feb 2023	19 Sep 2022
Machine Age	hrs	Client Info		<b>38338</b>	0	33157
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>6	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>80	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0	<b>0</b>	1	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	2	8
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	0	<b>22</b>	2	0






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>12	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	0
Water	%	ASTM D6304	>0.1	<b>0.024</b>	0.019	0.015
ppm Water	ppm	ASTM D6304	>1000	<b>244.3</b>	195.5	159.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>3921</b>	3032	1395
Particles >6µm		ASTM D7647	>2500	<b>1254</b>	638	498
Particles >14µm		ASTM D7647	>320	<b>59</b>	23	73
Particles >21µm		ASTM D7647	>80	<b>15</b>	3	30
Particles >38µm		ASTM D7647	>20	<b>2</b>	0	1
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>19/17/13</b>	19/16/12	18/16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	<b>0.41</b>	0.44	0.37



# OIL ANALYSIS REPORT

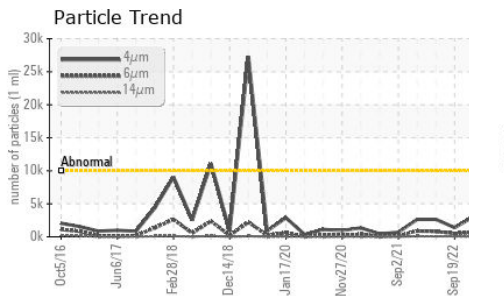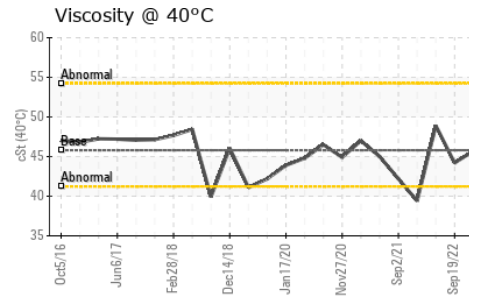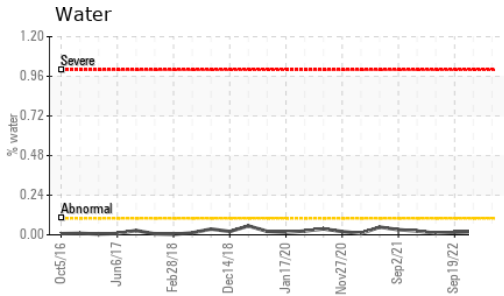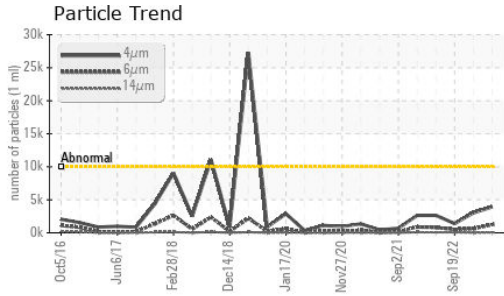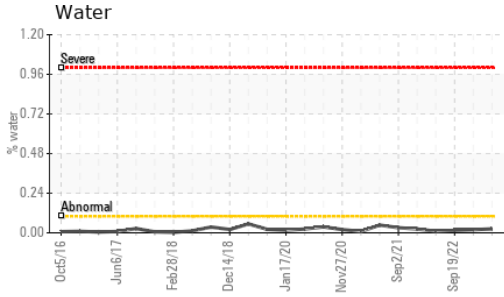






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	44.6	45.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

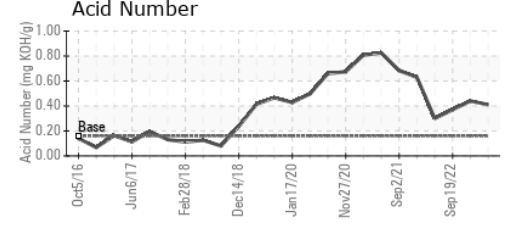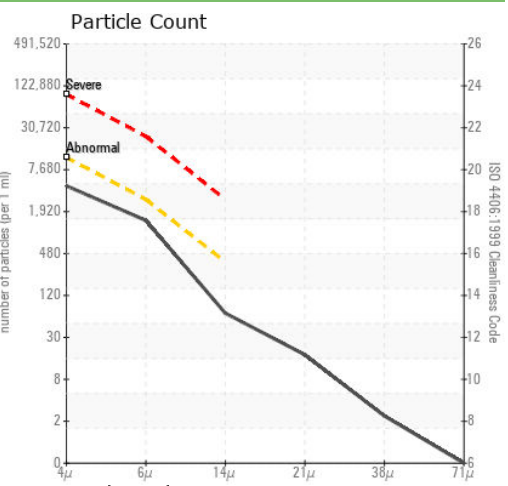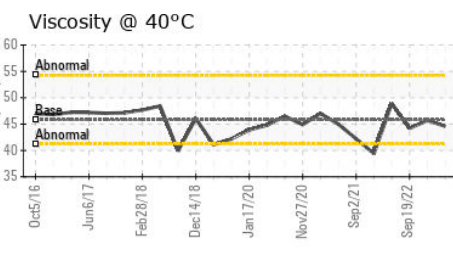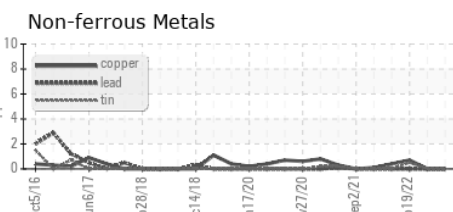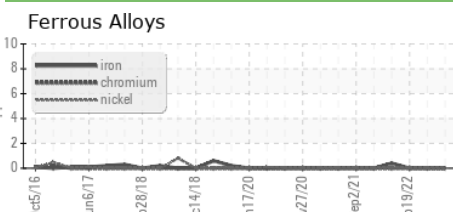

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM25355 **Received** : 20 Jul 2023  
**Lab Number** : 05903766 **Diagnosed** : 24 Jul 2023  
**Unique Number** : 10565122 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON-LEXINGTON-USP - MAIN PLANT**  
 PO BOX 920, PROSPECT ROAD US 283  
 LEXINGTON, NE  
 US 68850  
 Contact: SCOTT NIERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (308)324-8221  
 F: (308)324-8233