

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER ASD 40 5497955 (S/N 1221)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

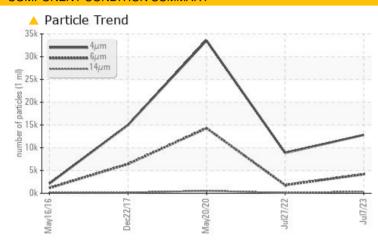

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	4181	1800	<u>▲</u> 14298				
Particles >14μm	ASTM D7647	>80	4 363	9 3	△ 537				
Particles >21µm	ASTM D7647	>20	<u></u> 45	18	<u></u> 107				
Oil Cleanliness	ISO 4406 (c)	>17/13	19/16	<u> </u>	<u></u> 21/16				

Customer Id: WORGLO Sample No.: KCPA003426 Lab Number: 05903784 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 Jul 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



20 May 2020 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



22 Dec 2017 Diag: Don Baldridge

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

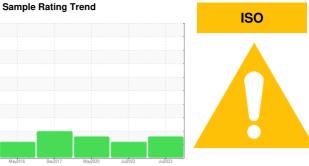

KAESER ASD 40 5497955 (S/N 1221)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May 2016	Dec2017	May2020 Jul2022	Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003426	KCP40647	KCP25689
Sample Date		Client Info		07 Jul 2023	27 Jul 2022	20 May 2020
Machine Age	hrs	Client Info		38037	29757	13940
Oil Age	hrs	Client Info		0	0	7100
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	8	9	5
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				2
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	0	0	2
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	32	30	63
Calcium	ppm	ASTM D5185m	2	<1	0	<1
Phosphorus	ppm	ASTM D5185m		2	0	0
Zinc	ppm	ASTM D5185m		12	11	19
Sulfur	ppm	ASTM D5185m		22310	17672	16085
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		27	25	16
Potassium	ppm	ASTM D5185m	>20	5	4	4
Water	%	ASTM D6304	>0.05	0.016	0.014	0.030
ppm Water	ppm	ASTM D6304	>500	164.5	143.5	304.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12824	8857	33554
Particles >6µm		ASTM D7647	>1300	<u>4181</u>	<u></u> 1800	<u>▲</u> 14298
Particles >14µm		ASTM D7647	>80	▲ 363	4 93	▲ 537
Particles >21µm		ASTM D7647	>20	<u>^</u> 85	18	▲ 107
Particles >38µm		ASTM D7647	>4	3	0	<u>^</u> 6
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	<u> </u>	<u>▲</u> 18/14	<u>^</u> 21/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.36

0.377



OIL ANALYSIS REPORT

