


## **PROBLEM SUMMARY**


# KAESER AIRCENTER SX 5 5813337 (S/N 1009)

Compressor

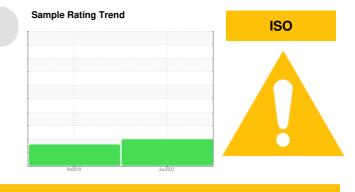

KAESER SIGMA (OEM) M-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

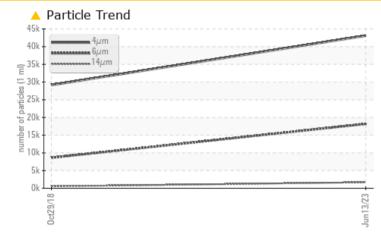

### RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL						
Particles >6µm	ASTM D7647	>1300	<u> </u>	▲ 8624						
Particles >14µm	ASTM D7647	>80	🔺 1689	<b>5</b> 48						
Particles >21µm	ASTM D7647	>20	<u> </u>	<b>1</b> 33						
Particles >38µm	ASTM D7647	>4	<b>A</b> 33	<b></b> 7						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	<b>2</b> 0/16						

Customer Id: PEPWHI Sample No.: KCPA005375 Lab Number: 05903800 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 29 Oct 2018 Diag: Jonathan Hester



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

# Sample Rating Trend ISO SAMPLE INFORMATION method limit/base

history1

historv2

current

Machine Id KAESER AIRCENTER SX 5 5813337 (S/N 1009) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005375	KCP14445	
Sample Date		Client Info		13 Jun 2023	29 Oct 2018	
Machine Age	hrs	Client Info		33990	6941	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	<1	4	
Chromium	ppm	ASTM D5185m		0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead		ASTM D5185m	>10	0	0	
	ppm	ASTM D5185m		12	38	
Copper Tin	ppm		>50 >10		0	
	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Volybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	<1	<1	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	2	2	
Zinc	ppm	ASTM D5185m	0	0	25	
Sulfur	ppm	ASTM D5185m	23500	17030	20522	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		<1	3	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.007	0.004	
opm Water	ppm	ASTM D6304	>500	72.9	40	
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		43075	29150	
Particles >6µm		ASTM D7647	>1300	<u> </u>	▲ 8624	
Particles >14µm		ASTM D7647	>80	<u> </u>	<u> </u>	
Particles >21µm		ASTM D7647	>20	<u> </u>	<b>1</b> 33	
Particles >38µm		ASTM D7647	>4	<b>A</b> 33	<b></b> 7	
Particles >71µm		ASTM D7647	>3	2	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>4</b> 23/21/18	<b>2</b> 0/16	
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.51	0.280	
58·12) Boy: 1	ing NOT //g	A0 HW D0040	1.0		0.200 on: Service Mar	

Report Id: PEPWHI [WUSCAR] 05903800 (Generated: 07/24/2023 14:58:12) Rev: 1

Contact/Location: Service Manager - PEPWHI



Water

Viscosity @ 40°C

1.20

0.9

<sub>늘</sub>0.72

a<sup>2</sup>0.48

0.24

0.00

60

55

ှ 50

-73 45 Base

40


35


ġG,

Abnormal

Se

# **OIL ANALYSIS REPORT**

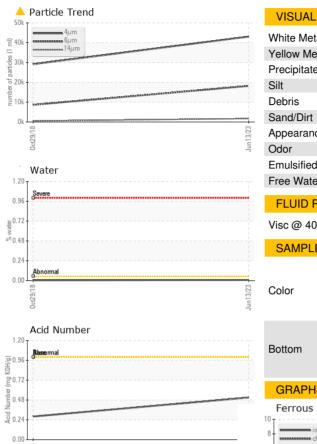

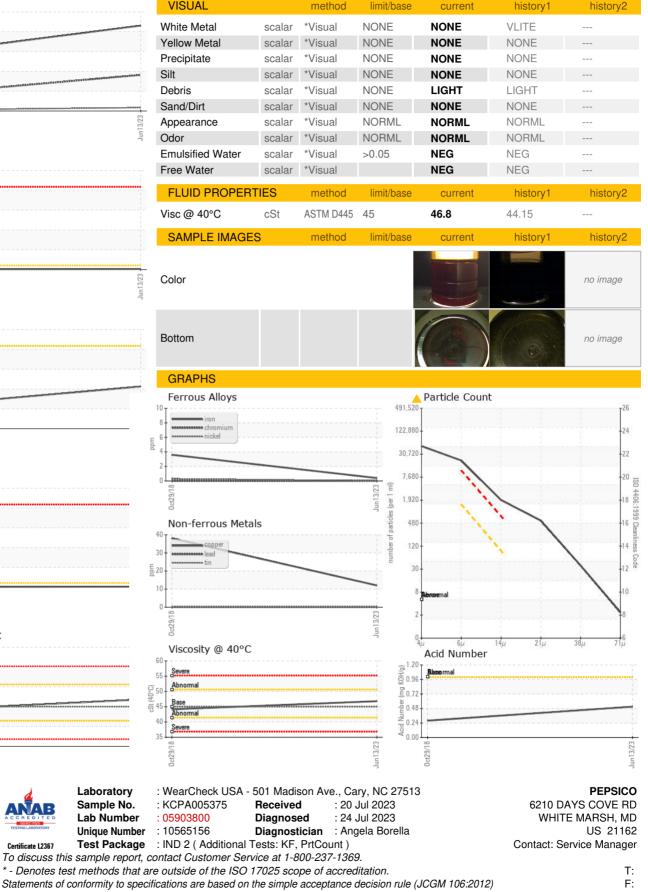

Certificate L2367

Contact/Location: Service Manager - PEPWHI