




# FUEL REPORT

Sample Rating Trend

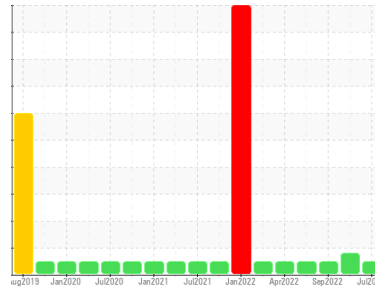

**NORMAL**



Area  
**HOSPITAL**  
 Machine Id  
**ABOVE GROUND DUKE - JET A**  
 Component  
**Tank Jet Fuel**  
 Fluid  
**JET FUEL Type A (8000 GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for Jet-A fuel.

### Wear

All metal levels are normal indicating no corrosion in the system.

### Contamination

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC05904030</b>	WC05687562	WCDF04785
Sample Date	Client Info			<b>19 Jul 2023</b>	07 Nov 2022	22 Sep 2022
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		<b>0.804</b>	0.799	0.803
Fuel Color	text	*Visual Screen		<b>Clear</b>	Red	Clear
ASTM Color	scalar	*ASTM D1500		<b>L1.5</b>	L0.5	0
Visc @ 40°C	cSt	ASTM D445	<8.0	<b>1.33</b>	1.31	1.27
Pensky-Martens Flash Point	°C	*PMCC Calculated	38	<b>47</b>	48	52

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	<3000	<b>572</b>	435	486
Sulfur (UVF)	ppm	ASTM D5453		<b>440</b>	443	392

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		<b>149</b>	152	153
5% Distillation Point	°C	ASTM D86		<b>169</b>	170	172
10% Distill Point	°C	ASTM D86	205	<b>173</b>	173	176
15% Distillation Point	°C	ASTM D86		<b>177</b>	177	179
20% Distill Point	°C	ASTM D86		<b>180</b>	180	183
30% Distill Point	°C	ASTM D86		<b>187</b>	186	189
40% Distill Point	°C	ASTM D86		<b>196</b>	194	197
50% Distill Point	°C	ASTM D86		<b>205</b>	202	205
60% Distill Point	°C	ASTM D86		<b>214</b>	210	213
70% Distill Point	°C	ASTM D86		<b>224</b>	219	223
80% Distill Point	°C	ASTM D86		<b>235</b>	229	233
85% Distillation Point	°C	ASTM D86		<b>242</b>	235	239
90% Distill Point	°C	ASTM D86		<b>251</b>	242	247
95% Distillation Point	°C	ASTM D86		<b>266</b>	254	258
Final Boiling Point	°C	ASTM D86	300	<b>275</b>	265	272
Distillation Residue	%	ASTM D86	1.5	<b>1.2</b>	1.2	1.2
Distillation Loss	%	ASTM D86	1.5	<b>1.6</b>	1.1	0.7


IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	44	<b>44.5</b>	45.6	44.7
Cetane Index		ASTM D4737	<40.0	<b>46.3</b>	47.2	47.8

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	0
Water	%	ASTM D6304	<0.05	<b>0.005</b>	0.003	0.005
ppm Water	ppm	ASTM D6304	<500	<b>52.3</b>	35.4	59.1
% Gasoline	%	*In-House	<0.50	<b>4.0</b>	3.3	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	0.0




# FUEL REPORT

Fuel Distillation Curve

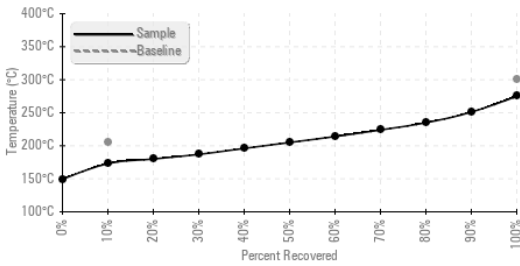


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>231</b>	▲ 5705	1078
Particles >6µm	ASTM D7647	>1300	<b>87</b>	1117	292
Particles >14µm	ASTM D7647	>160	<b>20</b>	73	18
Particles >21µm	ASTM D7647	>40	<b>8</b>	18	3
Particles >38µm	ASTM D7647	>10	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>15/14/11</b>	▲ 20/17/13	17/15/11

Particle Count

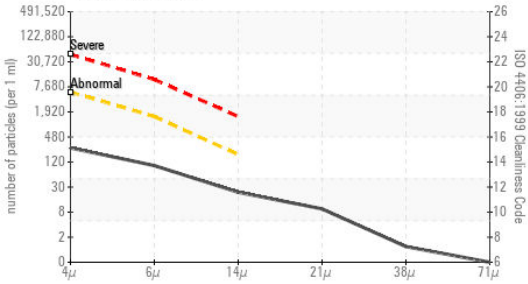


HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	0	0
Iron	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m <0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m <0.1	<b>0</b>	2	2
Zinc	ppm	ASTM D5185m <0.1	<b>0</b>	0	0


Water

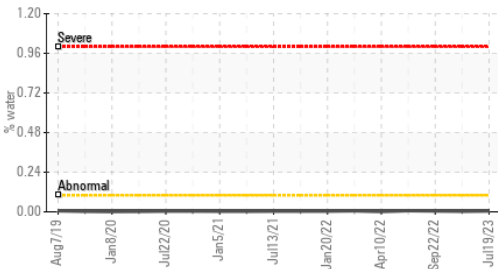


SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

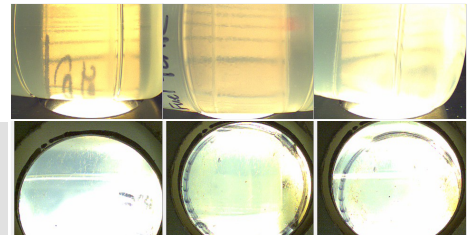

Acid Number

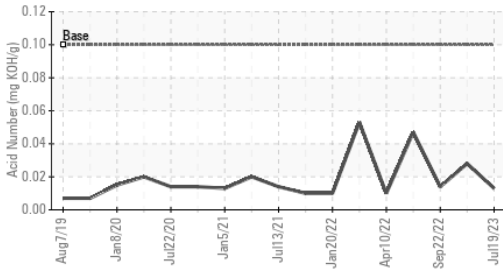

Viscosity @ 40°C

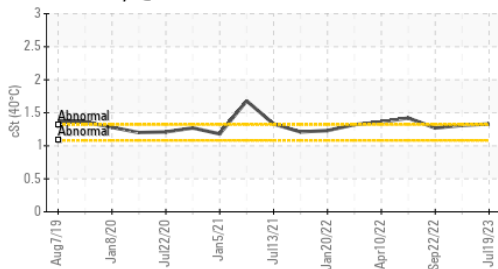

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05904030 **Received** : 20 Jul 2023  
**Lab Number** : **05904030** **Diagnosed** : 27 Jul 2023  
**Unique Number** : 10565386 **Diagnostician** : Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: API, CC Flash, Cetane, Color-ASTM, Fuel, GC-PercFuel, ICP, KF, KV40, PriCou

**COUCH OIL COMPANY**  
 2907 HILLSBOROUGH RD  
 DURHAM, NC  
 US 27705  
 Contact: JESSE BROWN  
 jesse@couchoilcompany.com  
 T: (919)285-5408  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)