


# **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



QSI 750 QUINCY (S/N 96823H)

Component

**Compressor** Fluid

PETRO CANADA PURITY FG COMPRESSOR 46 (30 GAL)

# DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

OR 46 (30 GAL)		y/2012 Oct20	13 Mar2015 Jan2017	Apr2018 Oct2019 Dec2020 .	Jun2022	
SAMPLE INFORM	//ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP248850	USP249746	USP245014
Sample Date		Client Info		17 Jun 2023	23 Apr 2023	11 Feb 2023
Machine Age	hrs	Client Info		17842	16958	15935
Oil Age	hrs	Client Info		2872	1017	177
Oil Changed		Client Info		N/A	Changed	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	8	8
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	2	1	1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		2	0	<1
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		614	619	585
Zinc	ppm	ASTM D5185m		74	49	51
Sulfur	ppm	ASTM D5185m		1548	1728	1550
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	2
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
Water	%	ASTM D6304	>0.1	0.003	0.001	<b>△</b> 0.225
ppm Water	ppm	ASTM D6304	>1000	39.2	10.7	<u>^</u> 2251.8
FLUID CLEANLIN	IESS	method	limit/base		history1	history2
Particles >4µm		ASTM D7647	0.50	2036	1694	9392
Particles >6µm		ASTM D7647	>2500	354	298	2292
Particles >14µm		ASTM D7647	>320	18	11	153
Particles >21µm		ASTM D7647	>80	3	3	27
Particles >38µm		ASTM D7647	>20	0	1	1
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	18/16/11	18/15/11	20/18/14
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.37	0.25	0.24	0.19



## **OIL ANALYSIS REPORT**

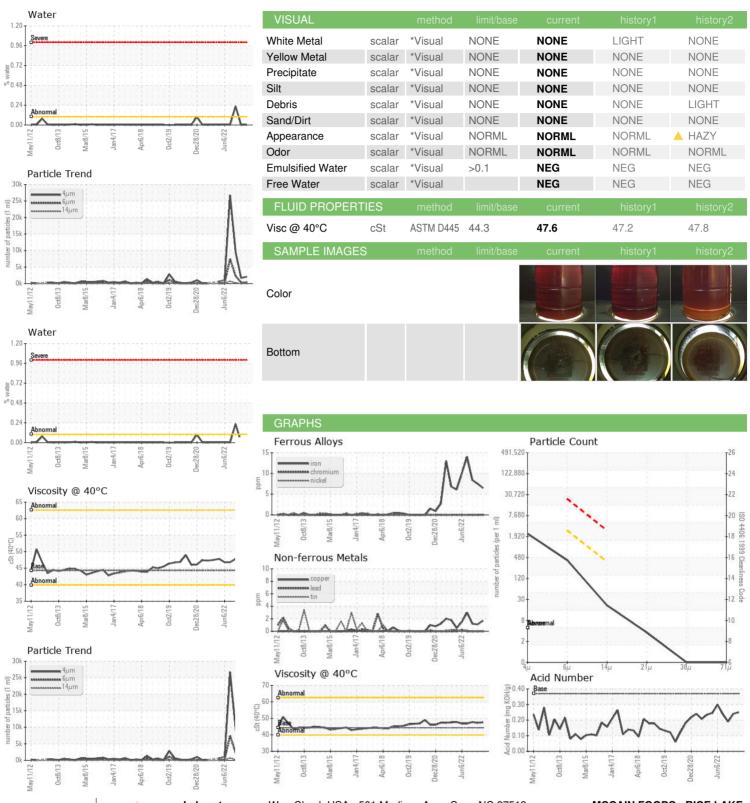



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: USP248850 : 05904382 : 10565738 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 21 Jul 2023 : 24 Jul 2023 Diagnosed

Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**MCCAIN FOODS - RICE LAKE** 

100 W. COLEMAN ST. RICE LAKE, WI US 54868

Contact: JOSH MILLER

josh.miller@mccain.com

T: F: (715)236-1542