




OIL ANALYSIS REPORT

Sample Rating Trend

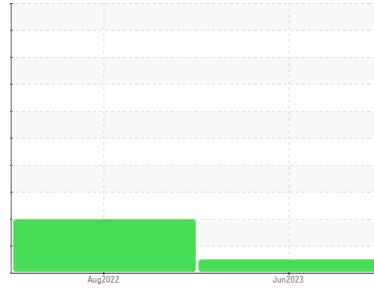

NORMAL



Machine Id
KAESER ASD 25 7895343 (S/N 1137)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA002142	KC104604	---
Sample Date	Client Info		16 Jun 2023	12 Aug 2022	---
Machine Age	hrs	Client Info	709	329	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	Changed	---
Sample Status			NORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	4	<1	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	<1	<1	---
Tin	ppm	ASTM D5185m >10	0	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	<1	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	1	<1	---
Magnesium	ppm	ASTM D5185m	6	7	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m 500	424	281	---
Zinc	ppm	ASTM D5185m	63	9	---
Sulfur	ppm	ASTM D5185m	3702	6249	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	0	---
Sodium	ppm	ASTM D5185m	2	<1	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >0.05	0.003	0.006	---
ppm Water	ppm	ASTM D6304 >500	26.0	66.6	---





FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2285	51062	---
Particles >6µm	ASTM D7647 >1300		494	▲ 11904	---
Particles >14µm	ASTM D7647 >80		28	▲ 925	---
Particles >21µm	ASTM D7647 >20		7	▲ 215	---
Particles >38µm	ASTM D7647 >4		0	▲ 6	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		18/16/12	▲ 23/21/17	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	1.33	0.86	---


OIL ANALYSIS REPORT

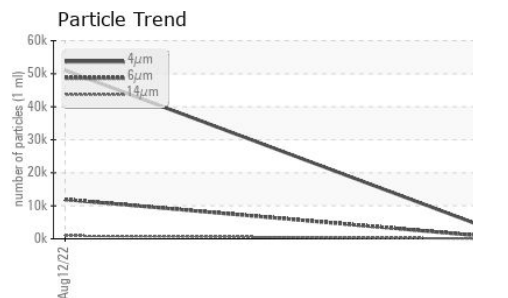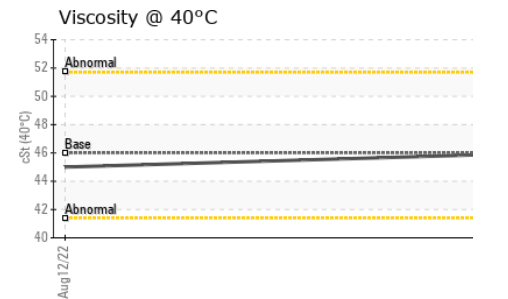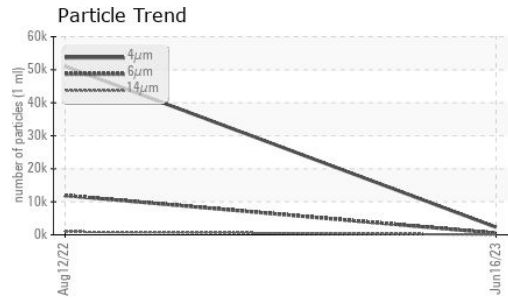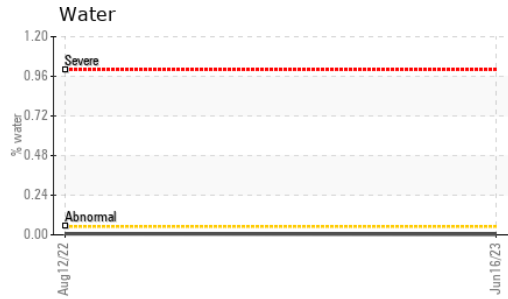






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.9	45.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

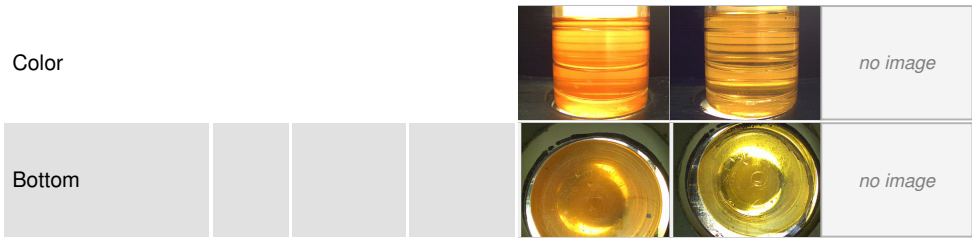

GRAPHS

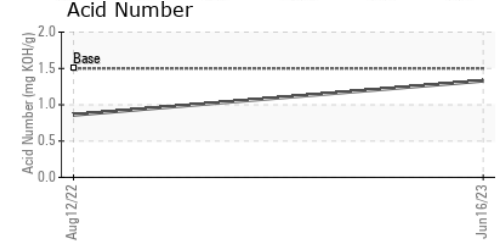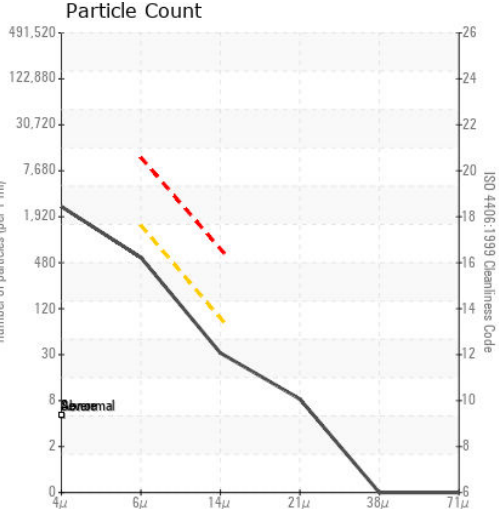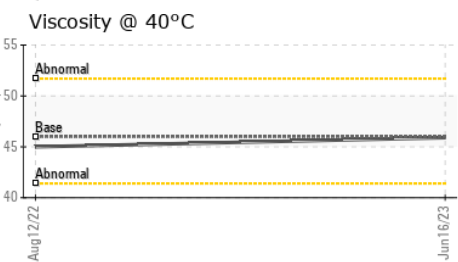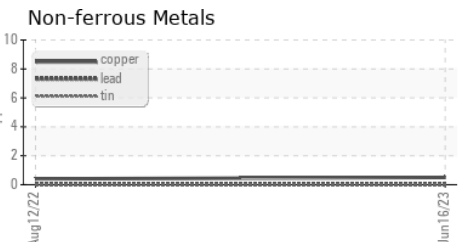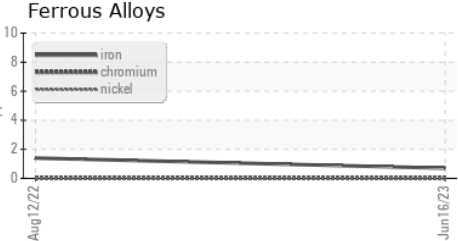

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA002142 **Received** : 21 Jul 2023
Lab Number : 05904393 **Diagnosed** : 25 Jul 2023
Unique Number : 10565749 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CHATEAU MONTELENA WINERY
 1429 TUBBS LN
 CALISTOGA, CA
 US 94515
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)