PROBLEM SUMMARY

Sample Rating Trend

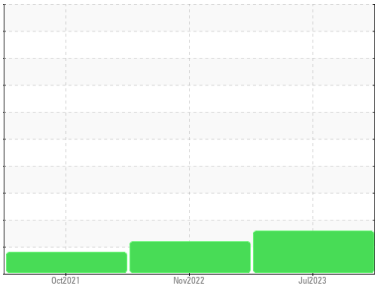

ISO

Machine Id
1834135 (S/N 1002)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

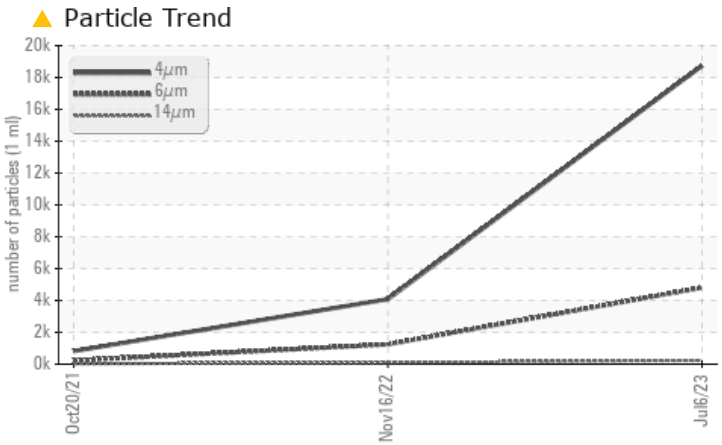

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm		ASTM D7647	>1300	▲ **4800**	1239	227
Particles >14µm		ASTM D7647	>80	▲ **227**	▲ 98	23
Particles >21µm		ASTM D7647	>20	▲ **54**	▲ 21	5
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **21/19/15**	▲ 19/17/14	15/12

Customer Id: BRISANCA
Sample No.: KCP35053
Lab Number: 05904399
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Nov 2022 Diag: Doug Bogart

ISO

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

20 Oct 2021 Diag: Don Baldridge

ADDITIVES

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

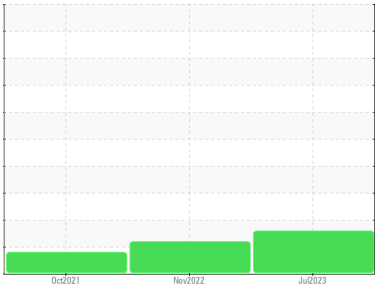

ISO

Machine Id
1834135 (S/N 1002)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCP35053**	KCP45756	KCP39370
Sample Date		Client Info		**06 Jul 2023**	16 Nov 2022	20 Oct 2021
Machine Age	hrs	Client Info		**56174**	55336	53638
Oil Age	hrs	Client Info		**2536**	0	2500
Oil Changed		Client Info		**Not Changd**	Changed	Changed
Sample Status				**ABNORMAL**	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	0
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**<1**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**<1**	<1	0
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**4**	3	8
Tin	ppm	ASTM D5185m	>10	**0**	<1	0
Antimony	ppm	ASTM D5185m		**---**	---	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	<1
Barium	ppm	ASTM D5185m	90	**0**	<1	▲ 0
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**<1**	<1	0
Magnesium	ppm	ASTM D5185m	100	**63**	47	▲ 0
Calcium	ppm	ASTM D5185m	0	**0**	0	0
Phosphorus	ppm	ASTM D5185m	0	**2**	7	21
Zinc	ppm	ASTM D5185m	0	**18**	41	12
Sulfur	ppm	ASTM D5185m	23500	**22616**	21641	15341

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**4**	2	2
Sodium	ppm	ASTM D5185m		**13**	13	0
Potassium	ppm	ASTM D5185m	>20	**0**	0	0
Water	%	ASTM D6304	>0.05	**0.016**	0.016	0.008
ppm Water	ppm	ASTM D6304	>500	**165.1**	167.4	88.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**18739**	4078	819
Particles >6µm		ASTM D7647	>1300	▲ **4800**	1239	227
Particles >14µm		ASTM D7647	>80	▲ **227**	▲ 98	23
Particles >21µm		ASTM D7647	>20	▲ **54**	▲ 21	5
Particles >38µm		ASTM D7647	>4	**3**	2	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **21/19/15**	▲ 19/17/14	15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.41**	0.40	0.417

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

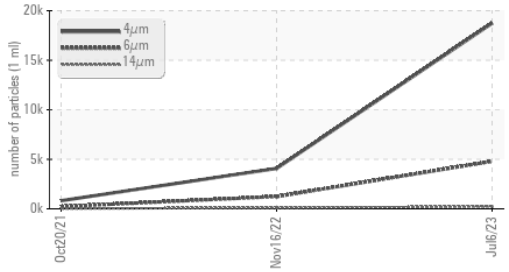

Water

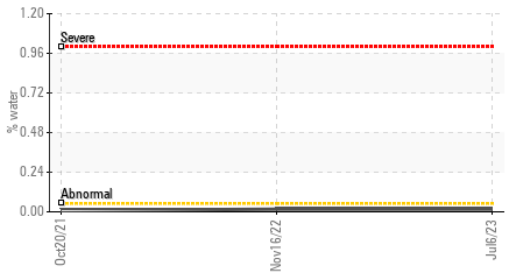

Acid Number

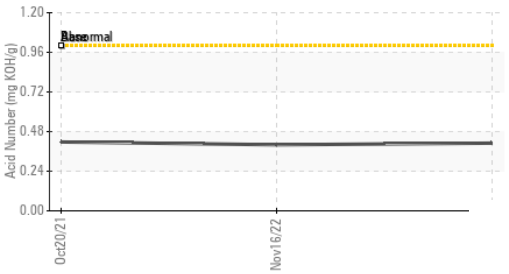

Water

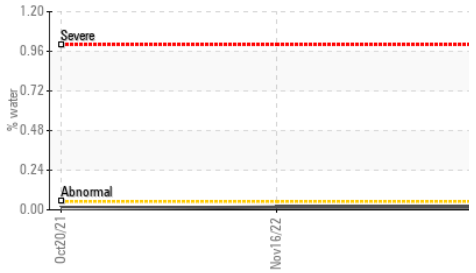

Viscosity @ 40°C

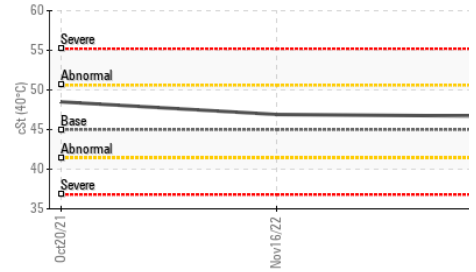

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	**46.7**	46.9	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			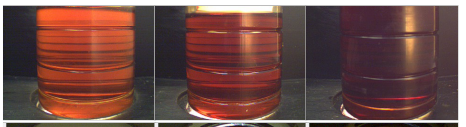		
Bottom			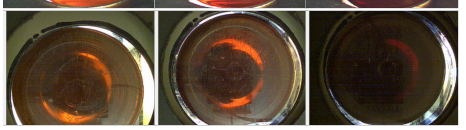		

GRAPHS

Ferrous Alloys

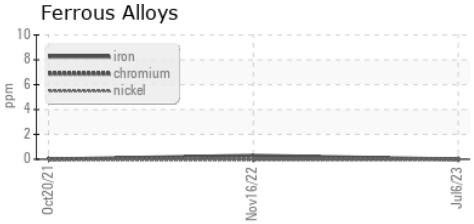

Non-ferrous Metals

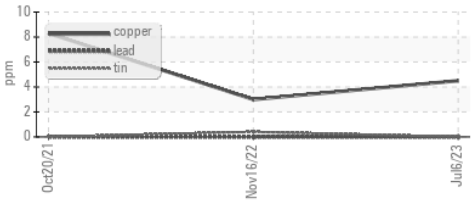

Viscosity @ 40°C

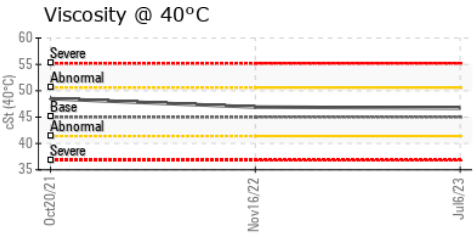

Particle Count

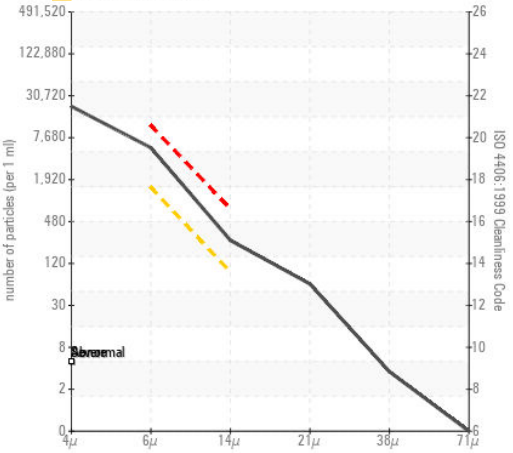

Acid Number

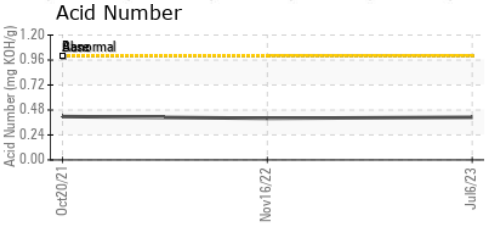

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP35053 **Received** : 21 Jul 2023
Lab Number : 05904399 **Diagnosed** : 25 Jul 2023
Unique Number : 10565755 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BRIDGESTONE TIRE
233 BELLEVUE AVE
SANTA ROSA, CA
US 95407
Contact: Service Manager

T:
F: