


# PROBLEM SUMMARY

Sample Rating Trend







**WATER**

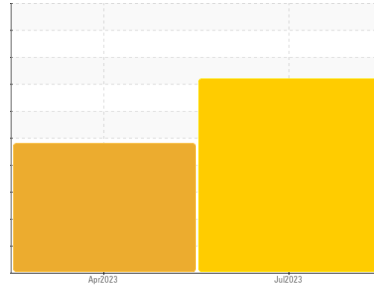

Area  
**MEK**  
Machine Id  
**[MEK] D-Filter**  
Component  
**Gearbox**  
Fluid  
**GEAR OIL ISO 680 (4 GAL)**

## COMPONENT CONDITION SUMMARY

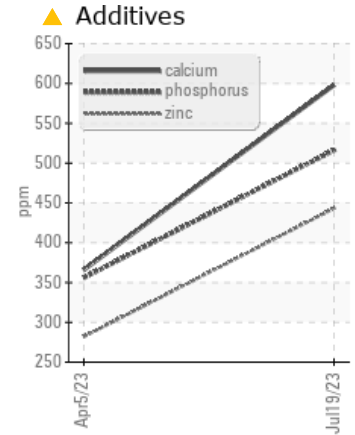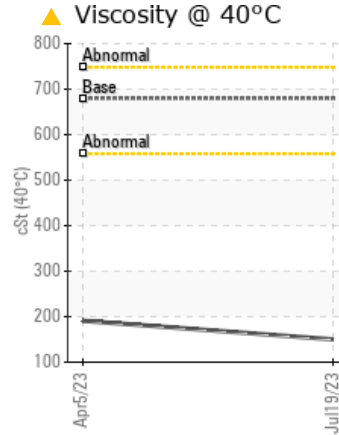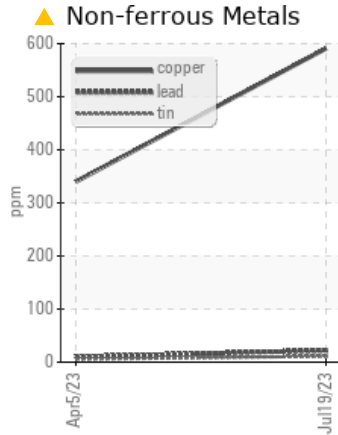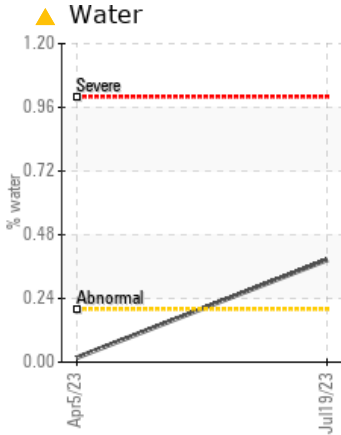

## RECOMMENDATION

We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	---
Copper	ppm	ASTM D5185m	>200	▲ 591	▲ 340	---
Molybdenum	ppm	ASTM D5185m	15	▲ 113	▲ 73	---
Magnesium	ppm	ASTM D5185m	50	▲ 261	▲ 152	---
Calcium	ppm	ASTM D5185m	50	▲ 598	▲ 366	---
Zinc	ppm	ASTM D5185m	100	▲ 443	▲ 282	---
Water	%	ASTM D6304	>0.2	▲ 0.385	0.017	---
ppm Water	ppm	ASTM D6304	>2000	▲ 3850	173.8	---
Yellow Metal	scalar	*Visual	NONE	▲ HEAVY	▲ MODER	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---
Visc @ 40°C	cSt	ASTM D445	680	▲ 150	▲ 191	---

Customer Id: CALSHR  
Sample No.: RP0034787  
Lab Number: 05904448  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Water Access	---	---	?	We advise that you check for the source of water entry.

## HISTORICAL DIAGNOSIS

05 Apr 2023 Diag: Angela Borella

### VISUAL METAL




Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. The copper level is abnormal. Moderate concentration of visible metal present. There is no indication of any contamination in the oil. The oil viscosity is higher than normal. This plus the additive levels indicates the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

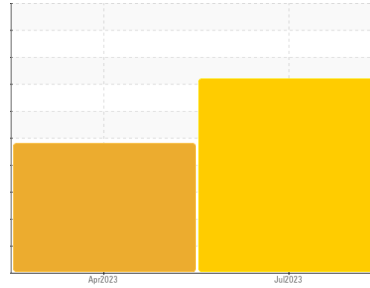

**WATER**



Area  
**MEK**  
Machine Id  
**[MEK] D-Filter**  
Component  
**Gearbox**  
Fluid  
**GEAR OIL ISO 680 (4 GAL)**

## DIAGNOSIS

### Recommendation

We advise that you check for the source of water entry. We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

### Wear

The copper level is abnormal. High concentration of visible metal present.

### Contamination

There is a moderate concentration of water present in the oil. Free water present.

### Fluid Condition

The oil viscosity is lower than normal. This plus the additive levels indicates the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0034787</b>	RP0034808	---
Sample Date	Client Info		<b>19 Jul 2023</b>	05 Apr 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	---
Sample Status			<b>ABNORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	<b>163</b>	90	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>15	<b>2</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>100	<b>22</b>	10	---
Copper	ppm	ASTM D5185m	>200	<b>▲ 591</b>	<b>▲ 340</b>	---
Tin	ppm	ASTM D5185m	>25	<b>11</b>	5	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	50	<b>60</b>	<b>▲ 38</b>	---
Barium	ppm	ASTM D5185m	15	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	15	<b>▲ 113</b>	<b>▲ 73</b>	---
Manganese	ppm	ASTM D5185m		<b>2</b>	1	---
Magnesium	ppm	ASTM D5185m	50	<b>▲ 261</b>	<b>▲ 152</b>	---
Calcium	ppm	ASTM D5185m	50	<b>▲ 598</b>	<b>▲ 366</b>	---
Phosphorus	ppm	ASTM D5185m	350	<b>516</b>	<b>▲ 356</b>	---
Zinc	ppm	ASTM D5185m	100	<b>▲ 443</b>	<b>▲ 282</b>	---

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>29</b>	19	---
Sodium	ppm	ASTM D5185m		<b>2</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	1	---
Water	%	ASTM D6304	>0.2	<b>▲ 0.385</b>	0.017	---
ppm Water	ppm	ASTM D6304	>2000	<b>▲ 3850</b>	173.8	---






## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>0.45</b>	0.35	---

## VISUAL

	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>▲ HEAVY</b>	<b>▲ MODER</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.2	<b>0.2%</b>	NEG	---
Free Water	scalar	*Visual		<b>▲ 1.0</b>	Submitted By: NICK-FLUHART	---

# OIL ANALYSIS REPORT

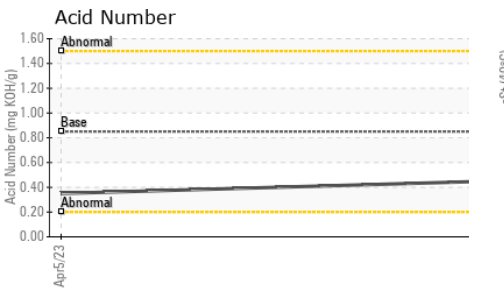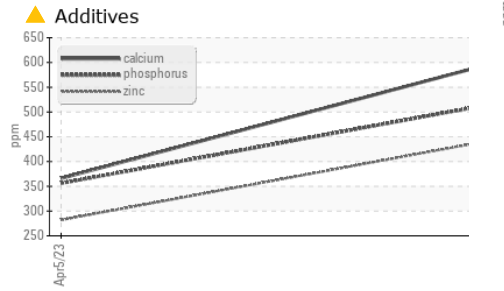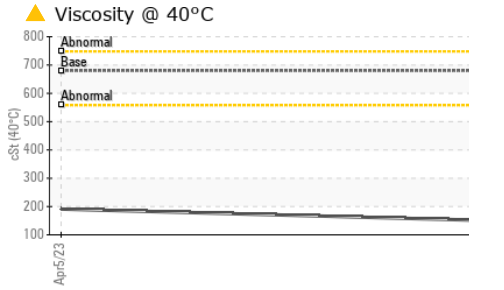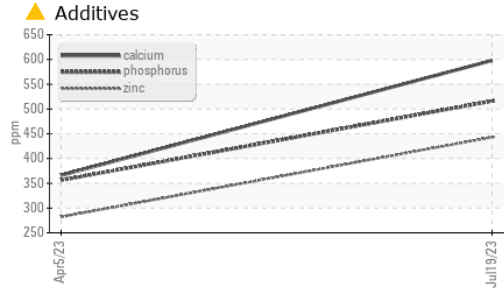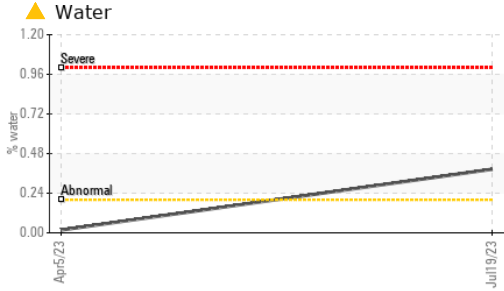





FLUID PROPERTIES		method	limit/base	current	history1	history2
------------------	--	--------	------------	---------	----------	----------

Visc @ 40°C	cSt	ASTM D445	680	▲ 150	▲ 191	---
-------------	-----	-----------	-----	-------	-------	-----

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color			no image			
Bottom			no image			

## GRAPHS

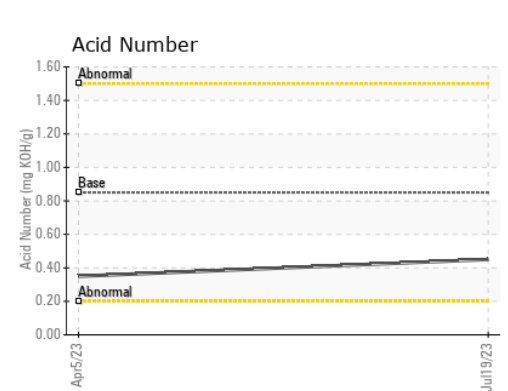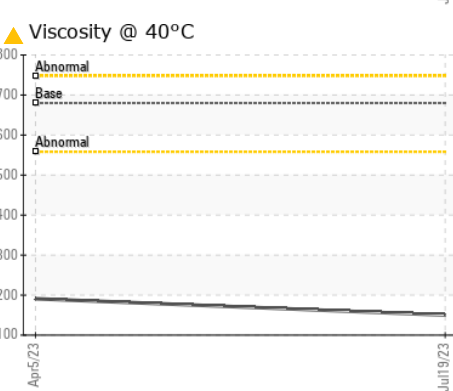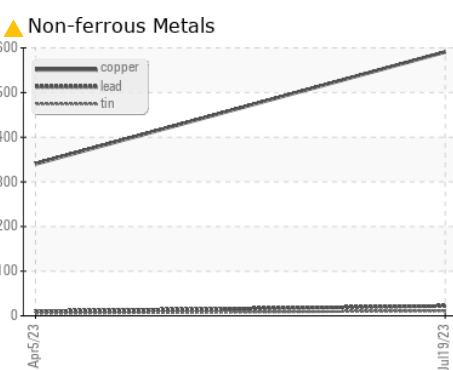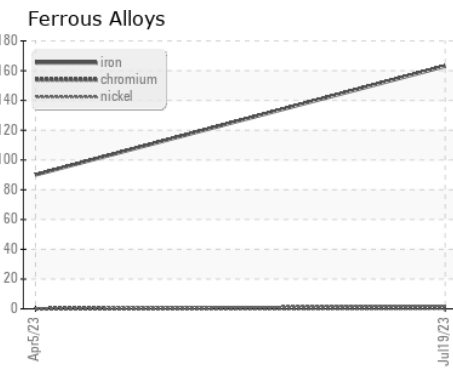

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034787 **Received** : 21 Jul 2023  
**Lab Number** : 05904448 **Diagnosed** : 01 Aug 2023  
**Unique Number** : 10565804 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CALUMET**  
 3333 MIDWAY AVENUE  
 SHREVEPORT, LA  
 US 71109  
 Contact: NICHOLAS LESAGE  
 nicholas.lesage@clmt.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)