



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**JBS310PLUS-46**  
 Machine Id  
**GARDNER DENVER S316518 - INDUSTRIAL DOOR**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number      | Client Info |             |            | <b>UCH05904451</b> | ---      | ---      |
| Sample Date        | Client Info |             |            | <b>07 Jul 2023</b> | ---      | ---      |
| Machine Age        | hrs         | Client Info |            | <b>21704</b>       | ---      | ---      |
| Oil Age            | hrs         | Client Info |            | <b>2652</b>        | ---      | ---      |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | ---      | ---      |
| Sample Status      |             |             |            | <b>NORMAL</b>      | ---      | ---      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >50        | <b>&lt;1</b> | ---      | ---      |
| Chromium    | ppm | ASTM D5185m | >10        | <b>0</b>     | ---      | ---      |
| Nickel      | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Titanium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | ---      | ---      |
| Silver      | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |
| Aluminum    | ppm | ASTM D5185m | >25        | <b>&lt;1</b> | ---      | ---      |
| Lead        | ppm | ASTM D5185m | >25        | <b>0</b>     | ---      | ---      |
| Copper      | ppm | ASTM D5185m | >50        | <b>2</b>     | ---      | ---      |
| Tin         | ppm | ASTM D5185m | >15        | <b>0</b>     | ---      | ---      |
| Vanadium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | ---      | ---      |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>     | ---      | ---      |




| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m | 0.1        | <b>0</b>     | ---      | ---      |
| Barium     | ppm | ASTM D5185m | 0.8        | <b>0</b>     | ---      | ---      |
| Molybdenum | ppm | ASTM D5185m | 0          | <b>0</b>     | ---      | ---      |
| Manganese  | ppm | ASTM D5185m | 0.9        | <b>&lt;1</b> | ---      | ---      |
| Magnesium  | ppm | ASTM D5185m | 0          | <b>3</b>     | ---      | ---      |
| Calcium    | ppm | ASTM D5185m | 0          | <b>4</b>     | ---      | ---      |
| Phosphorus | ppm | ASTM D5185m | 409        | <b>407</b>   | ---      | ---      |
| Zinc       | ppm | ASTM D5185m | 0          | <b>23</b>    | ---      | ---      |
| Sulfur     | ppm | ASTM D5185m | 1290       | <b>799</b>   | ---      | ---      |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >25        | <b>0</b>     | ---      | ---      |
| Sodium       | ppm | ASTM D5185m |            | <b>4</b>     | ---      | ---      |
| Potassium    | ppm | ASTM D5185m | >20        | <b>0</b>     | ---      | ---      |
| Water        | %   | ASTM D6304  | >0.1       | <b>0.186</b> | ---      | ---      |
| ppm Water    | ppm | ASTM D6304  | >1000      | <b>1860</b>  | ---      | ---      |

| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 | 0.537      | <b>0.73</b> | ---      | ---      |



# OIL ANALYSIS REPORT

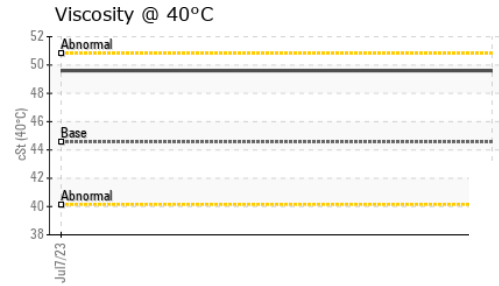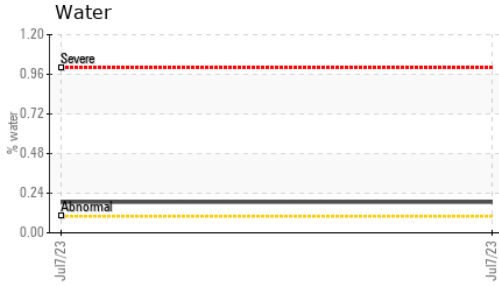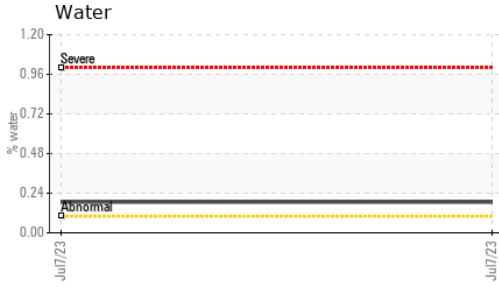






| VISUAL           | method | limit/base | current | history1     | history2 |     |
|------------------|--------|------------|---------|--------------|----------|-----|
| White Metal      | scalar | *Visual    | NONE    | <b>NONE</b>  | ---      | --- |
| Yellow Metal     | scalar | *Visual    | NONE    | <b>NONE</b>  | ---      | --- |
| Precipitate      | scalar | *Visual    | NONE    | <b>NONE</b>  | ---      | --- |
| Silt             | scalar | *Visual    | NONE    | <b>NONE</b>  | ---      | --- |
| Debris           | scalar | *Visual    | NONE    | <b>MODER</b> | ---      | --- |
| Sand/Dirt        | scalar | *Visual    | NONE    | <b>NONE</b>  | ---      | --- |
| Appearance       | scalar | *Visual    | NORML   | <b>NORML</b> | ---      | --- |
| Odor             | scalar | *Visual    | NORML   | <b>NORML</b> | ---      | --- |
| Emulsified Water | scalar | *Visual    | >0.1    | <b>0.2%</b>  | ---      | --- |
| Free Water       | scalar | *Visual    |         | <b>NEG</b>   | ---      | --- |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |     |
|------------------|--------|------------|---------|-------------|----------|-----|
| Visc @ 40°C      | cSt    | ASTM D445  | 44.56   | <b>49.6</b> | ---      | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

|        |  |  |  |          |          |
|--------|--|--|--|----------|----------|
| Color  |  |  |  | no image | no image |
| Bottom |  |  |  | no image | no image |

## GRAPHS

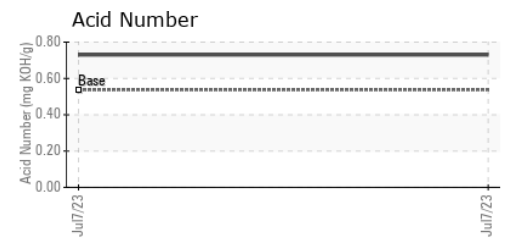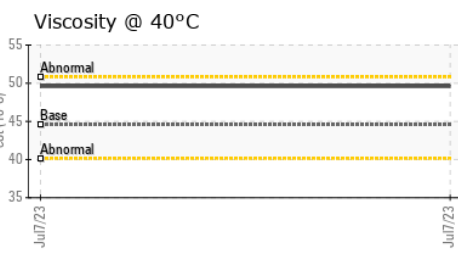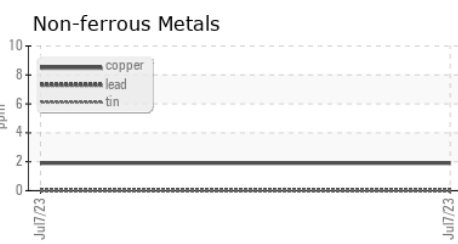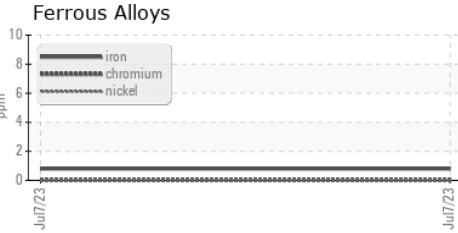

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05904451 **Received** : 21 Jul 2023  
**Lab Number** : **05904451** **Diagnosed** : 26 Jul 2023  
**Unique Number** : 10565807 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF )

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)