


OIL ANALYSIS REPORT

IR ULTRA COOLANT







Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun2023		
SAMPLE INFORM	AATION				المراجعة أحا	histow.0
	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05904452		
Sample Date		Client Info		19 Jun 2023		
Machine Age	hrs	Client Info		13938		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	27		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	500	491		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	3		
Calcium	ppm	ASTM D5185m	0	17		
Phosphorus	ppm	ASTM D5185m	20	12		
Zinc	ppm	ASTM D5185m	0	170		
Sulfur	ppm	ASTM D5185m	200	1727		
CONTAMINANTS	• •	method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	2	,	
	ppm	ASTM D5185m	>25			
Sodium	ppm		00	127		
Potassium	ppm	ASTM D5185m	>20	8		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.47		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		



OIL ANALYSIS REPORT

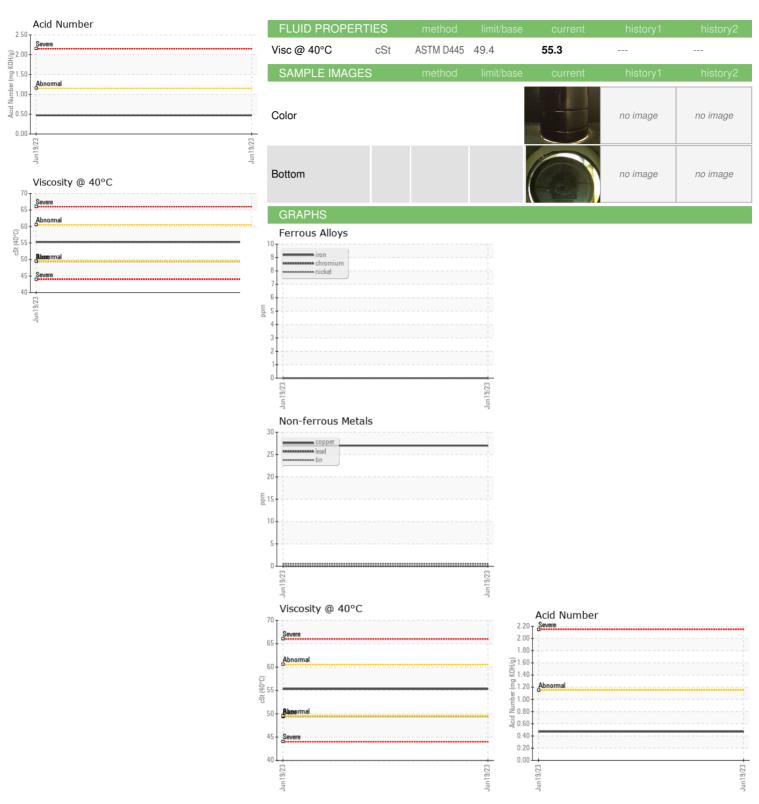





Laboratory Sample No.

Lab Number Unique Number : 10565808

: UCH05904452 : 05904452

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 21 Jul 2023 : 24 Jul 2023 Diagnostician : Doug Bogart

Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) TATE ENGINEERING

3921 Vero Road BALTIMORE, MD US 21227

Contact: MICHAEL DEAN michael.dean@tate.com

T:

F: