




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

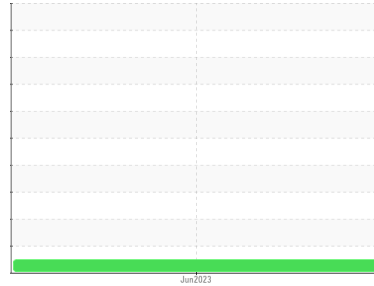

Area  
**CHEVRON [1382726]**  
 Machine Id  
**ATLAS COPCO APF167-166**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

We suspect abnormal contamination may be due to sampling method. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### Wear

Moderate concentration of visible metal present. All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05904475</b>	---	---
Sample Date	Client Info			<b>27 Jun 2023</b>	---	---
Machine Age	hrs	Client Info		<b>74057</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Not Chngd</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>65	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>65	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>3</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>10</b>	---	---
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>880</b>	---	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>4</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.17</b>	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>MODER</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>MODER</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---



# OIL ANALYSIS REPORT



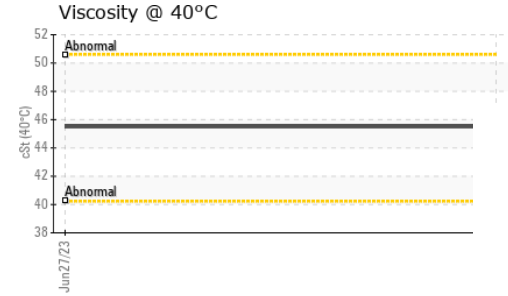
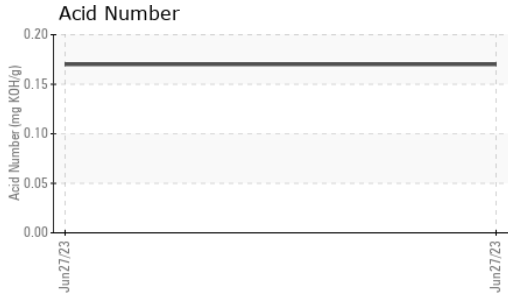


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image		
Bottom		no image	no image		

## GRAPHS

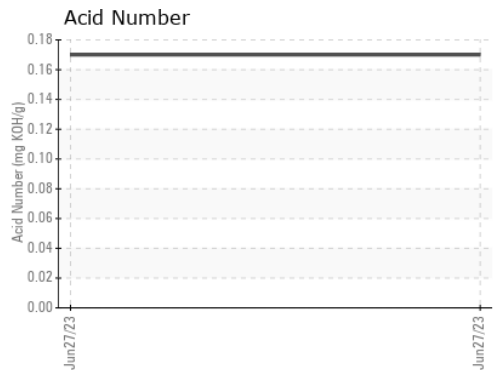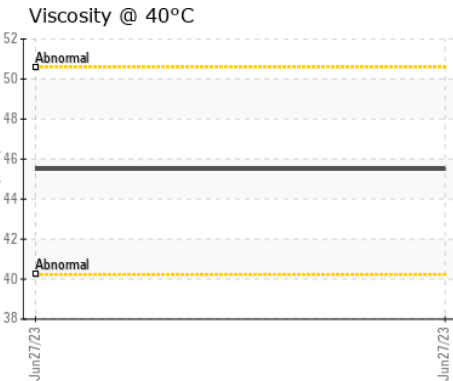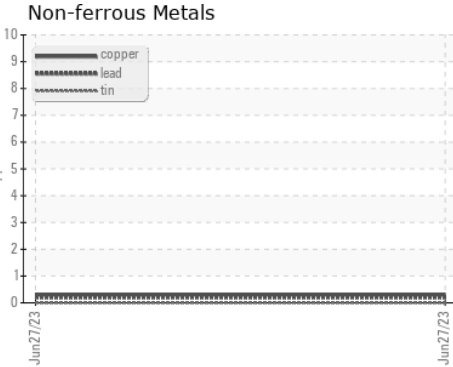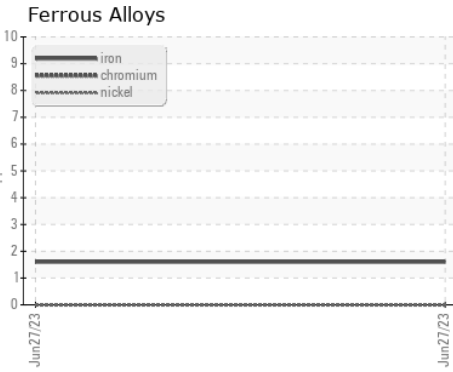

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05904475 **Received** : 21 Jul 2023  
**Lab Number** : 05904475 **Diagnosed** : 24 Jul 2023  
**Unique Number** : 10565831 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**AIR TECHNOLOGIES INC (DET-LIV)**  
 11771 BELDEN CT  
 LIVONIA, MI  
 US 48150-1446  
 Contact: CHAD ASMUS  
 chad.asmus@aircompressors.com  
 T: (734)762-9247  
 F: (734)762-9248

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)