




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

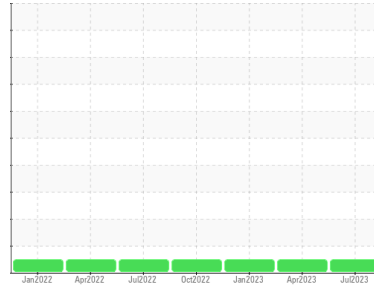

Machine Id  
**MH-HT-2 (S/N 00857-003-1-01-02)**

Component  
**Refrigeration Compressor**  
Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP248264</b>	USP245956	USP233930
Sample Date	Client Info	<b>11 Jul 2023</b>	17 Apr 2023	16 Jan 2023
Machine Age	hrs	<b>5896</b>	3860	3262
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 50	<b>&lt;1</b>	14	3

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.002</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >100	<b>21.5</b>	13.1	18.4

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>134</b>	296	509
Particles >6µm	ASTM D7647 >2500	<b>40</b>	78	99
Particles >14µm	ASTM D7647 >320	<b>4</b>	5	9
Particles >21µm	ASTM D7647 >80	<b>2</b>	1	1
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>14/12/9</b>	15/13/10	16/14/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.015



# OIL ANALYSIS REPORT

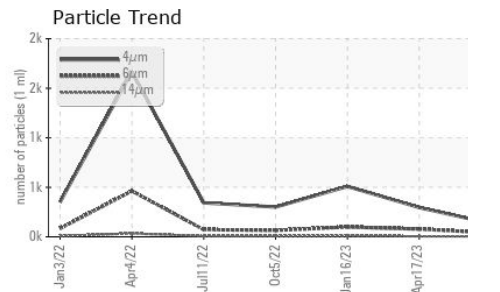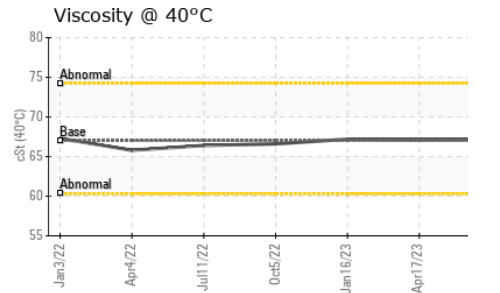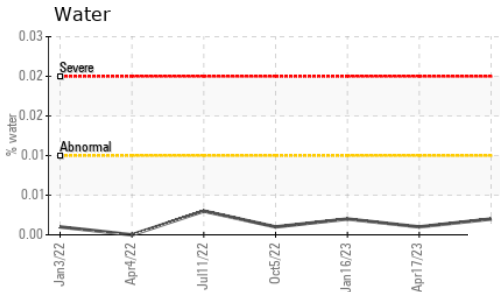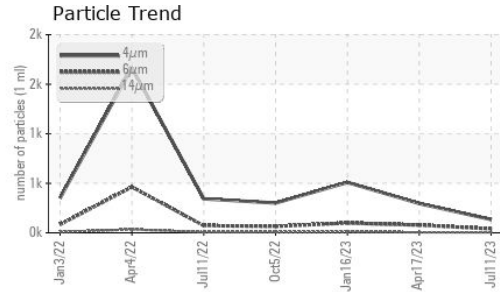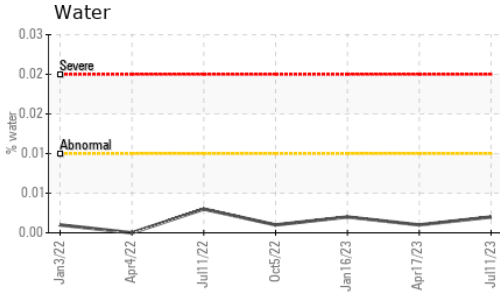




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	<b>67.2</b>	67.1	67.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

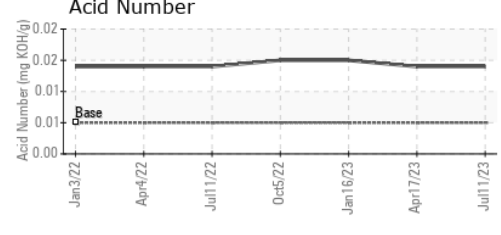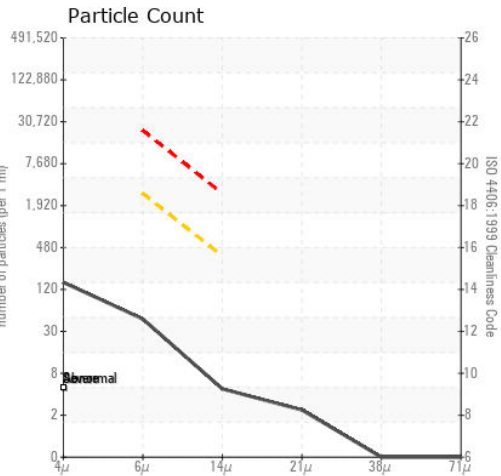

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP248264 **Received** : 21 Jul 2023  
**Lab Number** : 05904923 **Diagnosed** : 24 Jul 2023  
**Unique Number** : 10566279 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON - FREEZER**  
 28424 38TH AVE N  
 JOSLIN, IL  
 US 61257  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6661