




# OIL ANALYSIS REPORT

Sample Rating Trend

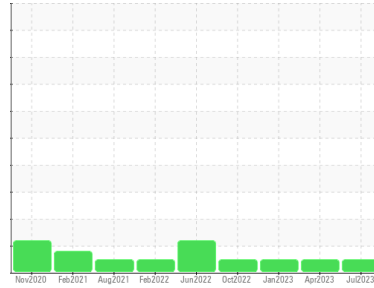

**NORMAL**



Machine Id  
**KAESER BSD 60 2722725 (S/N 1080)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC121438</b>	KC107723	KC108083
Sample Date	Client Info			<b>17 Jul 2023</b>	17 Apr 2023	16 Jan 2023
Machine Age	hrs	Client Info		<b>93488</b>	91333	90597
Oil Age	hrs	Client Info		<b>0</b>	1500	1000
Oil Changed	Client Info			<b>N/A</b>	Not Changd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	2	3
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	31	57
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	51	56
Calcium	ppm	ASTM D5185m	2	<b>0</b>	2	1
Phosphorus	ppm	ASTM D5185m		<b>0</b>	3	2
Zinc	ppm	ASTM D5185m		<b>0</b>	0	4

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>1</b>	15	11
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	2	3
Water	%	ASTM D6304	>0.05	<b>0.004</b>	0.010	0.012
ppm Water	ppm	ASTM D6304	>500	<b>41.4</b>	108.8	123.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>799</b>	491	669
Particles >6µm		ASTM D7647	>1300	<b>271</b>	122	211
Particles >14µm		ASTM D7647	>80	<b>38</b>	12	19
Particles >21µm		ASTM D7647	>20	<b>9</b>	3	5
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/15/12</b>	16/14/11	17/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.39</b>	0.37	0.33


# OIL ANALYSIS REPORT

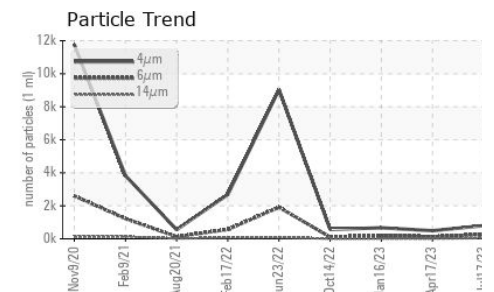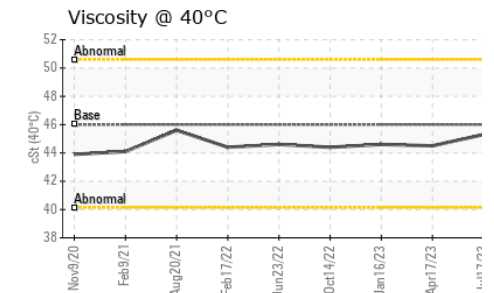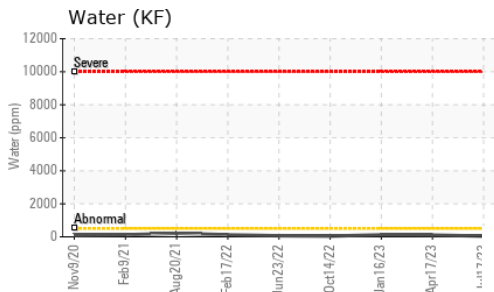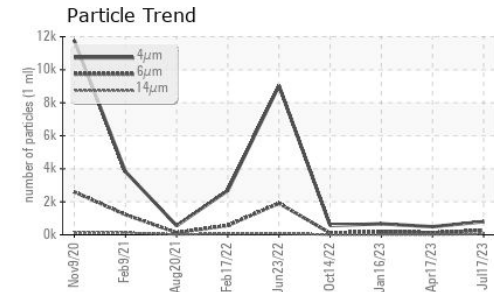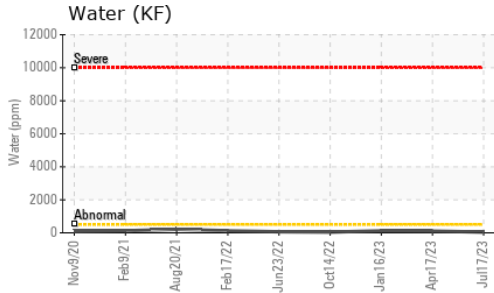






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.3	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

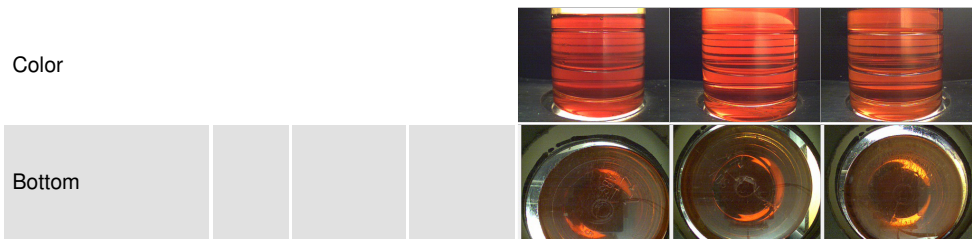

## GRAPHS

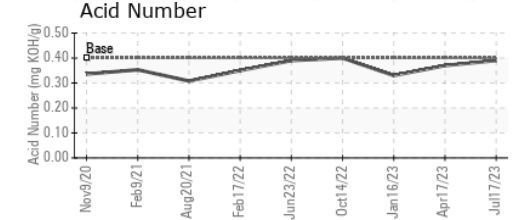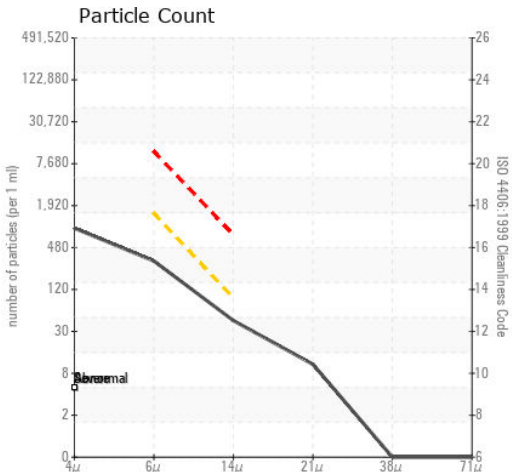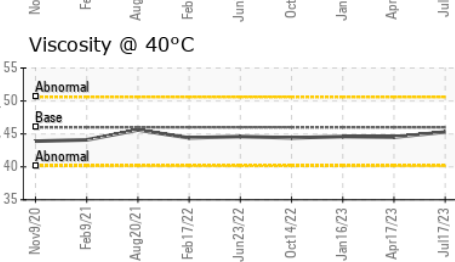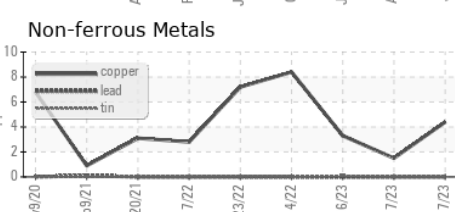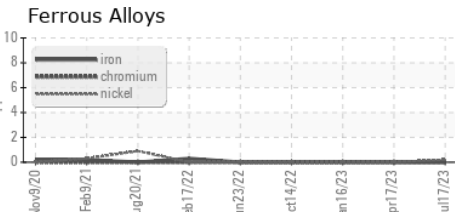

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121438  
**Lab Number** : 05904933  
**Unique Number** : 10566289  
**Test Package** : IND 2  
**Received** : 21 Jul 2023  
**Tested** : 24 Jul 2023  
**Diagnosed** : 25 Jul 2023 - Angela Borella

**NORMAN NOBLE**  
 5340 AVION PKWY  
 HIGHLAND HEIGHTS, OH  
 US 44143  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: