




PROBLEM SUMMARY

Sample Rating Trend

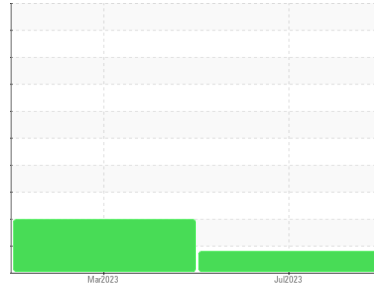


ISO



Machine Id
335 - EFFECT 6 LIQUOR TRANSFER
 Component
Pump
 Fluid
MOBIL SHC 626 (1 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

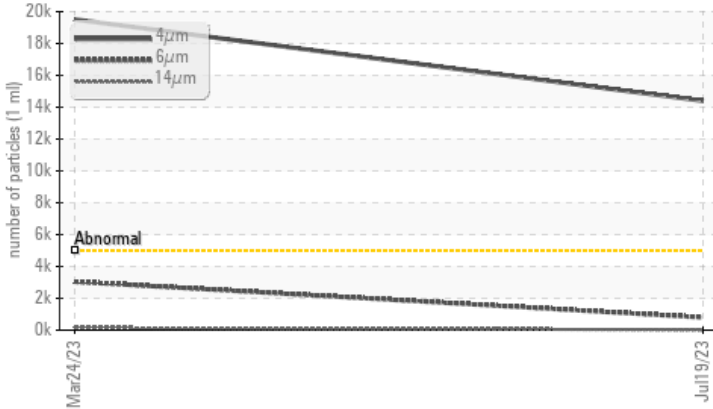

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Analytical Ferrography: Results are normal with typical amounts of ferrous rubbing wear and contamination present.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	---
Particles >4µm	ASTM D7647 >5000	▲ 14399	▲ 19511	---
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ 21/17/11	▲ 21/19/14	---

Customer Id: GRAMAC
 Sample No.: WC0824334
 Lab Number: 05904979
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Aaron Black +1
aaron.black@wearcheck.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

24 Mar 2023 Diag: Aaron Black

CONTAMINANT



We recommend you service the filters on this component (as applicable). If filtration is not possible, consider flushing the sump to remove as much contamination as possible. Recommend investigating the source of contamination. We recommend an early resample to monitor this condition. Analytical Ferrography: Mildly elevated contamination levels are present. Ferrous rubbing wear is present in low levels. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

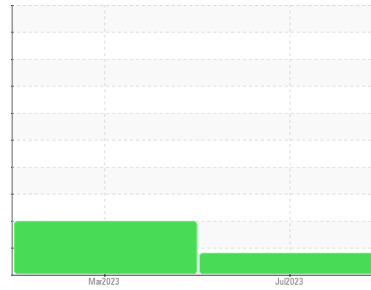

ISO



Machine Id
335 - EFFECT 6 LIQUOR TRANSFER

Component
Pump
Fluid
MOBIL SHC 626 (1 GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Analytical Ferrography: Results are normal with typical amounts of ferrous rubbing wear and contamination present.

Wear

All component wear rates are normal. The analytical ferrographic results are normal indicating no abnormal wear in the system.

▲ Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Oil Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0824334	WC0783652	---
Sample Date	Client Info		19 Jul 2023	24 Mar 2023	---
Machine Age	mths	Client Info	0	0	---
Oil Age	mths	Client Info	3	0	---
Oil Changed	Client Info		Not Changed	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		7	7	---
Iron	ppm	ASTM D5185m >90	<1	2	---
Chromium	ppm	ASTM D5185m >5	0	0	---
Nickel	ppm	ASTM D5185m >5	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >3	<1	0	---
Aluminum	ppm	ASTM D5185m >7	0	<1	---
Lead	ppm	ASTM D5185m >12	0	0	---
Copper	ppm	ASTM D5185m >30	0	0	---
Tin	ppm	ASTM D5185m >9	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	<1	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m	474	444	---
Zinc	ppm	ASTM D5185m	0	0	---
Sulfur	ppm	ASTM D5185m	0	0	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	2	2	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	0	<1	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 14399	▲ 19511	---
Particles >6µm	ASTM D7647	>1300	796	▲ 3041	---
Particles >14µm	ASTM D7647	>160	14	156	---
Particles >21µm	ASTM D7647	>40	2	38	---
Particles >38µm	ASTM D7647	>10	0	4	---
Particles >71µm	ASTM D7647	>3	0	1	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/17/11	▲ 21/19/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.66	0.56	---




OIL ANALYSIS REPORT

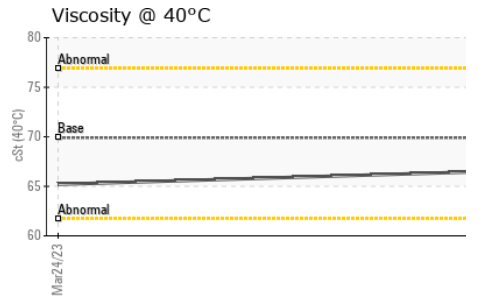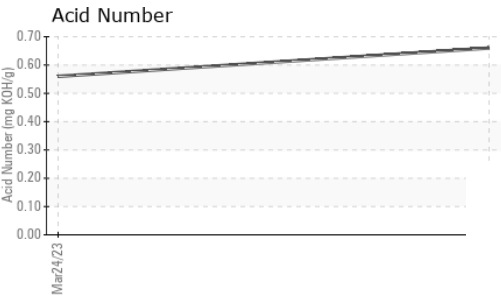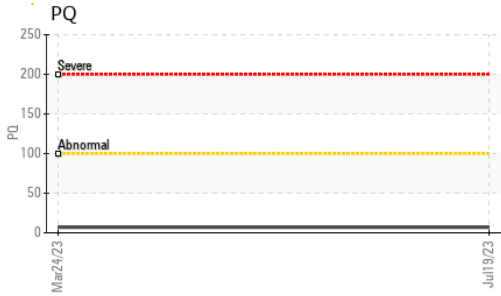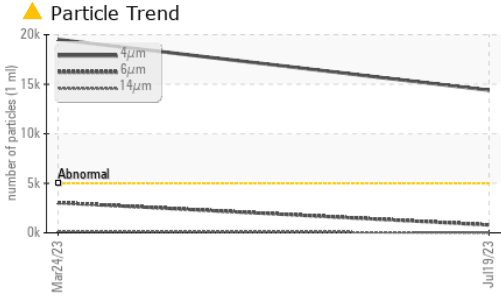





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	69.9	66.5	65.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

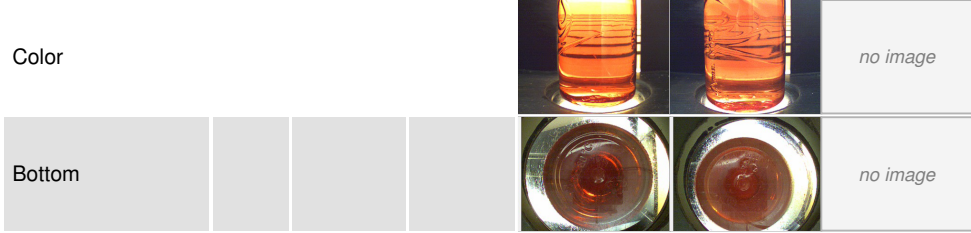

GRAPHS

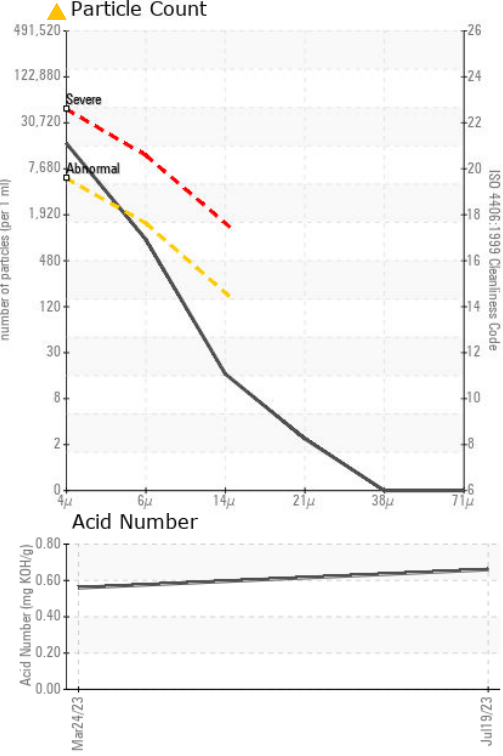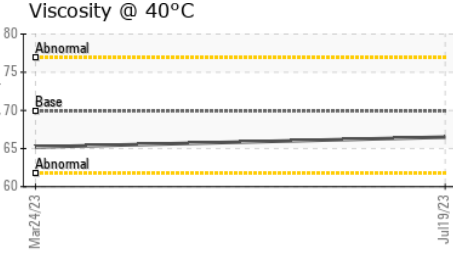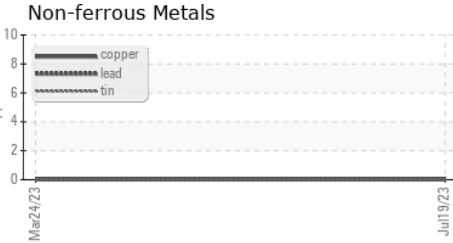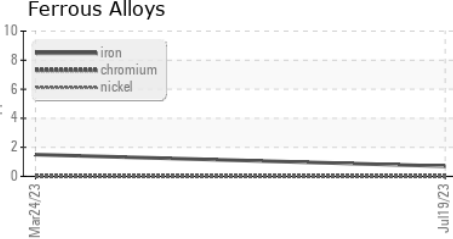




Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0824334 **Received** : 21 Jul 2023
Lab Number : 05904979 **Diagnosed** : 03 Aug 2023
Unique Number : 10566335 **Diagnostician** : Aaron Black
Test Package : PLANT (Additional Tests: A-FERR)

GRAPHIC PACKAGING INTERNATIONAL
 100 GRAPHIC PACKAGING INTERNATIONAL
 MACON, GA
 US 31206
 Contact: DARYL SPRINGER
 daryl.springer@graphicpkg.com
 T: (478)784-3677
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

FERROGRAPHY REPORT

Machine Id
335 - EFFECT 6 LIQUOR TRANSFER
 Component
Pump
 Fluid
MOBIL SHC 626 (1 GAL)

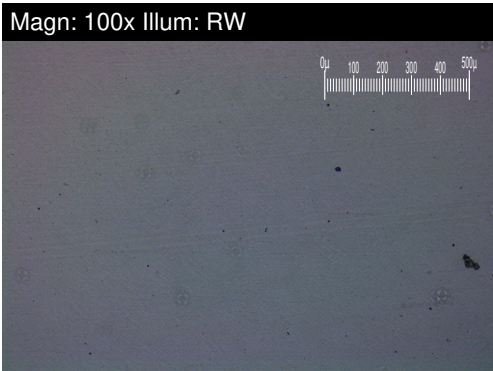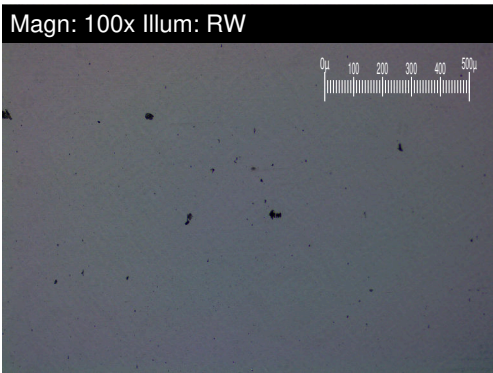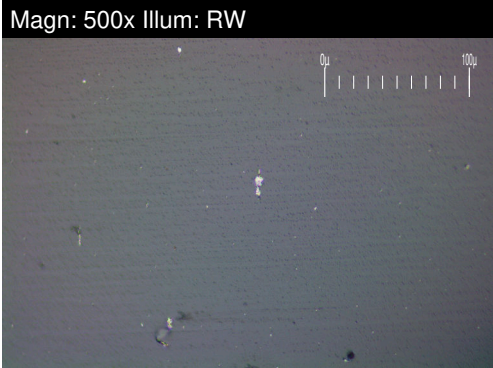

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	*ASTM D7684		■ 2	■ 2	
Ferrous Sliding	Scale 0-10	*ASTM D7684				
Ferrous Cutting	Scale 0-10	*ASTM D7684				
Ferrous Rolling	Scale 0-10	*ASTM D7684				
Ferrous Break-in	Scale 0-10	*ASTM D7684				
Ferrous Spheres	Scale 0-10	*ASTM D7684				
Ferrous Black Oxides	Scale 0-10	*ASTM D7684				
Ferrous Red Oxides	Scale 0-10	*ASTM D7684				
Ferrous Corrosive	Scale 0-10	*ASTM D7684				
Ferrous Other	Scale 0-10	*ASTM D7684				
Nonferrous Rubbing	Scale 0-10	*ASTM D7684				
Nonferrous Sliding	Scale 0-10	*ASTM D7684				
Nonferrous Cutting	Scale 0-10	*ASTM D7684				
Nonferrous Rolling	Scale 0-10	*ASTM D7684				
Nonferrous Other	Scale 0-10	*ASTM D7684				
Carbonaceous Material	Scale 0-10	*ASTM D7684				
Lubricant Degradation	Scale 0-10	*ASTM D7684				
Sand/Dirt	Scale 0-10	*ASTM D7684				
Fibres	Scale 0-10	*ASTM D7684				
Spheres	Scale 0-10	*ASTM D7684				
Other	Scale 0-10	*ASTM D7684		■ 2	▲ 4	

WEAR

All component wear rates are normal. The analytical ferrographic results are normal indicating no abnormal wear in the system.

This page left intentionally blank