




# PROBLEM SUMMARY

Sample Rating Trend

ISO




Machine Id  
**MYCOM LSB-2-ER-1 (S/N SU1426)**  
Component  
**Refrigeration Compressor**  
Fluid  
**USPI ALT-68 SC (--- GAL)**

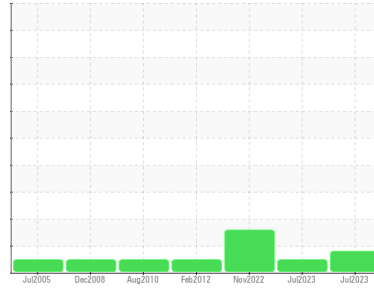

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

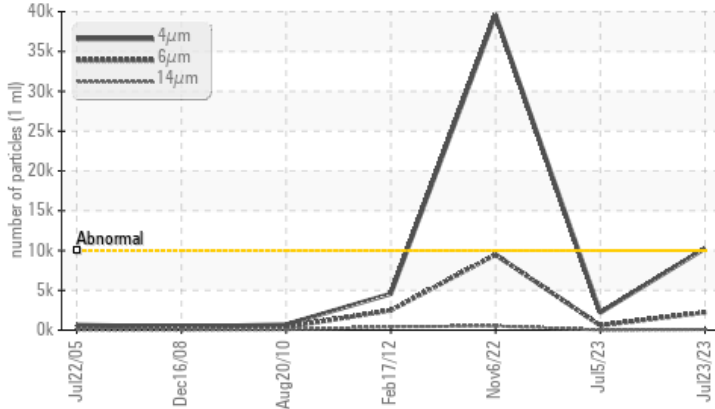

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	ABNORMAL
Particles >4µm	ASTM D7647 >10000	▲ 10268	2204	▲ 39600
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 21/18/14	18/16/12	▲ 22/20/16

Customer Id: ADVORA  
Sample No.: USPM5905481  
Lab Number: 05905481  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 05 Jul 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 06 Nov 2022 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 17 Feb 2012 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The condition of oil is suitable for further service.

view report





# OIL ANALYSIS REPORT


Sample Rating Trend

ISO



Machine Id  
**MYCOM LSB-2-ER-1 (S/N SU1426)**

Component  
**Refrigeration Compressor**  
Fluid  
**USPI ALT-68 SC (--- GAL)**

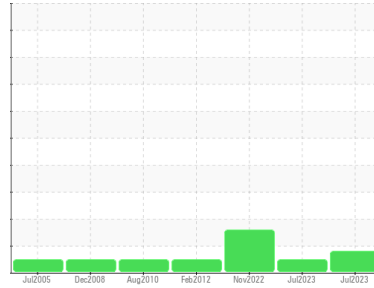

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM5905481</b>	USP243431	USP226040
Sample Date	Client Info		<b>23 Jul 2023</b>	05 Jul 2023	06 Nov 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ATTENTION</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	1	2
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	0
Water	%	ASTM D6304 >0.01	<b>0.007</b>	0.003	0.003
ppm Water	ppm	ASTM D6304 >100	<b>70.8</b>	32.6	32.2

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 10268</b>	2204	<b>▲ 39600</b>
Particles >6µm	ASTM D7647	>2500	<b>2228</b>	595	<b>▲ 9478</b>
Particles >14µm	ASTM D7647	>320	<b>84</b>	23	<b>▲ 517</b>
Particles >21µm	ASTM D7647	>80	<b>22</b>	4	<b>77</b>
Particles >38µm	ASTM D7647	>20	<b>1</b>	0	<b>4</b>
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	<b>0</b>
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 21/18/14</b>	18/16/12	<b>▲ 22/20/16</b>


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.015</b>	0.043	0.015




# OIL ANALYSIS REPORT


## Particle Trend

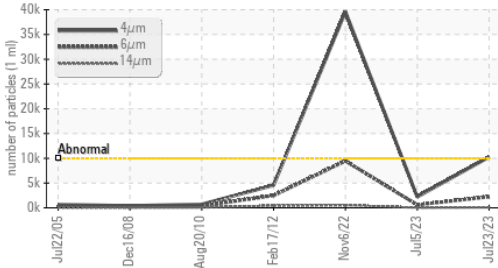


## Water

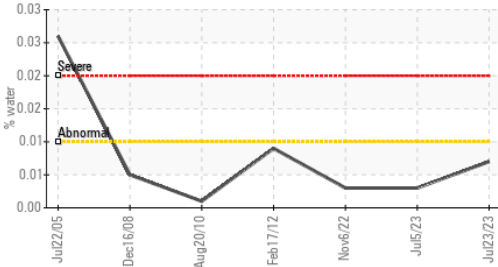


## Acid Number

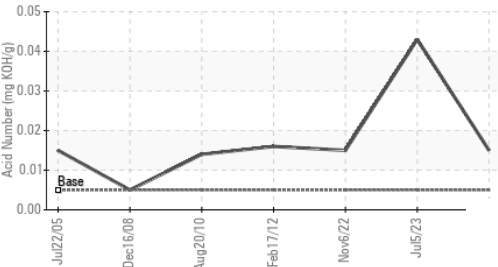

## Water

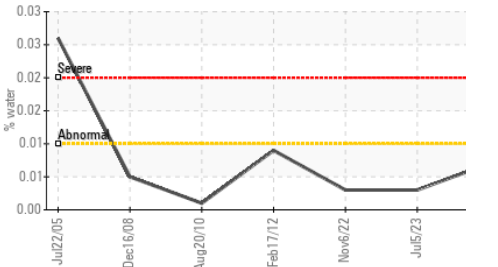


## Viscosity @ 40°C

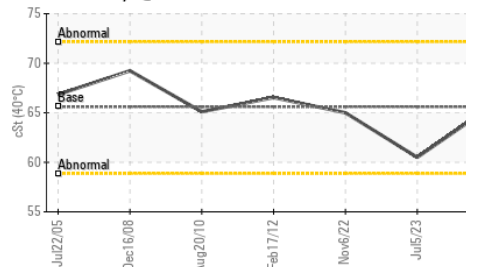

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	65.5	60.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

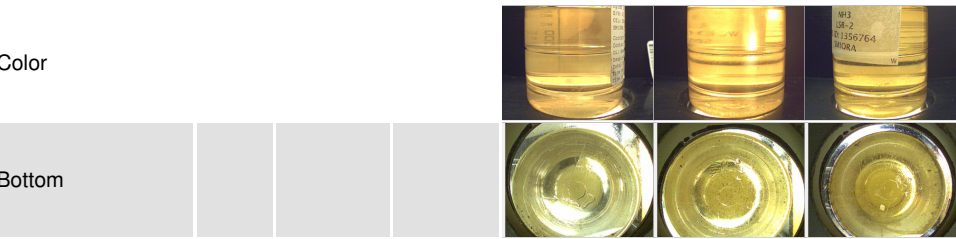


## GRAPHS


### Ferrous Alloys

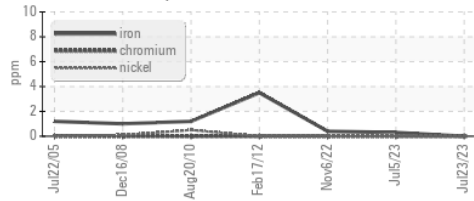


### Non-ferrous Metals

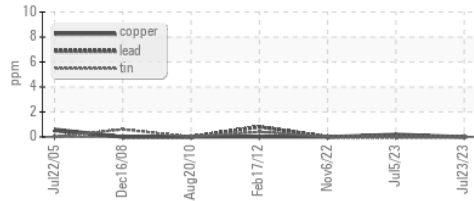


### Viscosity @ 40°C

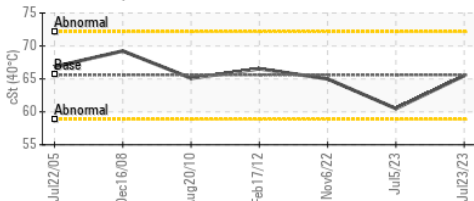

### Particle Count

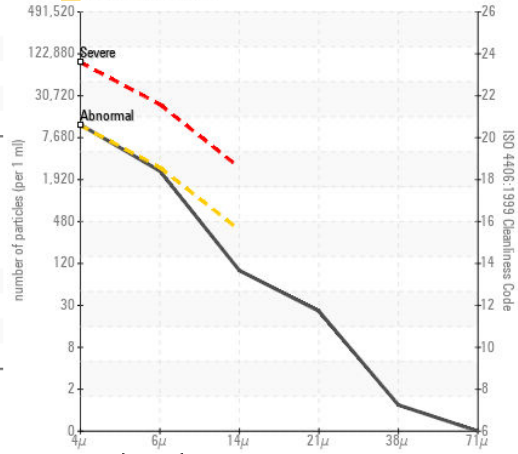

### Acid Number

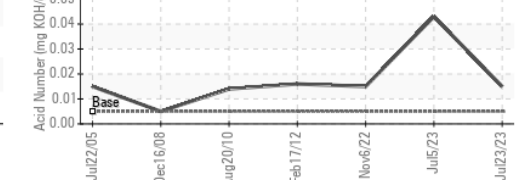

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM5905481 **Received** : 24 Jul 2023  
**Lab Number** : 05905481 **Diagnosed** : 25 Jul 2023  
**Unique Number** : 10566837 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**ADVANCED BRANDS-ORANGE**  
 101 14TH ST. SE  
 ORANGE, IA  
 US 51041  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (712)737-4820

F: