

OIL ANALYSIS REPORT

Sample Rating Trend





Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2023		
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC101756		
Sample Date		Client Info		13 Jul 2023		
Machine Age	hrs	Client Info		1664		
Oil Age	hrs	Client Info		1664		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	19		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	24		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	186.4		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3937		
Particles >6µm		ASTM D7647	>1300	1234		
Particles >14µm		ASTM D7647	>80	71		
Particles >21µm		ASTM D7647	>20	19		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40		
. ,						



OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

White Metal

Precipitate

Silt

Debris

Yellow Metal

*Visual

*Visual

*Visual

*Visual

scalar *Visual

NONE


NONE


NONE

NONE

NONE





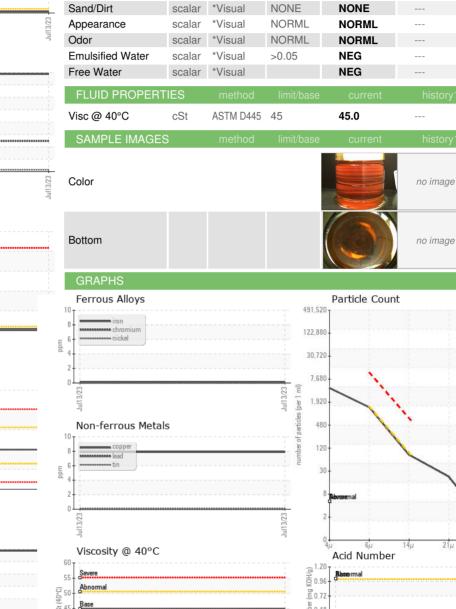

Water 1.20 0.9 _닅0.72 õ^e 0.48 0.24 0.00 Viscosity @ 40°C 60 Se 55 <u>ှ</u> 50 -73 45 Base Abnormal 4 Sev 35 Jul13/23 Particle Trend 4 Ē 31 particles (1) 3K 3K 2 2k

1

1k

0

	Viscosity @ 40° Viscosity @ 40° 55 Abnomal Base Abnomal Severe	C	kaid Number (mg K	2 4 4 4 4 4 4 4 4 4 4 4 4 4	4μ 21μ	
Laboratory Sample No. Lab Number Unique Number Test Package To discuss this sample report, * - Denotes test methods that a Statements of conformity to specific	: IND 2 contact Customer Se are outside of the ISC	Received Diagnosed Diagnostician ervice at 1-800-23 0 17025 scope of a	: 24 Jul 2023 : 25 Jul 2023 : Doug Bogart 7-1369. accreditation.			ASSOCIATION 2 8TH ST NCHVILLE, NJ US 07826 Invice Manager T: F:

NONE

NONE

NONE

NONE

NONE

Contact/Location: Service Manager - NORBRAKC

no image

no image

ISC

:1999 Cle

18 18

16

14