



PROBLEM SUMMARY

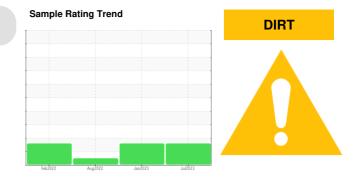

Machine Id 8089008 (S/N 1147) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

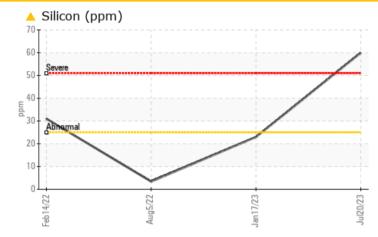

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|-----|-------------|-----|-----------|----------|--------|--|--|--|
| Sample Status | | | | ATTENTION | ABNORMAL | NORMAL | | | |
| Silicon | ppm | ASTM D5185m | >25 | <u> </u> | 23 | 3 | | | |

Customer Id: ALUPIE Sample No.: KC05905529 Lab Number: 05905529 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

17 Jan 2023 Diag: Don Baldridge

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

05 Aug 2022 Diag: Doug Bogart

14 Feb 2022 Diag: Don Baldridge

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All

component wear rates are normal. Elemental level of silicon (Si) above normal indicating ingress of seal material. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Report Id: ALUPIE [WUSCAR] 05905529 (Generated: 07/25/2023 18:40:04) Rev: 1



OIL ANALYSIS REPORT

Sample Rating Trend DIRT

Machine Id 8089008 (S/N 1147) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | ATION | method | limit/base | current | history1 | history2 |
|------------------|----------|--------------|------------|-------------|---------------|-------------|
| Sample Number | | Client Info | | KC05905529 | KC104140 | KC102871 |
| Sample Date | | Client Info | | 20 Jul 2023 | 17 Jan 2023 | 05 Aug 2022 |
| Machine Age | hrs | Client Info | | 9016 | 6800 | 4745 |
| Oil Age | hrs | Client Info | | 4273 | 2054 | 1989 |
| Oil Changed | | Client Info | | N/A | Not Changd | Changed |
| Sample Status | | | | ATTENTION | ABNORMAL | NORMAL |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | <1 | 0 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >2 | <1 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | 0 | 2 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | 6 | 3 | 1 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | <1 |
| Antimony | ppm | ASTM D5185m | | | | |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 90 | <1 | 0 | 42 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 90 | <1 | 27 | 69 |
| Calcium | ppm | ASTM D5185m | 2 | 0 | 0 | <1 |
| Phosphorus | ppm | ASTM D5185m | | 0 | 0 | 4 |
| Zinc | ppm | ASTM D5185m | | 0 | 2 | 0 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | <u> </u> | 23 | 3 |
| Sodium | ppm | ASTM D5185m | | 0 | 7 | 2 |
| Potassium | ppm | ASTM D5185m | >20 | 2 | 9 | 11 |
| Water | % | ASTM D6304 | >0.05 | 0.016 | 0.005 | 0.030 |
| ppm Water | ppm | ASTM D6304 | >500 | 164.9 | 56.1 | 305.8 |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 2168 | 12978 | 1651 |
| Particles >6µm | | ASTM D7647 | >1300 | 469 | A 2921 | 343 |
| Particles >14µm | | ASTM D7647 | >80 | 25 | 1 36 | 22 |
| Particles >21µm | | ASTM D7647 | >20 | 8 | <u> </u> | 7 |
| Particles >38µm | | ASTM D7647 | >4 | 0 | 1 | 2 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >17/13 | 16/12 | ▲ 19/14 | 16/12 |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.41 | 0.51 | 0.39 |

Contact/Location: CHRIS SHOUE - ALUPIE



Built for a lifetime

OIL ANALYSIS REPORT

method

method

method

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

limit/base

>0.05

46

current

NONE

NONE

NONE

LIGHT

NONE

NONE

NORML

NORML

curren

current

NEG

NEG

44.3

history1

VLITE

NONE

NONE

NONE

VLITE

NONE

NORML

NORML

NEG

NEG

44.5

history

history1

history2

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML


history2


history2

NEG

NEG

44.0

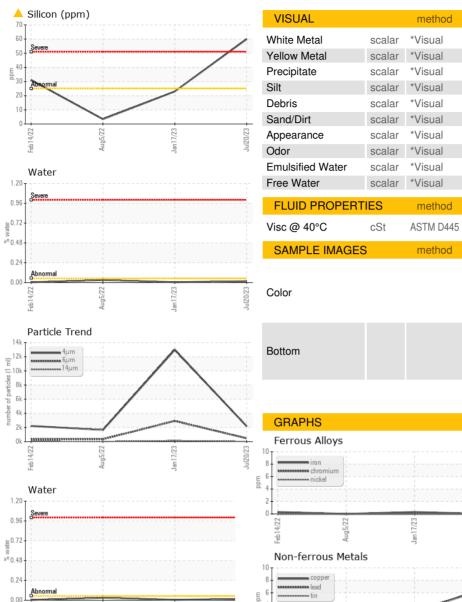

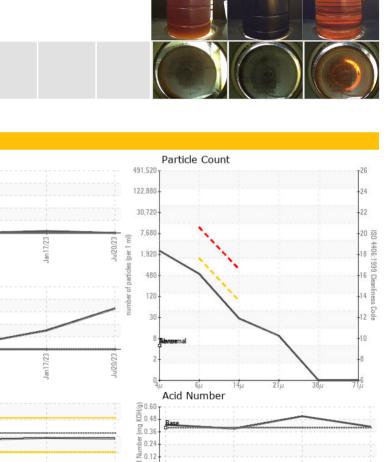

Abnorm 40 0.00 PC 35 Aug5/22 -Feb14/22 Jan 17/23 Aug5/22 Jan 17/23 3 Jul20/23 001 ua5/77 Feb 1 Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 ALUDYNE INC Sample No. **5 ARNOLT DRIVE** : KC05905529 Received : 24 Jul 2023 Lab Number : 05905529 Diagnosed : 25 Jul 2023 PIERCETON, IN US 46562 Unique Number : 10566885 Diagnostician : Don Baldridge Test Package : IND 2 Contact: CHRIS SHOUE Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. christopher.shoue@aludyne.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (574)594-9681 F:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Jan 17/23

Feb14/22

B 45

Abnorma 40

55

50

ŝ

Viscosity @ 40°C

-eb1

B

52

5

48 (D-046 44

47

Viscosity @ 40°C