


PROBLEM SUMMARY

SEDIMENT

KAESER SK 20 7023278 (S/N 1046)


Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)





COMPONENT CONDITION SUMMARY

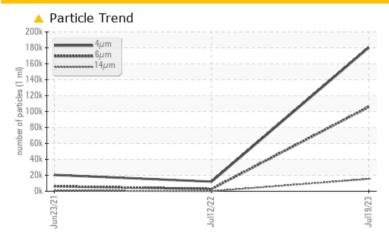

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm		ASTM D7647	>1300	105856	▲ 2823	<u>^</u> 6223				
Particles >14µm		ASTM D7647	>80	15502	▲ 131	△ 763				
Particles >21µm		ASTM D7647	>20	4514	△ 35	<u>\$\times\$ 253</u>				
Particles >38µm		ASTM D7647	>4	193	<u> </u>	<u> </u>				
Particles >71µm		ASTM D7647	>3	<u> </u>	0	0				
Oil Cleanliness		ISO 4406 (c)	>/17/13	25/24/21	<u>\$\lambda\$</u> 21/19/14	2 0/17				
Silt	scalar	*Visual	NONE	▲ MODER	NONE	NONE				

Customer Id: GOLWAT Sample No.: KC05905533 Lab Number: 05905533 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

12 Jul 2022 Diag: Jonathan Hester

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



23 Jun 2021 Diag: Don Baldridge

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.





OIL ANALYSIS REPORT

Sample Rating Trend



SEDIMENT

KAESER SK 20 7023278 (S/N 1046)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun ² 021 Jul ² 022 Jul ² 023				
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05905533	KC100228	KC78547
Sample Date		Client Info		19 Jul 2023	12 Jul 2022	23 Jun 2021
Machine Age	hrs	Client Info		2585	2023	1329
Oil Age	hrs	Client Info		0	694	1329
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	14	2	2
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	13
Barium	ppm	ASTM D5185m	90	<1	4	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	17	61	66
Calcium	ppm	ASTM D5185m	2	0	<1	1
Phosphorus	ppm	ASTM D5185m		0	8	2
Zinc	ppm	ASTM D5185m		3	3	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	0
Sodium	ppm	ASTM D5185m		9	13	17
Potassium	ppm	ASTM D5185m	>20	23	4	6
Water	%	ASTM D6304	>0.05	0.014	△ 0.082	0.049
ppm Water	ppm	ASTM D6304	>500	143.5	▲ 821.9	494.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		180247	12066	20489
Particles >6µm		ASTM D7647	>1300	<u> </u>	▲ 2823	<u>▲</u> 6223
Particles >14μm		ASTM D7647	>80	15502	<u> </u>	▲ 763
Particles >21µm		ASTM D7647	>20	4514	△ 35	<u>△</u> 253
Particles >38µm		ASTM D7647	>4	193	<u> 5</u>	<u> </u>
Particles >71µm		ASTM D7647	>3	<u> </u>	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 25/24/21	<u>^</u> 21/19/14	△ 20/17
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (AN)	ma I/OII/a	ACTM DODAE	0.4	0.15	0.40	0.205

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.40

0.15

0.305



OIL ANALYSIS REPORT

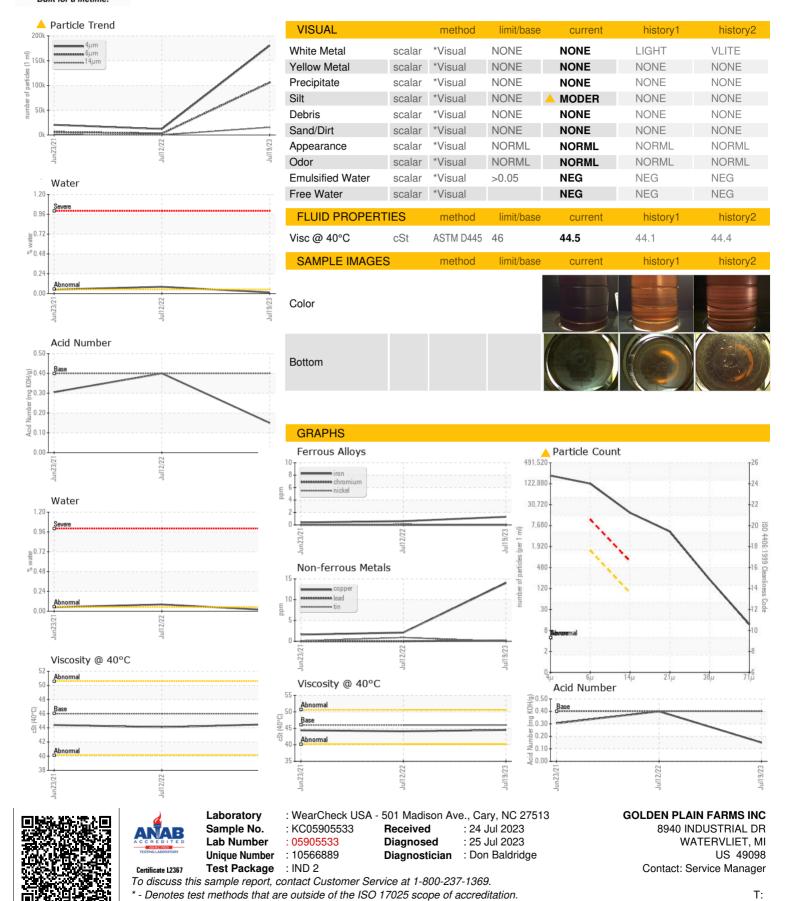

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: