

## **OIL ANALYSIS REPORT**

Area S-460 [5486] Machine Id KAESER 2001 - THE PRINTER INC

Compressor

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






NORMAL

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05905611		
Sample Date		Client Info		28 Jun 2023		
Machine Age	hrs	Client Info		29724		
Oil Age	hrs	Client Info		326		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	_ <1		
Vanadium	ppm	ASTM D5185m	210	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	4		
Molybdenum	ppm	ASTM D5185m	00	0		
Manganese	ppm	ASTM D5185m		۰ <1		
Magnesium	ppm	ASTM D5185m	90	د 61		
Calcium		ASTM D5185m	2	3		
	ppm	ASTM D5185m	2	5		
Phosphorus Zinc	ppm	ASTM D5185m		38		
Sulfur	ppm	ASTM D5185m		22525		
	ppm					
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		19		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
6.19.22) Pour 1			0	taat/Lagation: M		

Contact/Location: MICHAEL FERRIS - UCDELCED



# **OIL ANALYSIS REPORT**

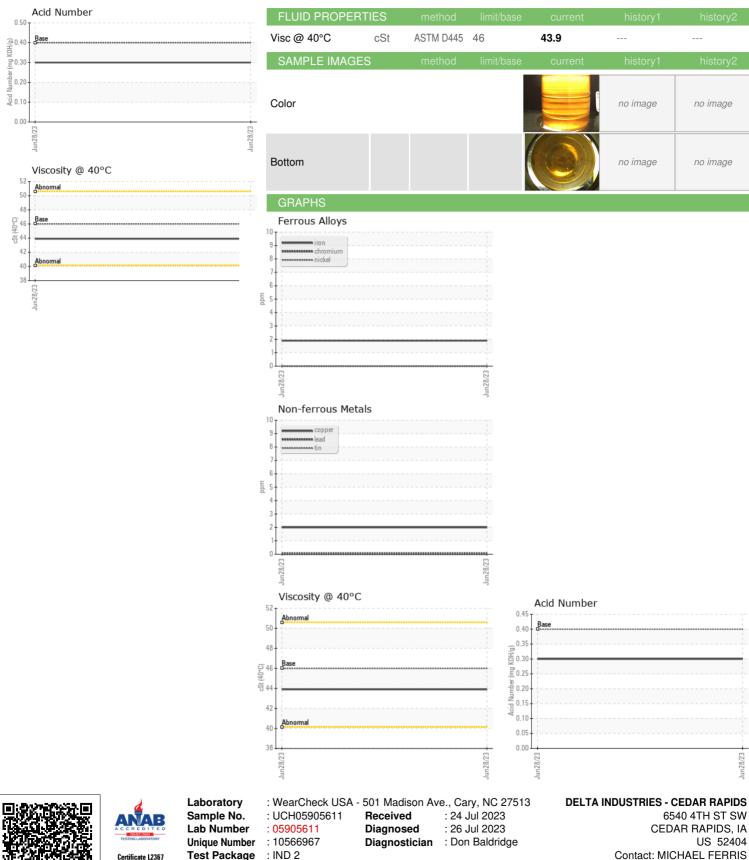

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: MICHAEL FERRIS - UCDELCED

6540 4TH ST SW

T: (319)862-2500

F: (319)862-2501

US 52404

CEDAR RAPIDS, IA

wearcheck@deltaind.net

no image

no image