




# OIL ANALYSIS REPORT

Sample Rating Trend

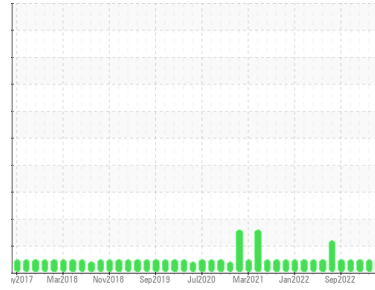

**NORMAL**



Machine Id  
**VILTER 2**

Component  
**Compressor**

Fluid  
**MOBIL SHC 627 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0745752</b>	WC0745739	WC0745733
Sample Date	Client Info		<b>02 Aug 2023</b>	02 Mar 2023	05 Jan 2023
Machine Age	hrs	Client Info	<b>88400</b>	84704	83370
Oil Age	hrs	Client Info	<b>88400</b>	84704	83370
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	4	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	<1	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	6	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	12	0
Phosphorus	ppm	ASTM D5185m	<b>49</b>	45	65
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>1963</b>	1486	1708

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>16</b>	16	16
Sodium	ppm	ASTM D5185m	<b>4</b>	0	2
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>1584</b>	1515	1977
Particles >6µm	ASTM D7647	>2500	<b>327</b>	291	512
Particles >14µm	ASTM D7647	>320	<b>21</b>	3	29
Particles >21µm	ASTM D7647	>80	<b>6</b>	1	8
Particles >38µm	ASTM D7647	>20	<b>1</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/18/15	<b>18/16/12</b>	18/15/9	18/16/12


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.49</b>	0.47	0.56




# OIL ANALYSIS REPORT


Particle Trend

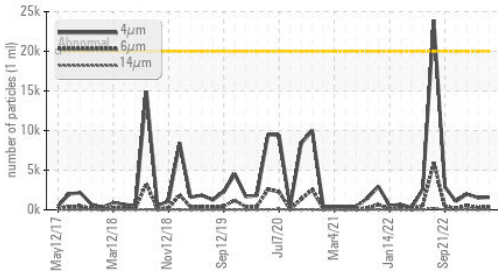


Acid Number

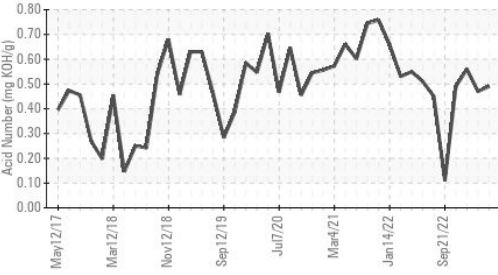

Viscosity @ 40°C

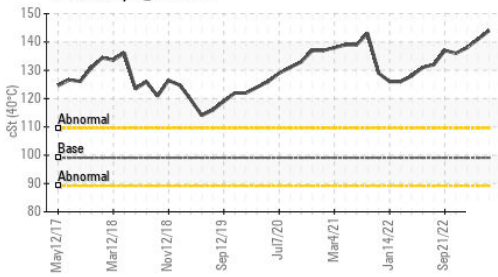

Particle Trend

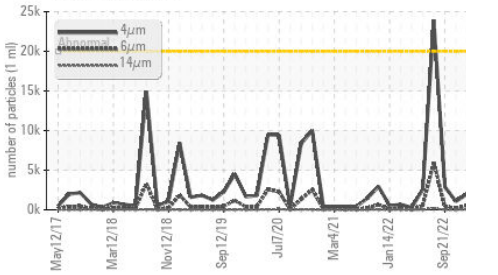


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	99.1	144	141

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

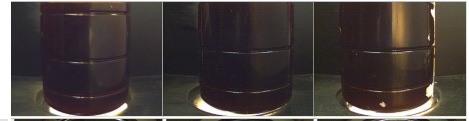


Bottom




## GRAPHS


Ferrous Alloys

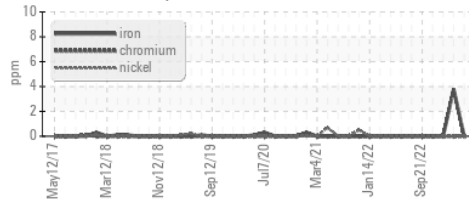


Non-ferrous Metals

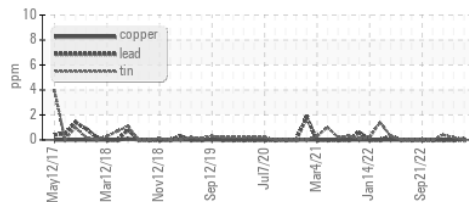


Viscosity @ 40°C

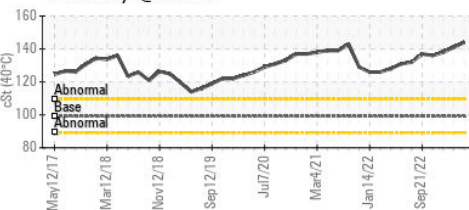

Particle Count

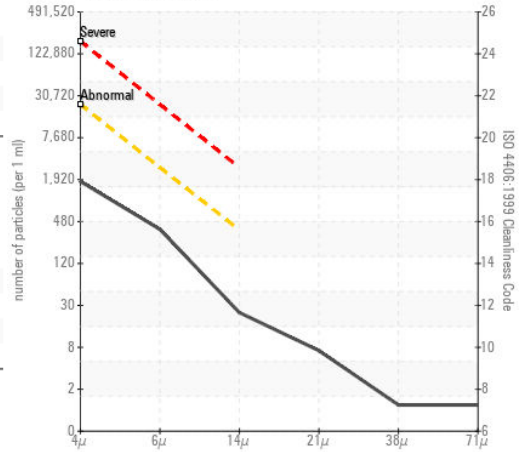

Acid Number

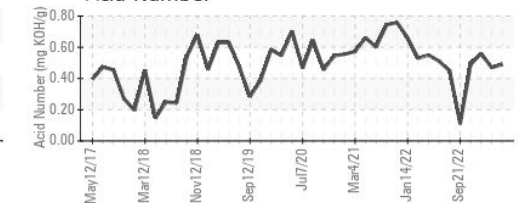

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0745752 Received : 11 Aug 2023  
 Lab Number : 05922155 Diagnosed : 14 Aug 2023  
 Unique Number : 10602102 Diagnostician : Jonathan Hester  
 Test Package : IND 2 ( Additional Tests: PrtCount )

**GREENE VALLEY LANDFILL**  
 9 SOUTH 610 GREENE ROAD  
 NAPERVILLE, IL  
 US 60565  
 Contact: CHRIS ADEN  
 caden@wm.com  
 T: (630)743-4479  
 F: (630)983-1535

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)