




# OIL ANALYSIS REPORT

Sample Rating Trend

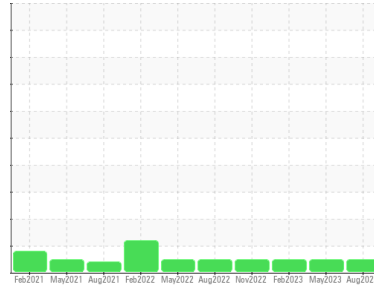

**NORMAL**



Machine Id  
**B34376 (S/N C4032)**

Component  
**Pump**  
Fluid  
**BUSCH R605 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0825629</b>	WC0794801	WC0768279
Sample Date	Client Info	<b>09 Aug 2023</b>	08 May 2023	08 Feb 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>Not Changed</b>	Not Changed	Not Changed
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	<b>&lt;1</b>	0	0
Chromium	ppm ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >7	<b>1</b>	0	0
Lead	ppm ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm ASTM D5185m >30	<b>&lt;1</b>	0	0
Tin	ppm ASTM D5185m >9	<b>0</b>	0	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	1	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm ASTM D5185m	<b>27</b>	0	0
Phosphorus	ppm ASTM D5185m	<b>9</b>	1	3
Zinc	ppm ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m	<b>29</b>	32	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >60	<b>10</b>	9	8
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>0</b>	<1	0
Water	% ASTM D6304	<b>0.005</b>	0.00	0.002
ppm Water	ppm ASTM D6304 >.1	<b>54.7</b>	0.00	21.2

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	<b>859</b>	557	1380
Particles >6µm	ASTM D7647 >1300	<b>193</b>	181	430
Particles >14µm	ASTM D7647 >160	<b>16</b>	13	10
Particles >21µm	ASTM D7647 >40	<b>4</b>	2	2
Particles >38µm	ASTM D7647 >10	<b>0</b>	0	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	<b>17/15/11</b>	16/15/11	18/16/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.091</b>	0.051	0.055




# OIL ANALYSIS REPORT

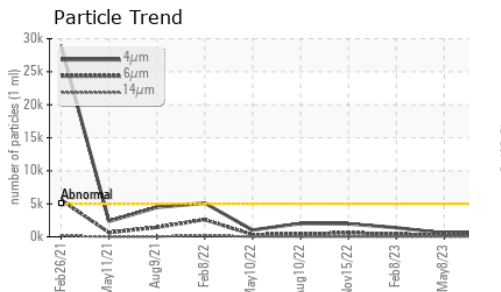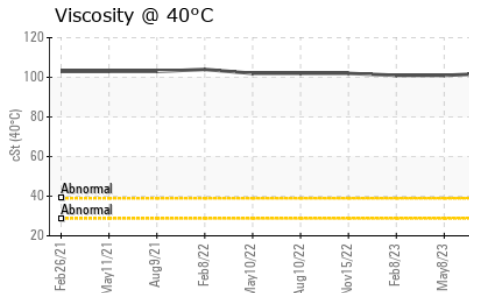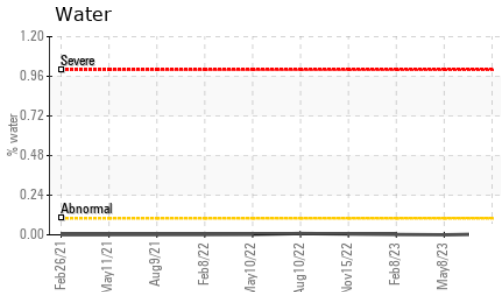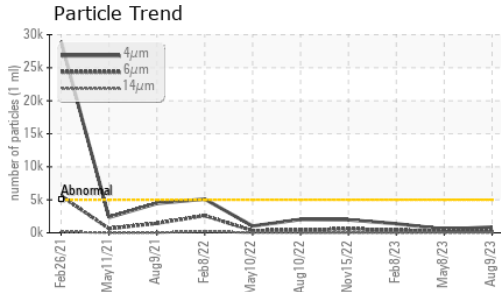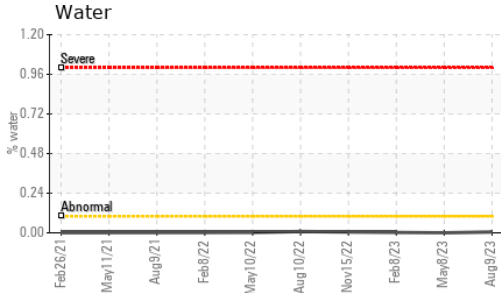






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	102	101	101

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

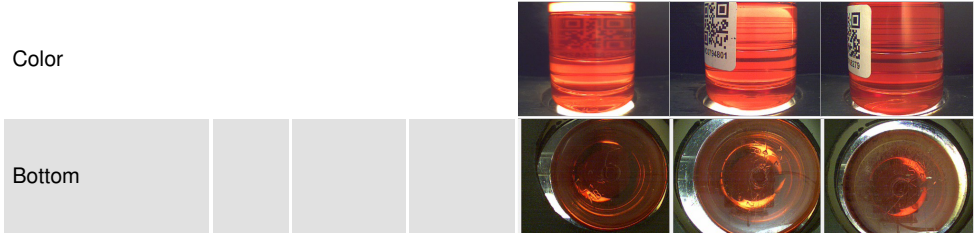

## GRAPHS

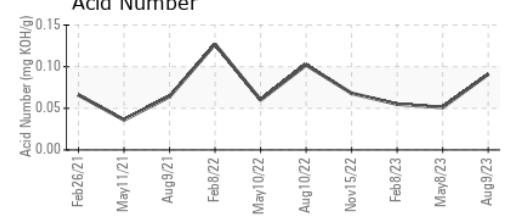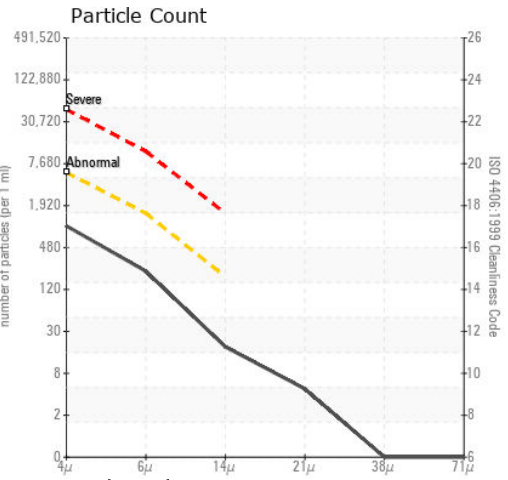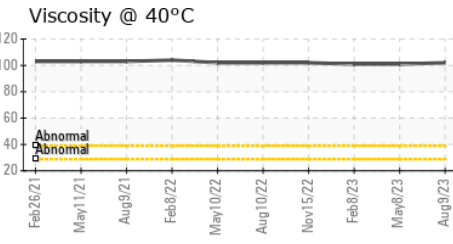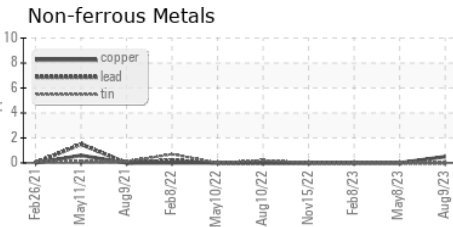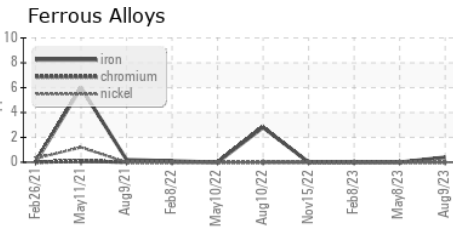

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0825629 **Received** : 11 Aug 2023  
**Lab Number** : 05922217 **Diagnosed** : 14 Aug 2023  
**Unique Number** : 10602164 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**LLOYDS BARBEQUE COMPANY - HORMEL**  
 1455 MENDOTA HEIGHTS RD  
 SAINT PAUL, MN  
 US 55120  
 Contact: PAT HUMPHREY  
 PAHumphrey@Hormel.com  
 T: (651)905-8767  
 F: (651)688-6000

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)