




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

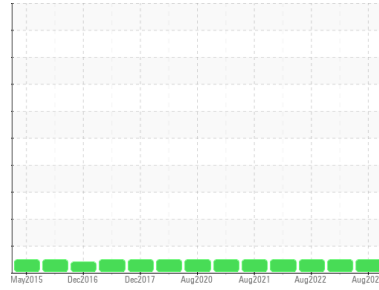

Machine Id  
**LINE 3 SIDE (S/N X55A0100042)**

Component  
**Gearbox**

Fluid  
**SHELL OMALA 320 (10 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0021310</b>	RP0021669	RP0029330
Sample Date	Client Info		<b>03 Aug 2023</b>	06 Feb 2023	15 Aug 2022
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>92</b>	74	62
Chromium	ppm	ASTM D5185m >15	<b>1</b>	<1	<1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m >5	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5.5	<b>&lt;1</b>	0	3
Barium	ppm	ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0.5	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>2</b>	<1	<1
Magnesium	ppm	ASTM D5185m 23	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m 13	<b>5</b>	5	5
Phosphorus	ppm	ASTM D5185m 450	<b>323</b>	264	273
Zinc	ppm	ASTM D5185m 9.9	<b>4</b>	7	9




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>3</b>	4	2
Sodium	ppm	ASTM D5185m	<b>1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	0
Water	%	ASTM D6304 >0.2	<b>0.003</b>	0.003	0.006
ppm Water	ppm	ASTM D6304 >2000	<b>32.7</b>	39.0	62.9

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.46</b>	0.43	0.43


# OIL ANALYSIS REPORT

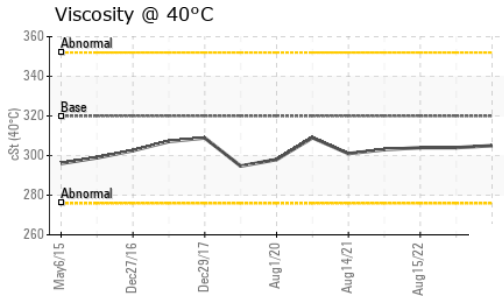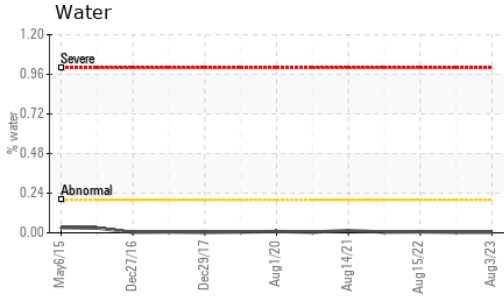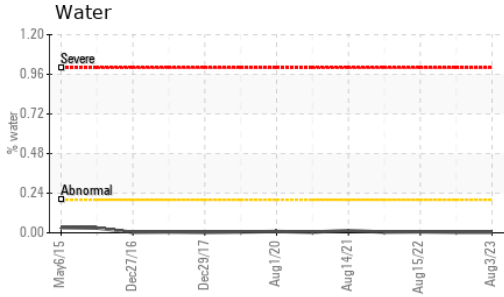





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	<b>305</b>	304

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

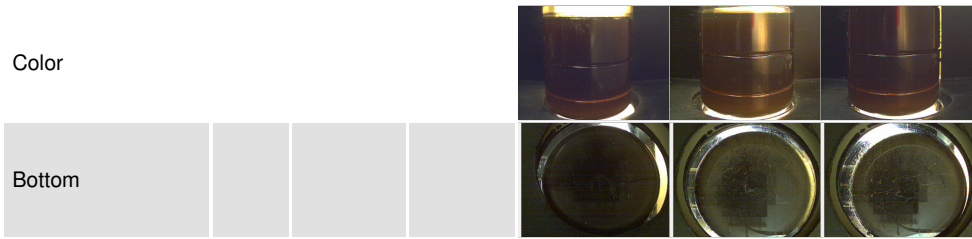

## GRAPHS

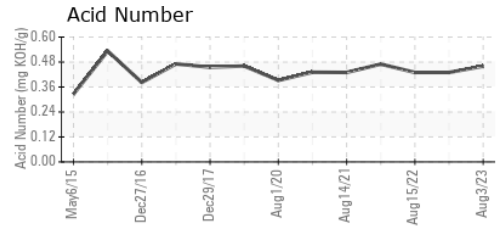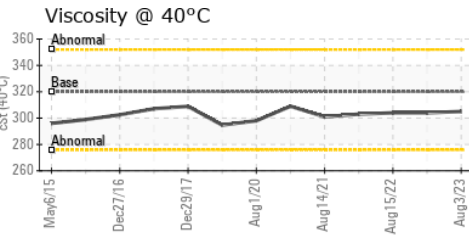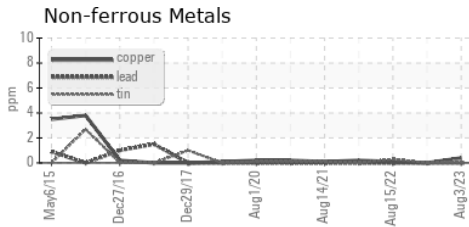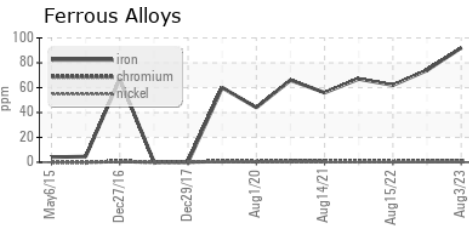

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0021310 **Received** : 11 Aug 2023  
**Lab Number** : **05922272** **Diagnosed** : 14 Aug 2023  
**Unique Number** : 10602219 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**WESTLAKE CHEMICAL - FRANKLIN**  
 200 SHOTWELL DR  
 FRANKLIN, OH  
 US 45005  
 Contact: Bill Eisaman  
 bill.eisaman@westlake.net  
 T: (419)788-9155  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)