


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



VERSETTA SIDE (S/N 2248514/2)

Component

Gearbox

SHELL OMALA 320 (3 QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Augzozo	Peozozi Augzozi	reozozz Augzozz reozozs	Augzozs	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0021301	RP0029318	RP0016178
Sample Date		Client Info		03 Aug 2023	06 Feb 2023	15 Aug 2022
Machine Age	mths	Client Info		0	0	17
Oil Age	mths	Client Info		0	0	17
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	71	60	57
Chromium	ppm	ASTM D5185m	>15	<1	<1	<1
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	0	1
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	0	0	0
Tin	ppm	ASTM D5185m	>25	<1	0	<1
Antimony	ppm	ASTM D5185m	>5			
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5.5	2	0	2
Barium	ppm	ASTM D5185m	0.4	0	0	0
Molybdenum	ppm	ASTM D5185m	0.5	0	<1	<1
Manganese	ppm	ASTM D5185m		1	<1	<1
Magnesium	ppm	ASTM D5185m	23	1	<1	<1
Calcium	ppm	ASTM D5185m	13	22	19	18
Phosphorus	ppm	ASTM D5185m	450	327	272	259
Zinc	ppm	ASTM D5185m	9.9	20	19	22
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	4	3	3
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	2	1	0
Water	%	ASTM D6304	>0.2	0.001	0.003	0.011
ppm Water	ppm	ASTM D6304	>2000	11.8	33.7	113.3
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

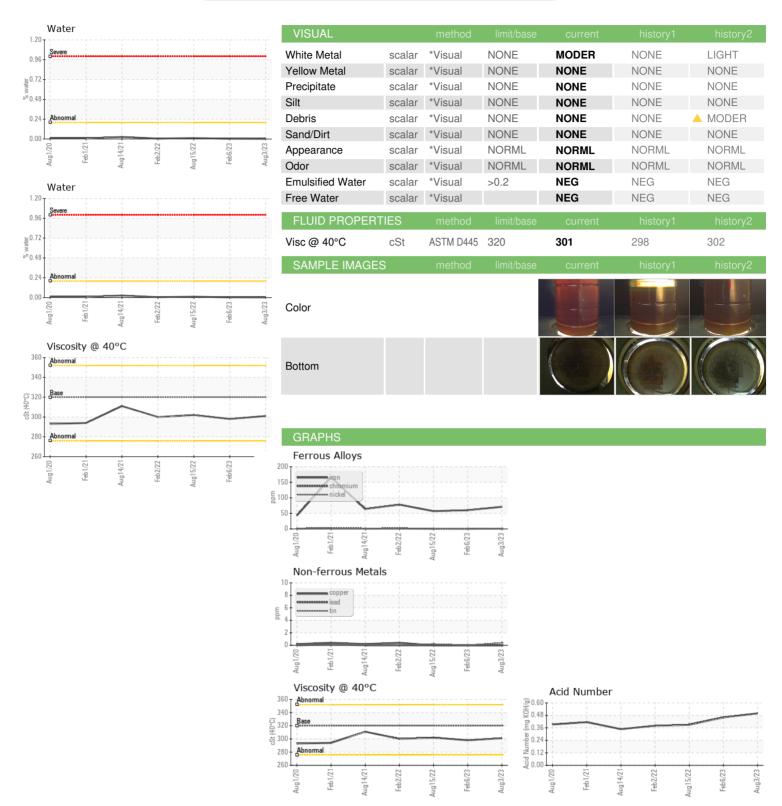





Certificate L2367

Laboratory Sample No. Lab Number Test Package : IND 2

Unique Number

: 05922279

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : RP0021301 Received : 11 Aug 2023

Diagnosed : 14 Aug 2023 : Wes Davis : 10602226 Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WESTLAKE CHEMICAL - FRANKLIN

200 SHOTWELL DR FRANKLIN, OH US 45005

Contact: Bill Eisaman bill.eisaman@westlake.net

T: (419)788-9155

F: