


Area  
**HERTZ SMART OIL**  
Machine Id  
**HERTZ VD015159 - DOBRO**  
Component  
**Compressor**  
Fluid  
**SMARTOIL 6000 (--- GAL)**

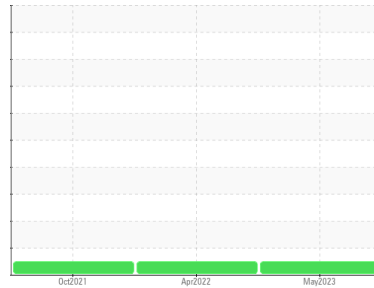

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UHK05922308</b>	UHK05554934	UCH05409349	
Sample Date	Client Info	<b>18 May 2023</b>	28 Apr 2022	18 Oct 2021	
Machine Age	hrs	Client Info	<b>3825</b>	1126	255
Oil Age	hrs	Client Info	<b>1314</b>	1126	255
Oil Changed	Client Info	<b>Not Chngd</b>	Not Chngd	Not Chngd	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	2	3
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	6	8
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	5	6
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>0</b>	<1	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	6	8
Calcium	ppm	ASTM D5185m	20	<b>0</b>	6	12
Phosphorus	ppm	ASTM D5185m		<b>406</b>	57	73
Zinc	ppm	ASTM D5185m		<b>4</b>	47	64
Sulfur	ppm	ASTM D5185m		<b>1023</b>	269	348

**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>5</b>	15	10
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1



**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.07</b>	0.10	0.115
------------------	----------	------------	--	-------------	------	-------

**VISUAL** method limit/base current history1 history2


White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT



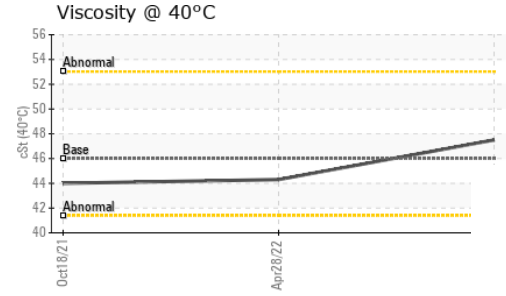
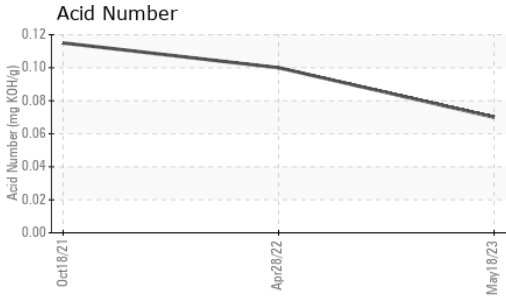


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>47.5</b>	44.3	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

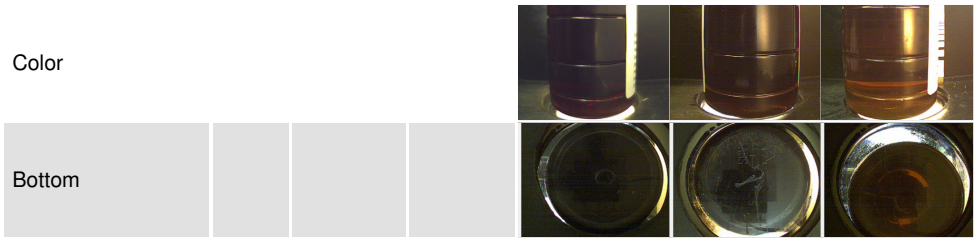

## GRAPHS

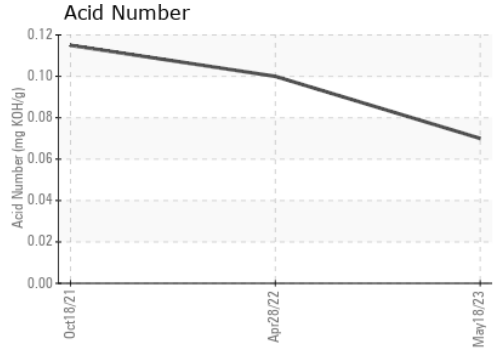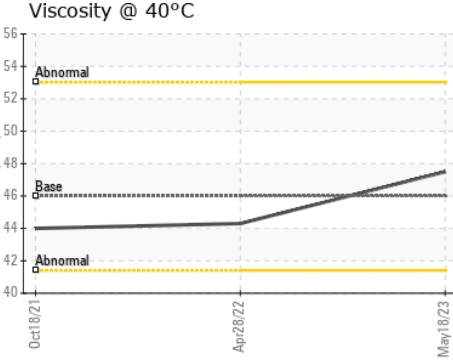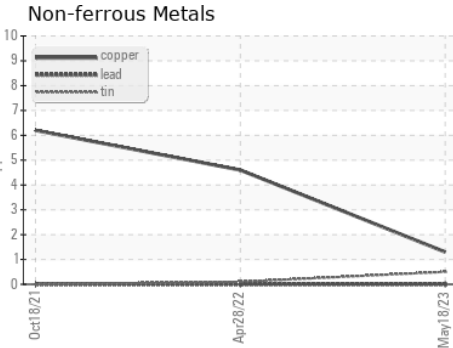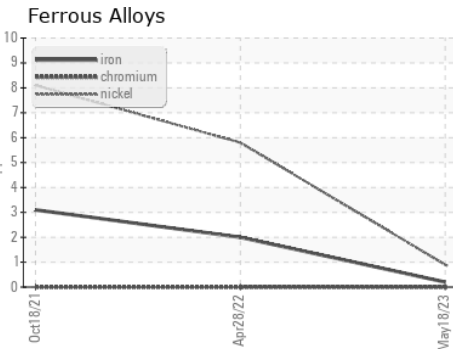

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UHK05922308  
**Lab Number** : 05922308  
**Unique Number** : 10602255  
**Test Package** : IND 2

**ATLANTA AIR COMPRESSOR - HERTZ**  
 123 MERCHANTS PARK DR  
 HOSCHTON, GA  
 US 30548  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: