


Area  
**SMART OIL**  
 Machine Id  
**HERTZ VD008793**  
 Component  
**Compressor**  
 Fluid  
**SMARTOIL 6000 (--- GAL)**

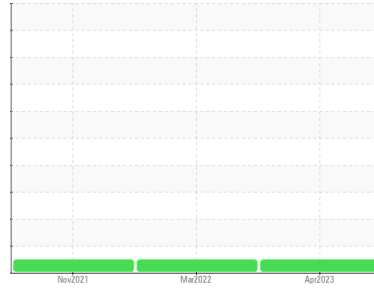

**DIAGNOSIS**

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UHK05922325</b>	UHK05625760	UCH05425896
Sample Date	Client Info			<b>06 Apr 2023</b>	23 Mar 2022	30 Nov 2021
Machine Age	hrs Client Info			<b>9329</b>	2005	766
Oil Age	hrs Client Info			<b>2300</b>	2005	766
Oil Changed	Client Info			<b>Not Changed</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	4	7
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>4</b>	4	9
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	2
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	5	8
Calcium	ppm	ASTM D5185m	20	<b>0</b>	9	11
Phosphorus	ppm	ASTM D5185m		<b>486</b>	52	72
Zinc	ppm	ASTM D5185m		<b>55</b>	38	44
Sulfur	ppm	ASTM D5185m		<b>1108</b>	174	212

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	4	4
Sodium	ppm	ASTM D5185m		<b>3</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.06</b>	0.12	0.064


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT



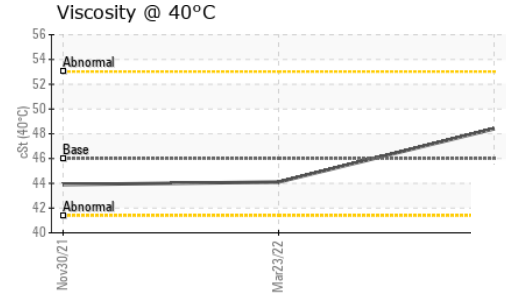
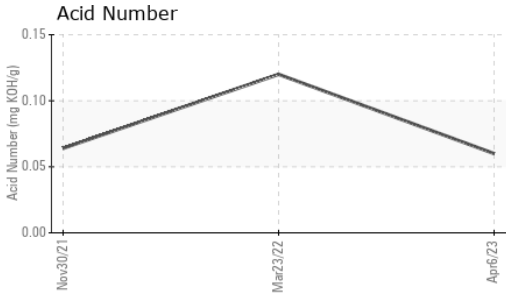


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	<b>48.4</b>	44.1	43.9

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

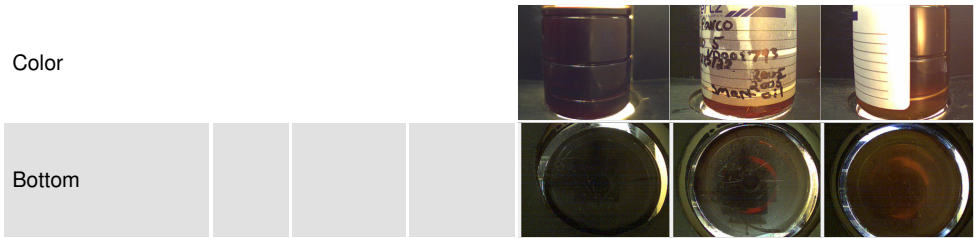

## GRAPHS

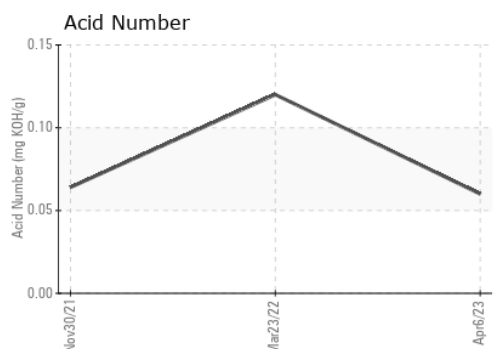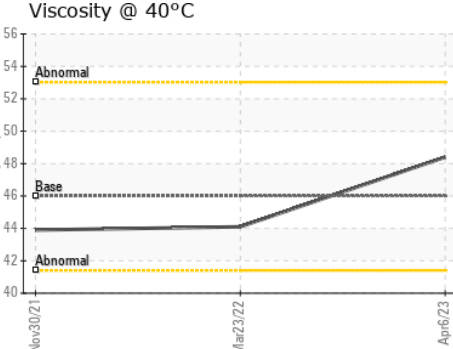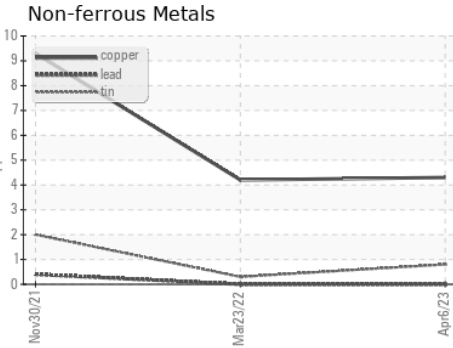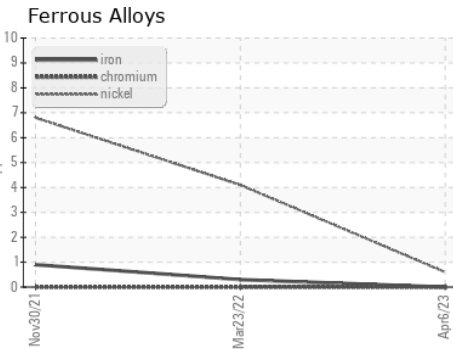

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UHK05922325 **Received** : 11 Aug 2023  
**Lab Number** : **05922325** **Diagnosed** : 14 Aug 2023  
**Unique Number** : 10602272 **Diagnostician** : Don Baldridge  
**Test Package** : IND 2

**ATLANTA AIR COMPRESSOR - HERTZ**  
 123 MERCHANTS PARK DR  
 HOSCHTON, GA  
 US 30548  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: