


OIL ANALYSIS REPORT

NOT GIVEN [PLC2147769] Machine Id KAESER 1122 - CALBIO GAS

Component

Compressor



DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Aug2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05922327		
Sample Date		Client Info		01 Aug 2023		
Machine Age	hrs	Client Info		11146		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		118		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		7667		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.098		
ppm Water	ppm	ASTM D6304	>500	980		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
A	140111	AOTH DOC :-		0.00		


Acid Number (AN)

mg KOH/g ASTM D8045

0.20



OIL ANALYSIS REPORT

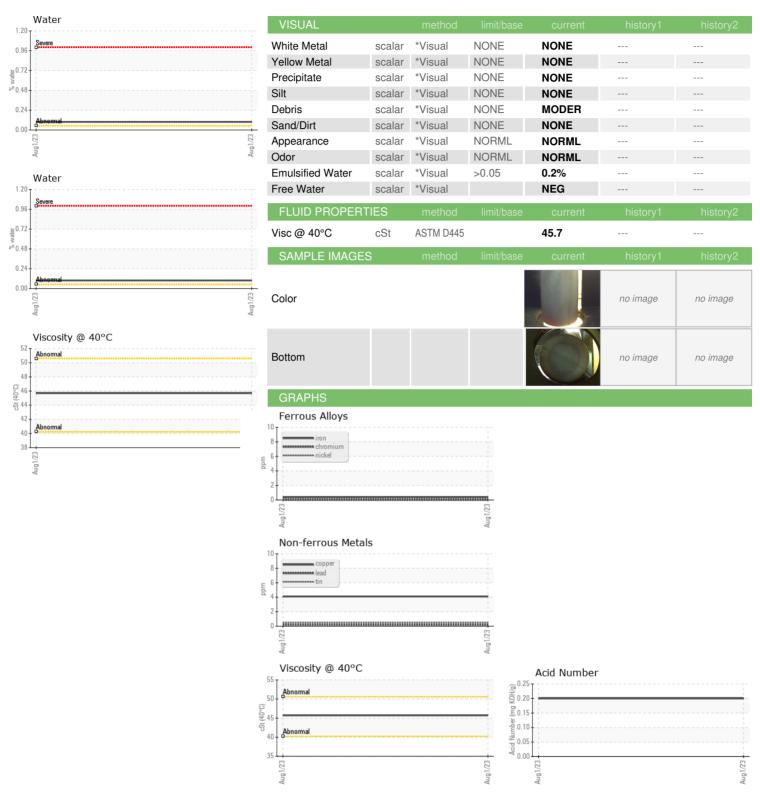





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 05922327 : 10602274

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : UCH05922327 Diagnosed

: 11 Aug 2023 : 16 Aug 2023 Diagnostician : Doug Bogart

Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CISCO AIR SYSTEMS

214 27TH ST SACRAMENTO, CA US 95816

Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com

T: (916)444-2525

F: x: