




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

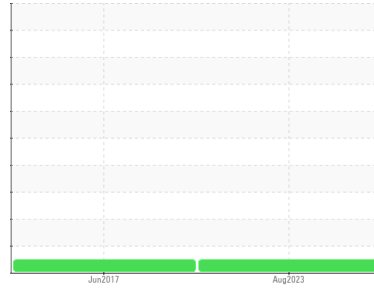

Area  
**AEON 6000 FG**  
 Machine Id  
**GARDNER DENVER S127811 - BUSH BROTHERS (S/N S12811)**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05922335</b>	UCH04254725	---
Sample Date	Client Info		<b>04 Aug 2023</b>	22 Jun 2017	---
Machine Age	hrs	Client Info	<b>77605</b>	51646	---
Oil Age	hrs	Client Info	<b>2000</b>	2050	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	<1	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	---
Antimony	ppm	ASTM D5185m	<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>395</b>	381	---
Zinc	ppm	ASTM D5185m	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>573</b>	484	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	---
Water	%	ASTM D6304 >0.1	<b>0.079</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>790</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.181</b>	0.086	---




# OIL ANALYSIS REPORT

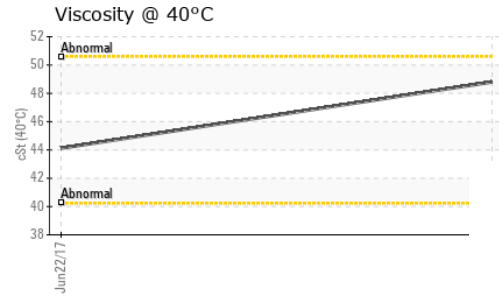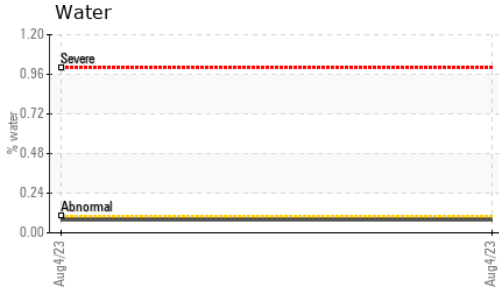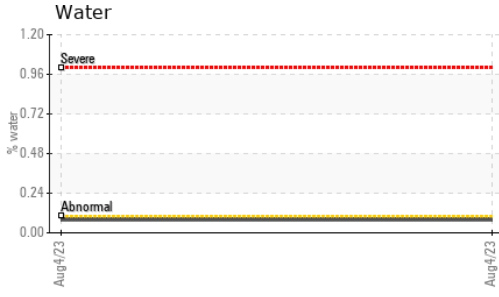





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	NEG
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.8	44.12	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

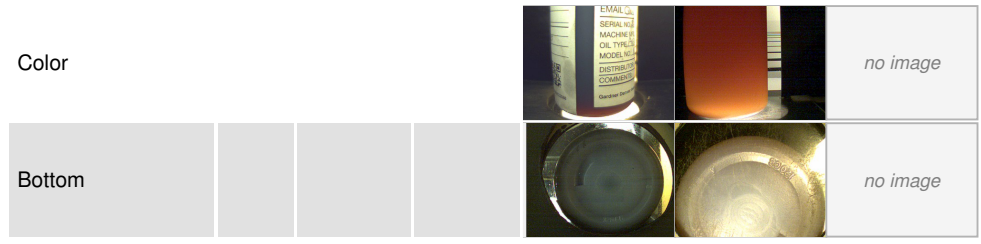

## GRAPHS

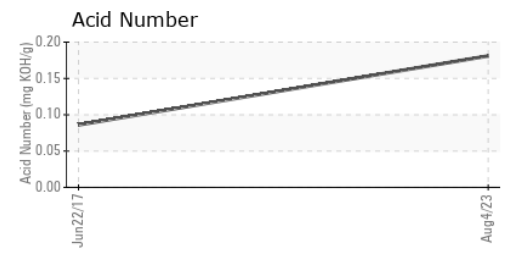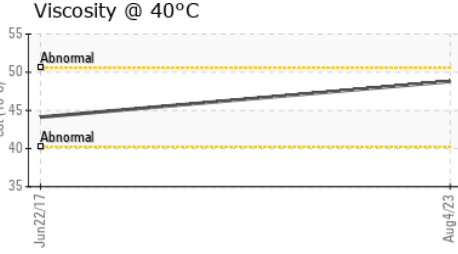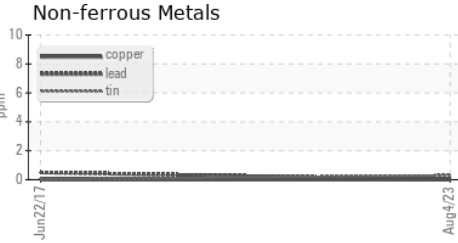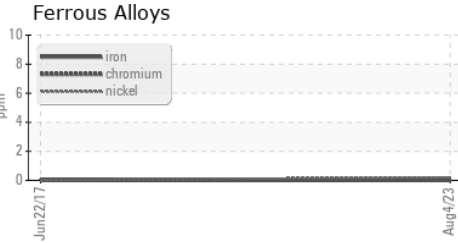

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05922335 **Received** : 11 Aug 2023  
**Lab Number** : 05922335 **Diagnosed** : 14 Aug 2023  
**Unique Number** : 10602282 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF )

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)