




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**CZ-20 [C-SP2291814]**  
 Machine Id  
**ATLAS COPCO AII704626 - MRP SAN JOAQUIN ENERGY**  
 Component  
**Compressor**

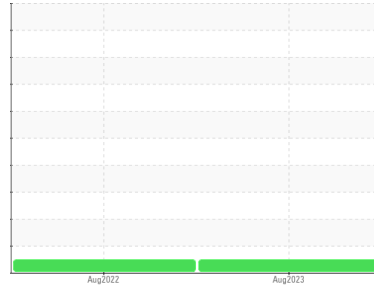

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05922338</b>	UCH05627999	---
Sample Date	Client Info		<b>10 Aug 2023</b>	10 Aug 2022	---
Machine Age	hrs	Client Info	<b>56429</b>	54441	---
Oil Age	hrs	Client Info	<b>1988</b>	0	---
Oil Changed	Client Info		<b>Not Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>1</b>	1	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >15	<b>1</b>	2	---
Lead	ppm	ASTM D5185m >65	<b>4</b>	19	---
Copper	ppm	ASTM D5185m >65	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m	<b>2</b>	5	---
Phosphorus	ppm	ASTM D5185m	<b>229</b>	414	---
Zinc	ppm	ASTM D5185m	<b>3</b>	13	---
Sulfur	ppm	ASTM D5185m	<b>850</b>	686	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	---

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.26</b>	0.22	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>MODER</b>	NONE	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>LIGHT</b>	NONE	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	NEG	---







# OIL ANALYSIS REPORT

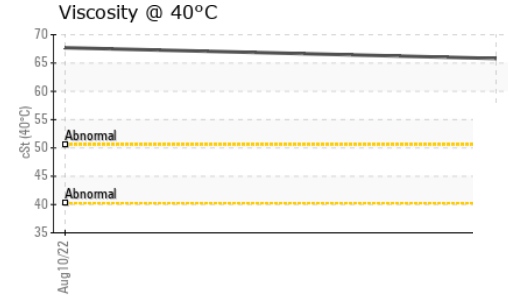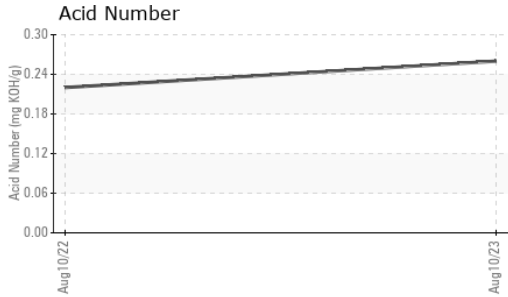

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		65.8	67.7	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

## GRAPHS

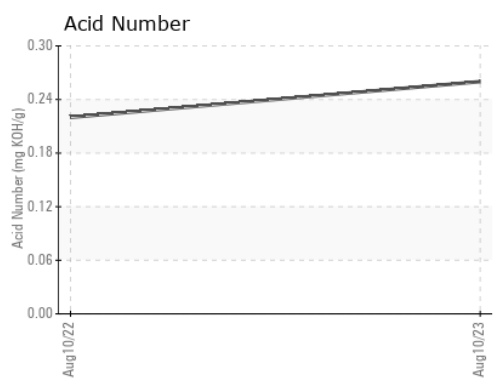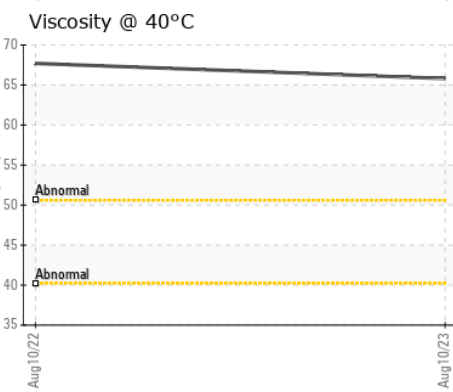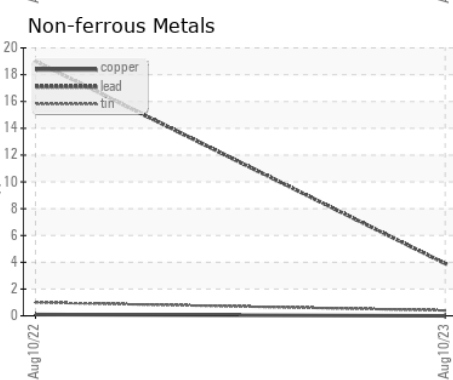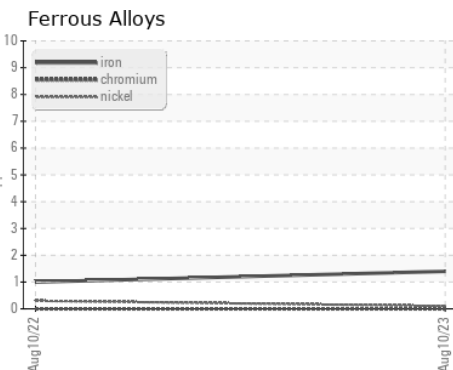

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05922338 **Received** : 11 Aug 2023  
**Lab Number** : 05922338 **Diagnosed** : 14 Aug 2023  
**Unique Number** : 10602285 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CISCO AIR SYSTEMS**  
 214 27TH ST  
 SACRAMENTO, CA  
 US 95816

Contact: BARRY FRKOVICH

barryfrkovich@ciscoair.com

T: (916)444-2525

F: x: