



PROBLEM SUMMARY

Sample Rating Trend



WEAR




Machine Id
1103AB - LINE 3

Component
Gearbox

Fluid
MOBIL MOBILGEAR 600 XP 220 (5 GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

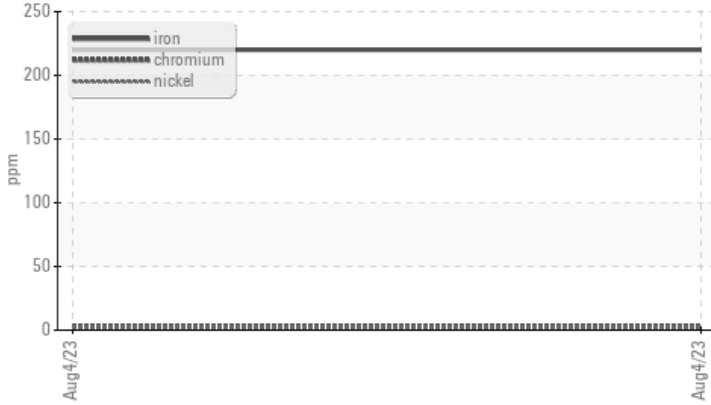

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Iron	ppm	ASTM D5185m	>200	▲ 220	---	---

Customer Id: MANMANOH
Sample No.: WC0834162
Lab Number: 05922354
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend


WEAR



Machine Id
1103AB - LINE 3

Component
Gearbox

Fluid
MOBIL MOBILGEAR 600 XP 220 (5 GAL)

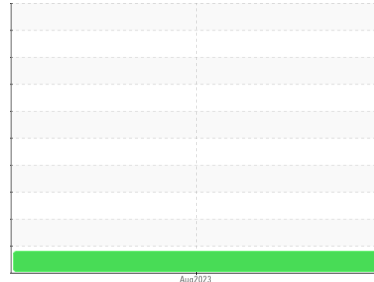

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

Gear wear is indicated.

Contamination

Insufficient sample was received to conduct all the routine laboratory tests. There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0834162	---	---
Sample Date	Client Info	04 Aug 2023	---	---
Machine Age	hrs	Client Info	0	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	Not Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >200	▲ 220	---	---
Chromium ppm	ASTM D5185m >15	3	---	---
Nickel ppm	ASTM D5185m >15	2	---	---
Titanium ppm	ASTM D5185m	0	---	---
Silver ppm	ASTM D5185m	0	---	---
Aluminum ppm	ASTM D5185m >25	2	---	---
Lead ppm	ASTM D5185m >100	<1	---	---
Copper ppm	ASTM D5185m >200	4	---	---
Tin ppm	ASTM D5185m >25	<1	---	---
Vanadium ppm	ASTM D5185m	0	---	---
Cadmium ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	5	---	---
Barium ppm	ASTM D5185m	0	---	---
Molybdenum ppm	ASTM D5185m	0	---	---
Manganese ppm	ASTM D5185m	2	---	---
Magnesium ppm	ASTM D5185m	<1	---	---
Calcium ppm	ASTM D5185m	10	---	---
Phosphorus ppm	ASTM D5185m	284	---	---
Zinc ppm	ASTM D5185m	27	---	---
Sulfur ppm	ASTM D5185m	11875	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >50	8	---	---
Sodium ppm	ASTM D5185m	3	---	---
Potassium ppm	ASTM D5185m >20	3	---	---

VISUAL


method	limit/base	current	history1	history2
White Metal scalar	*Visual NONE	NONE	---	---
Yellow Metal scalar	*Visual NONE	NONE	---	---
Precipitate scalar	*Visual NONE	NONE	---	---
Silt scalar	*Visual NONE	NONE	---	---
Debris scalar	*Visual NONE	NONE	---	---
Sand/Dirt scalar	*Visual NONE	NONE	---	---
Appearance scalar	*Visual NORML	NORML	---	---
Odor scalar	*Visual NORML	NORML	---	---
Emulsified Water scalar	*Visual >0.2	NEG	---	---
Free Water scalar	*Visual	NEG	---	---

FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D445 220	219	---	---









OIL ANALYSIS REPORT

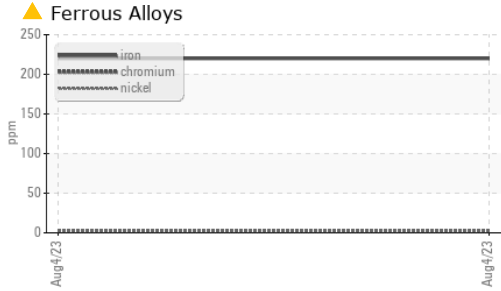

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

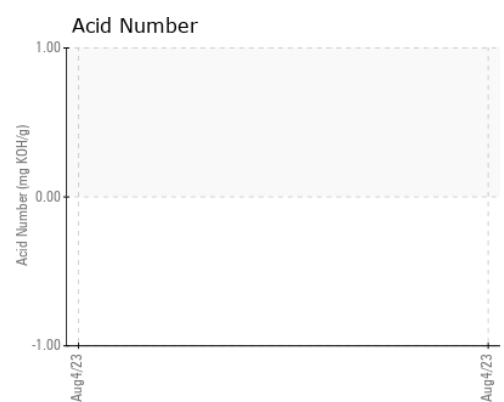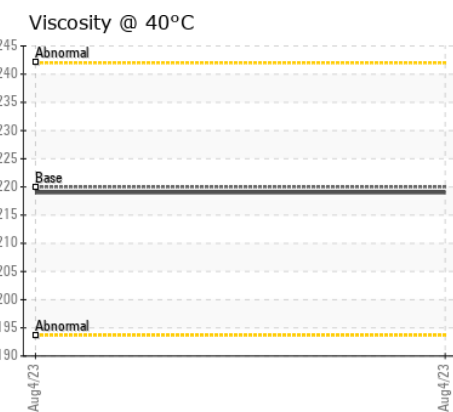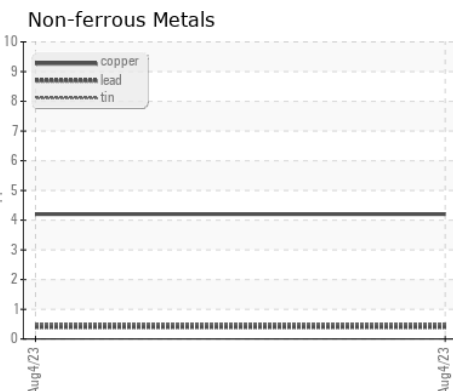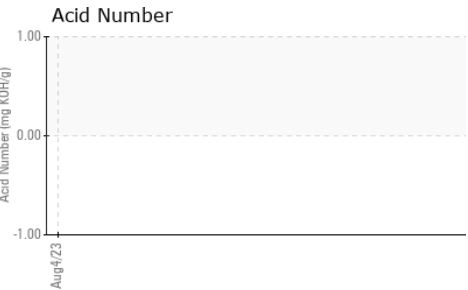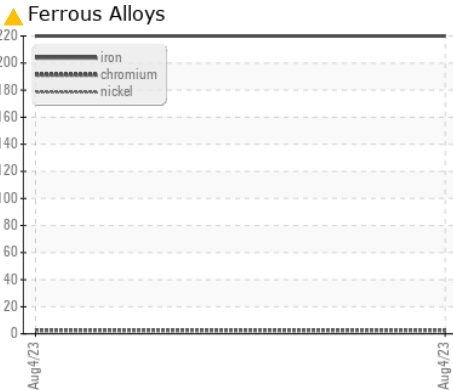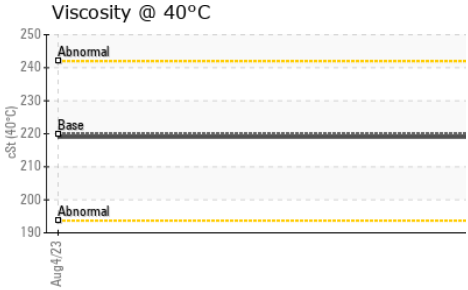

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0834162 **Received** : 11 Aug 2023
Lab Number : 05922354 **Diagnosed** : 14 Aug 2023
Unique Number : 10602301 **Diagnostician** : Doug Bogart
Test Package : IND 2

MANTALINE CORP-MANTUA
 4754 EAST HIGH STREET
 MANTUA, OH
 US 44255
 Contact: BILL STEWART
 bstewart@mantine.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
F: x: