

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER BSD 60 6445920 (S/N 1451)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

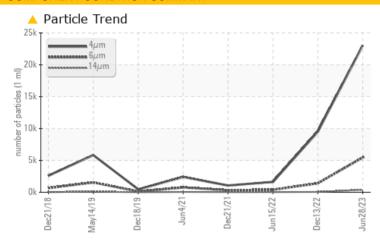

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	NORMAL				
Particles >6µm	ASTM D7647	>1300	△ 5465	<u>1408</u>	385				
Particles >14μm	ASTM D7647	>80	▲ 382	57	37				
Particles >21µm	ASTM D7647	>20	<u> </u>	15	13				
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/20/16	20/18/13	18/16/12				

Customer Id: ALKFRE Sample No.: KC05922840 Lab Number: 05922840 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

13 Dec 2022 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



15 Jun 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



21 Dec 2021 Diag: Don Baldridge

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

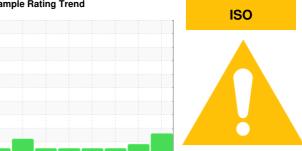

KAESER BSD 60 6445920 (S/N 1451)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Dec2018 May2019 Dec2019 Jun2021 Dec2021 Jun2022 Dec2022 Jun2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KC05922840	KCP52663	KCP41356		
Sample Date		Client Info		28 Jun 2023	13 Dec 2022	15 Jun 2022		
Machine Age	hrs	Client Info		30148	29786	25619		
Oil Age	hrs	Client Info		0	8165	4000		
Oil Changed		Client Info		N/A	Changed	Not Changd		
Sample Status				ABNORMAL	ATTENTION	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	4	3	0		
Chromium	ppm	ASTM D5185m	>10	0	0	0		
Nickel	ppm	ASTM D5185m	>3	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	<1		
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1		
Lead	ppm	ASTM D5185m	>10	0	0	0		
Copper	ppm	ASTM D5185m	>50	2	10	3		
Tin	ppm	ASTM D5185m	>10	0	<1	<1		
Antimony	ppm	ASTM D5185m						
Vanadium	ppm	ASTM D5185m		<1	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	2		
Barium	ppm	ASTM D5185m	90	59	0	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		<1	0	0		
Magnesium	ppm	ASTM D5185m	90	73	18	47		
Calcium	ppm	ASTM D5185m	2	<1	0	0		
Phosphorus	ppm	ASTM D5185m		2	<1	30		
Zinc	ppm	ASTM D5185m		0	17	10		
CONTAMINANTS	,	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	<1	2	2		
Sodium	ppm	ASTM D5185m		10	13	18		
Potassium	ppm	ASTM D5185m		3	8	9		
Water	%	ASTM D6304	>0.05	0.030	0.011	0.032		
ppm Water	ppm	ASTM D6304	>500	303.1	118.0	327.2		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		23036	9505	1624		
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>1408</u>	385		
Particles >14μm		ASTM D7647	>80	△ 382	57	37		
Particles >21µm		ASTM D7647	>20	<u> 100</u>	15	13		
Particles >38μm		ASTM D7647	>4	2	1	1		
Particles >71µm		ASTM D7647	>3	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/16</u>	2 0/18/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.33	0.36		



OIL ANALYSIS REPORT

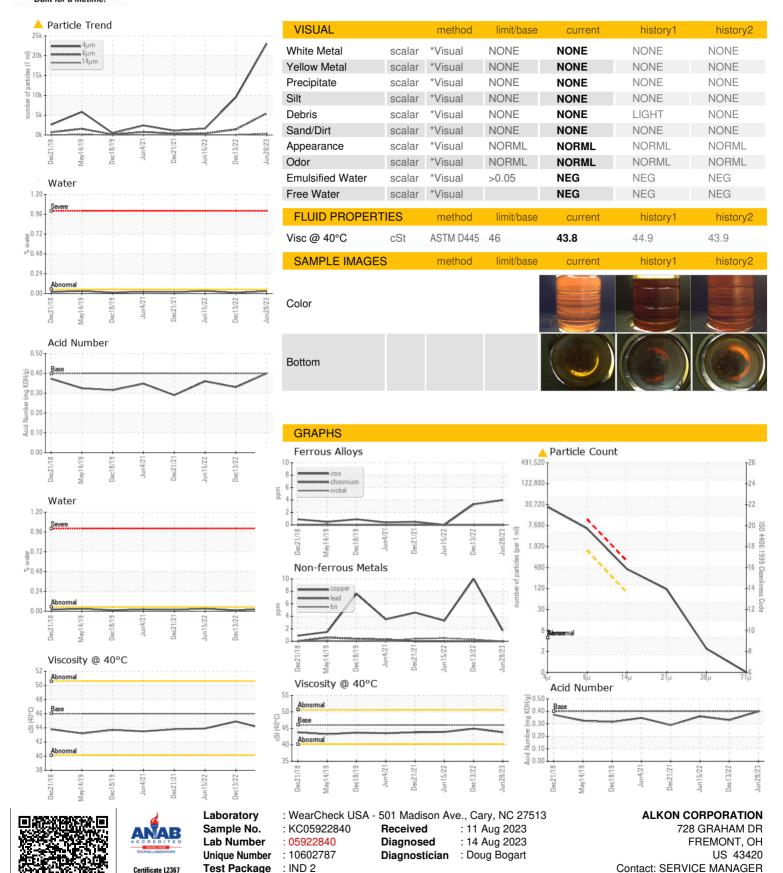

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: