




PROBLEM SUMMARY

Sample Rating Trend



WEAR



Machine Id
NOT GIVEN WC0806774 (S/N NO INFO ON SIF/BOTTLE)
Component
Gearbox
Fluid
NOT GIVEN (--- GAL)

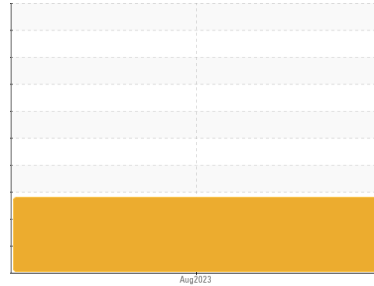

COMPONENT CONDITION SUMMARY

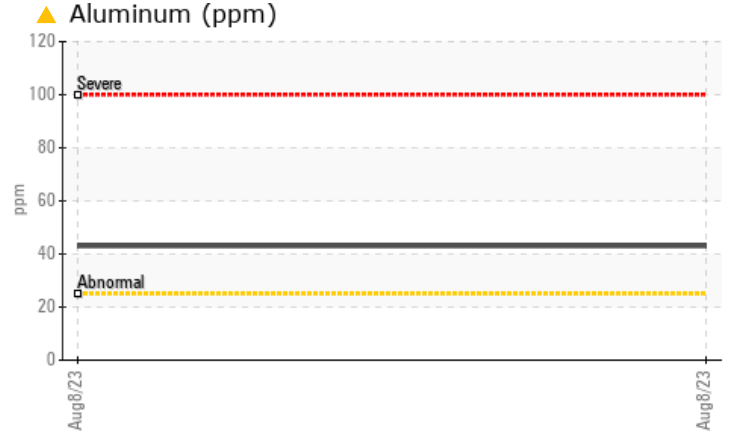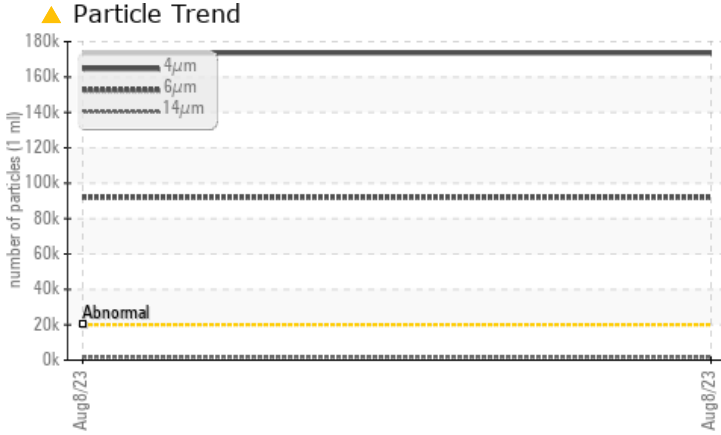

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D5185m	>25	ABNORMAL	---	---
Aluminum	ppm	>25	▲ 43	---	---
Particles >4µm	ASTM D7647	>20000	▲ 173551	---	---
Particles >6µm	ASTM D7647	>5000	▲ 91973	---	---
Particles >14µm	ASTM D7647	>640	▲ 1661	---	---
Particles >21µm	ASTM D7647	>160	▲ 221	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 25/24/18	---	---

Customer Id: TALCLA
Sample No.: WC0806774
Lab Number: 05922842
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.


HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

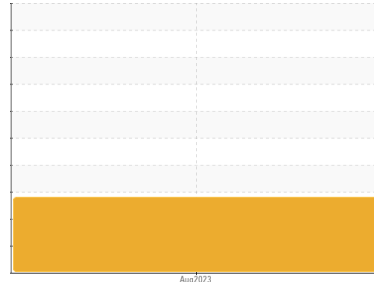

Machine Id
NOT GIVEN WC0806774 (S/N NO INFO ON SIF/BOTTLE)

Component
Gearbox
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0806774	---	---
Sample Date	Client Info		08 Aug 2023	---	---
Machine Age	days	Client Info	540	---	---
Oil Age	days	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	66	---	---
Chromium	ppm	ASTM D5185m >15	<1	---	---
Nickel	ppm	ASTM D5185m >15	0	---	---
Titanium	ppm	ASTM D5185m	16	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >25	▲ 43	---	---
Lead	ppm	ASTM D5185m >100	0	---	---
Copper	ppm	ASTM D5185m >200	<1	---	---
Tin	ppm	ASTM D5185m >25	0	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	2	---	---
Calcium	ppm	ASTM D5185m	205	---	---
Phosphorus	ppm	ASTM D5185m	549	---	---
Zinc	ppm	ASTM D5185m	0	---	---
Sulfur	ppm	ASTM D5185m	736	---	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	17	---	---
Sodium	ppm	ASTM D5185m	22	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304 >0.2	0.011	---	---
ppm Water	ppm	ASTM D6304 >2000	110.5	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 173551	---	---
Particles >6µm	ASTM D7647	>5000	▲ 91973	---	---
Particles >14µm	ASTM D7647	>640	▲ 1661	---	---
Particles >21µm	ASTM D7647	>160	▲ 221	---	---
Particles >38µm	ASTM D7647	>40	3	---	---
Particles >71µm	ASTM D7647	>10	1	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 25/24/18	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.34	---	---



OIL ANALYSIS REPORT

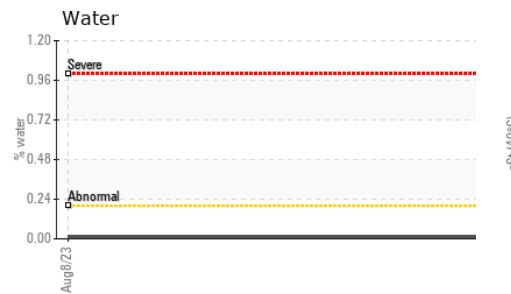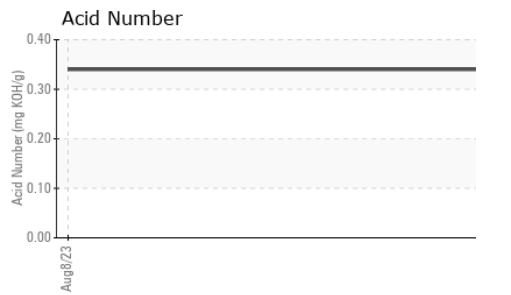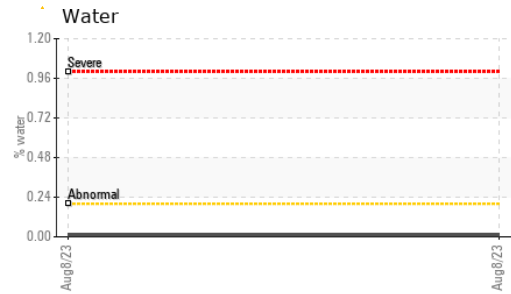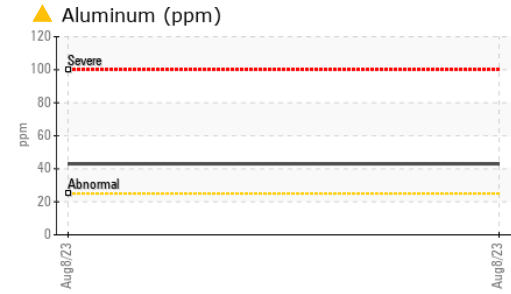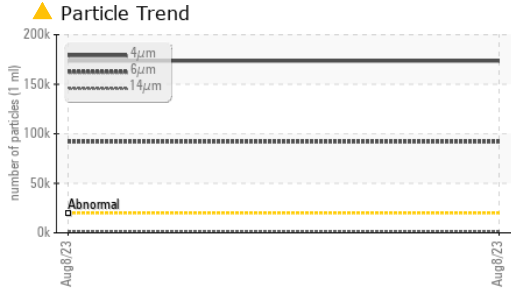





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	230	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

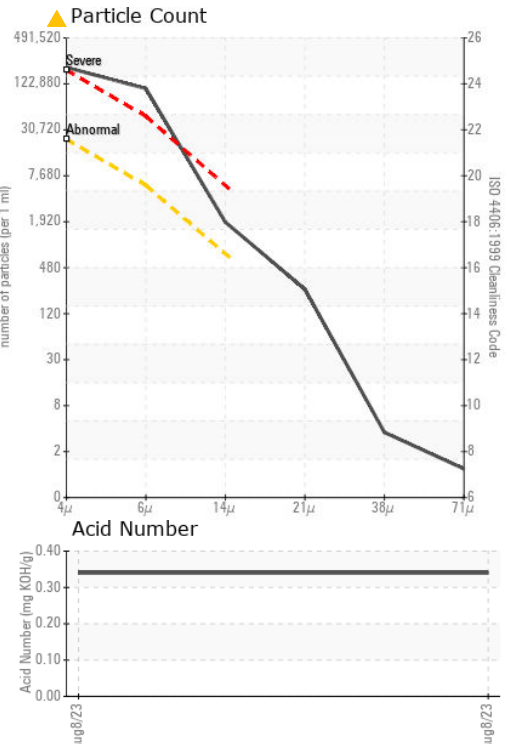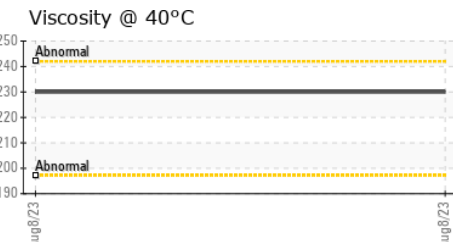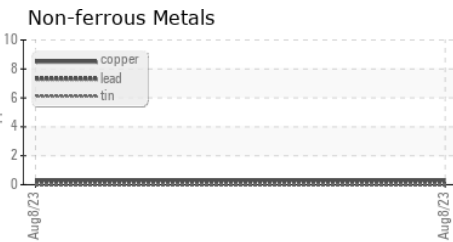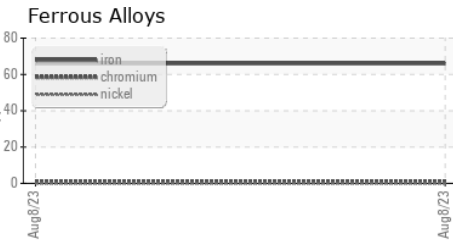

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0806774 **Received** : 11 Aug 2023
Lab Number : 05922842 **Diagnosed** : 14 Aug 2023
Unique Number : 10602789 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GRIFOLS TALECRIS PHARMACEUTICAL
 8368 US 70 WEST
 CLAYTON, NC
 US 27520
 Contact: KEN TERRY
 kenneth.terry@grifols.com
 T: (919)359-4362
 F: (919)359-4767

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)