



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
[20567321]

Machine Id
ROYAL PURPLE SYNFLIM GT 22

Component
New (Unused) Oil
Fluid
{not provided} (--- GAL)



DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0842631	---	---
Sample Date	Client Info		09 Aug 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >5	<1	---	---
Chromium	ppm	ASTM D5185m >5	0	---	---
Nickel	ppm	ASTM D5185m >5	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >5	<1	---	---
Lead	ppm	ASTM D5185m >5	0	---	---
Copper	ppm	ASTM D5185m >5	0	---	---
Tin	ppm	ASTM D5185m >5	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	2	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	85	---	---
Calcium	ppm	ASTM D5185m	3	---	---
Phosphorus	ppm	ASTM D5185m	<1	---	---
Zinc	ppm	ASTM D5185m	0	---	---
Sulfur	ppm	ASTM D5185m	19415	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	4	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	670	---	---
Particles >6µm	ASTM D7647	>1300	174	---	---
Particles >14µm	ASTM D7647	>160	18	---	---
Particles >21µm	ASTM D7647	>40	5	---	---
Particles >38µm	ASTM D7647	>10	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/15/11	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.40	---	---



OIL ANALYSIS REPORT

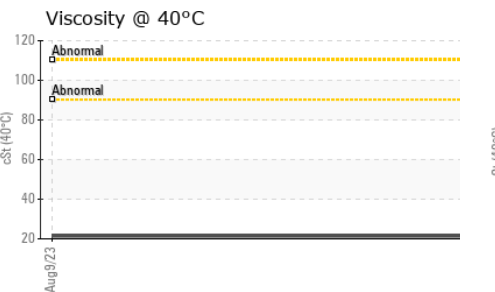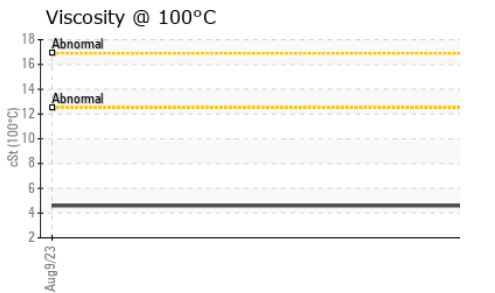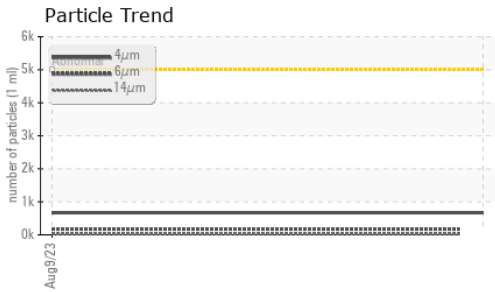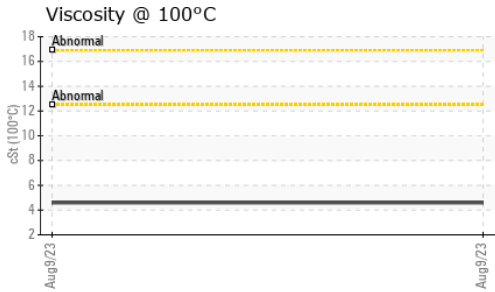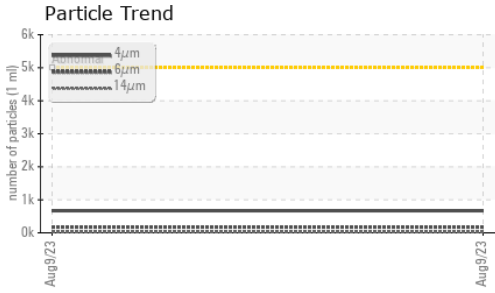





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	21.42	---	---
Visc @ 100°C	cSt	ASTM D445	4.59	---	---
Viscosity Index (VI)	Scale	ASTM D2270	132	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

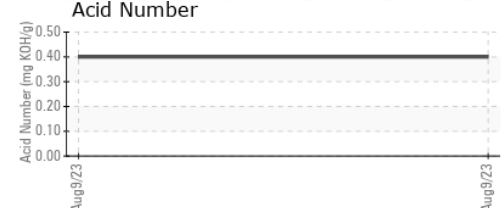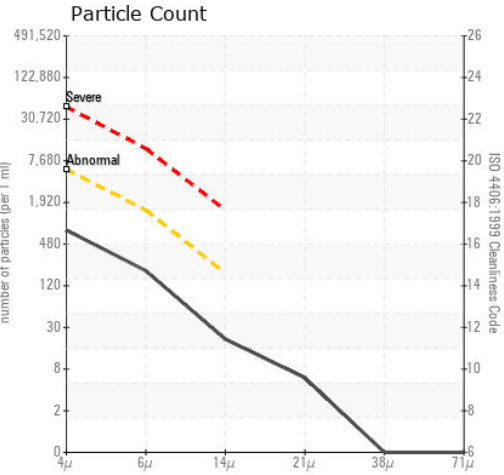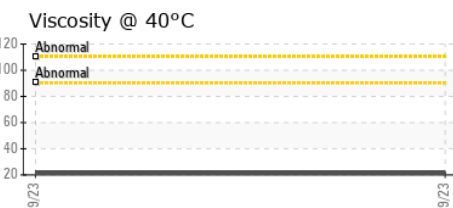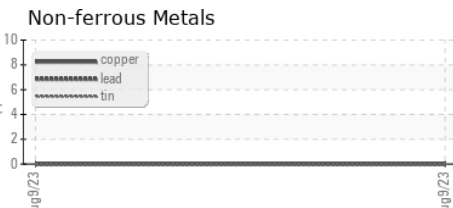

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0842631 **Received** : 11 Aug 2023
Lab Number : 05922960 **Diagnosed** : 15 Aug 2023
Unique Number : 10602907 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: FT-IR, KV100, PrtCount, VI)

PATHEON API
 6173 East Old Marion Highway, Bldg. 806
 Florence, SC
 US 29506
 Contact: SAM MCDOWELL
 sam.mcdowell@patheon.com
 T: (843)629-4042
 F: (843)629-4553

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)