




PROBLEM SUMMARY

Area
412
 Machine Id
74 BANBURY MOTOR
 Component
Inboard Journal Bearing
 Fluid
ESSO NUTO H ISO 68 (1 QTS)

Sample Rating Trend

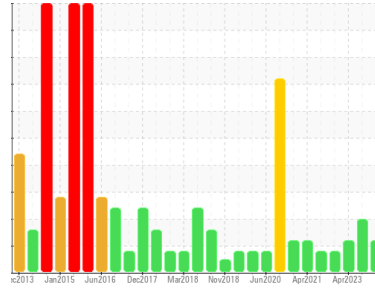

VISUAL METAL



COMPONENT CONDITION SUMMARY

No relevant graphs to display


RECOMMENDATION

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
White Metal	scalar	*Visual	NONE	▲ MODER	▲ MODER	NONE

Customer Id: BRIDES
Sample No.: WC0397551
Lab Number: 05923338
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to metal particles present in this sample.

HISTORICAL DIAGNOSIS

05 Jul 2023 Diag: Angela Borella

VISUAL METAL



The oil change at the time of sampling has been noted. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. We were unable to perform a particle count due to metal particles present in this sample. The tin level is abnormal. Moderate concentration of visible metal present. Bearing wear is indicated. All other component wear rates are normal. No other contaminants were detected in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

[view report](#)



09 Apr 2023 Diag: Angela Borella

ISO



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



25 Nov 2021 Diag: Don Baldrige

ISO



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

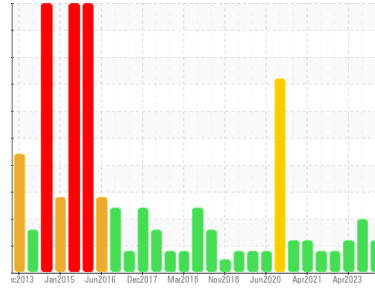

VISUAL METAL



Area
412
Machine Id
74 BANBURY MOTOR
Component
Inboard Journal Bearing
Fluid
ESSO NUTO H ISO 68 (1 QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

Wear

Moderate concentration of visible metal present. All component wear rates are normal.

Contamination

No other contaminants were detected in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0397551	WC0569522	WC0569581
Sample Date	Client Info		07 Aug 2023	05 Jul 2023	09 Apr 2023
Machine Age	mths	Client Info	1	6	0
Oil Age	mths	Client Info	0	0	4
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		9	12	9
Iron	ppm	ASTM D5185m >60	0	3	0
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >4	<1	<1	0
Lead	ppm	ASTM D5185m >250	11	37	8
Copper	ppm	ASTM D5185m >125	12	26	50
Tin	ppm	ASTM D5185m >80	44	▲ 146	45
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	<1	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	<1	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 5	6	0	4
Calcium	ppm	ASTM D5185m 50	41	38	48
Phosphorus	ppm	ASTM D5185m 330	332	332	337
Zinc	ppm	ASTM D5185m 420	400	408	406
Sulfur	ppm	ASTM D5185m 3100	3093	2999	2826

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	3	3	2
Sodium	ppm	ASTM D5185m	2	0	0
Potassium	ppm	ASTM D5185m >20	<1	1	0

FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	---	---	▲ 108998
Particles >6µm	ASTM D7647	>2500	---	---	▲ 5639
Particles >14µm	ASTM D7647	>160	---	---	31
Particles >21µm	ASTM D7647	>40	---	---	5
Particles >38µm	ASTM D7647	>10	---	---	0
Particles >71µm	ASTM D7647	>3	---	---	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	---	---	▲ 24/20/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 .40	0.43	0.45	0.39




OIL ANALYSIS REPORT

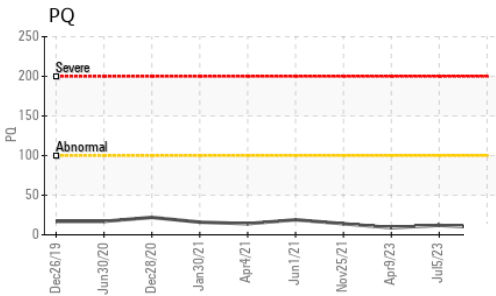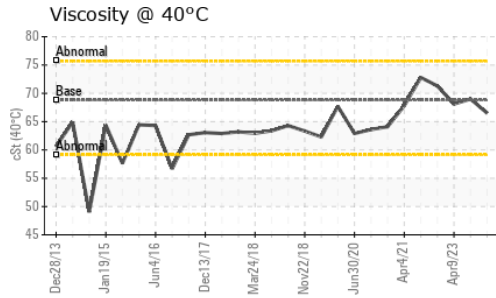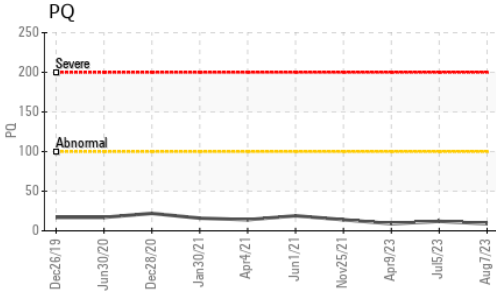





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	▲ MODER	▲ MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.8	66.5	69.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

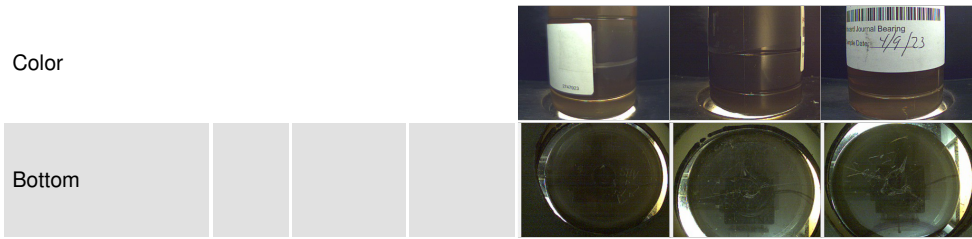

GRAPHS

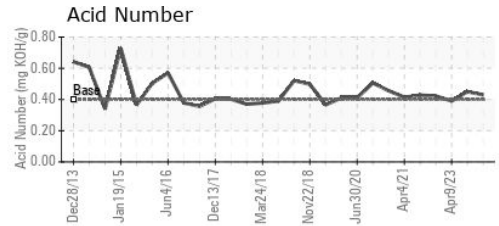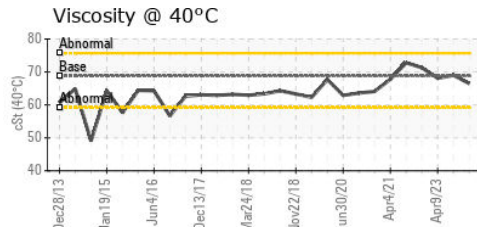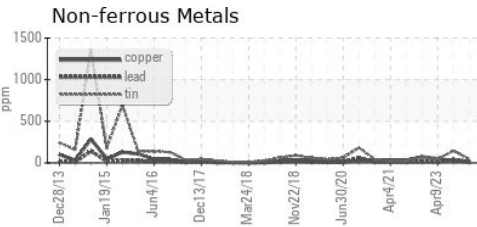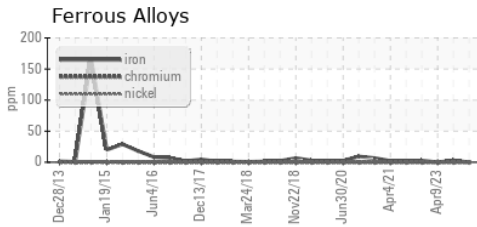

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0397551 **Received** : 14 Aug 2023
Lab Number : 05923338 **Diagnosed** : 18 Aug 2023
Unique Number : 10603285 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PQ, PrtCount)

BRIDGESTONE FIRESTONE - DES MOINES
 4600 NW 2ND AVE
 DES MOINES, IA
 US 50313
 Contact: SCOTT CARTER
 CarterScottA@FirestoneAg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:
F: x: