

PROBLEM SUMMARY


Sample Rating Trend


WEAR

Machine Id **42** Component **Turbine**

R&O OIL ISO 68 (--- QTS)

COMPONENT CONDITION SUMMARY

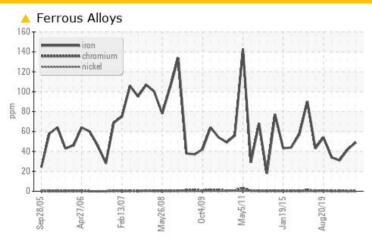

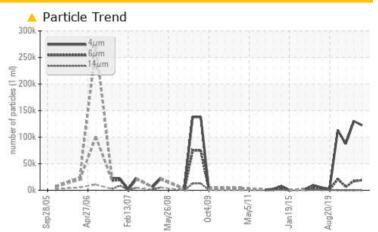

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL			
Iron	ppm	ASTM D5185m	>15	49	<u>42</u>	31			
Particles >6µm		ASTM D7647	>1300	19038	▲ 17024	△ 6485			
Oil Cleanliness		ISO 4406 (c)	>/17/14	24/21/13	<u>4</u> 24/21/14	4 24/20/13			

Customer Id: COLALB Sample No.: WC0813264 Lab Number: 05923379 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Sep 2022 Diag: Jonathan Hester

WEAR



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. The iron level is abnormal. All other component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Nov 2021 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



08 Sep 2020 Diag: Don Baldridge

WEAR




No corrective action is recommended at this time. We recommend an early resample to monitor this condition. The iron level is abnormal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



WEAR



Machine Id **42**Component

Turbine

R&O OIL ISO 68 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

A Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		2005 Apr20	06 Feb2007 May2008	Oct2009 May2011 Jan2015 /	aug2019	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0813264	WC0700754	WC0577574
Sample Date		Client Info		13 Aug 2023	14 Sep 2022	16 Nov 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	49	▲ 42	31
Chromium	ppm	ASTM D5185m	>4	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	3	0
Lead	ppm	ASTM D5185m		0	<1	0
Copper	ppm	ASTM D5185m	>5	3	3	5
Tin	ppm	ASTM D5185m	>5	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	<1	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		1	<1	<1
Magnesium	ppm	ASTM D5185m	5	6	<1	0
Calcium	ppm	ASTM D5185m	5	3	3	12
Phosphorus	ppm	ASTM D5185m	100	7	3	7
Zinc	ppm	ASTM D5185m	25	27	8	<1
Sulfur	ppm	ASTM D5185m	1500	7	30	126
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Sodium	ppm	ASTM D5185m		1	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		122351	130132	87439
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 17024	<u>▲</u> 6485
Particles >14μm		ASTM D7647	>160	66	104	59
Particles >21µm		ASTM D7647	>40	9	10	10
Particles >38µm		ASTM D7647	>10	0	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/14	<u>4</u> 24/21/13	<u>4</u> 24/21/14	<u>4</u> 24/20/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.08

0.07

0.09

0.044



OIL ANALYSIS REPORT





Sample No. Lab Number **Unique Number**

: 05923379 : 10603326 Test Package

: WC0813264 Received : 15 Aug 2023 Diagnosed : Don Baldridge Diagnostician

: IND 2

Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

P.O. Box 580 Albemarle, NC US 28001

Contact: STEPHEN MOSS

Contact/Location: STEPHEN MOSS - COLALB

smoss@iacna.com T: (704)983-8334

F: (704)983-8372