




PROBLEM SUMMARY

Sample Rating Trend

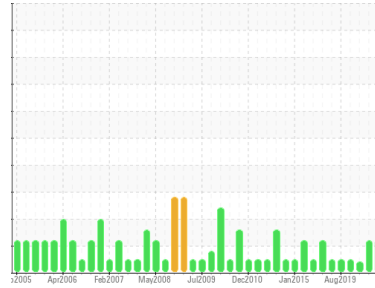

VISUAL METAL



Machine Id
40
 Component
Turbine
 Fluid
R&O OIL ISO 68 (--- QTS)

COMPONENT CONDITION SUMMARY

No relevant graphs to display


RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ATTENTION
White Metal	scalar	*Visual	NONE	▲ MODER	LIGHT	NONE

Customer Id: COLALB
Sample No.: WC0813260
Lab Number: 05923383
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Alert	---	---	?	We were unable to perform a particle count due to metal particles present in this sample.

HISTORICAL DIAGNOSIS

14 Sep 2022 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



16 Nov 2021 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



08 Sep 2020 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

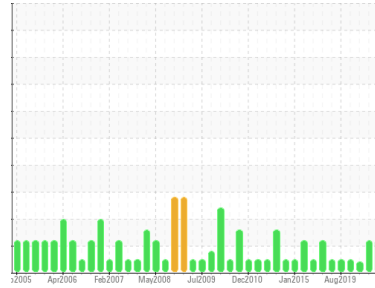

VISUAL METAL



Machine Id
40
 Component
Turbine
 Fluid
R&O OIL ISO 68 (--- QTS)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

▲ Wear

Moderate concentration of visible metal present. All component wear rates are normal.

Contamination

No other contaminants were detected in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0813260	WC0700752	WC0577572
Sample Date	Client Info		13 Aug 2023	14 Sep 2022	16 Nov 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	4	5	10
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	1	0
Lead	ppm	ASTM D5185m	0	0	0
Copper	ppm	ASTM D5185m >5	3	3	1
Tin	ppm	ASTM D5185m >5	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	0	<1
Barium	ppm	ASTM D5185m 5	<1	0	0
Molybdenum	ppm	ASTM D5185m 5	0	0	<1
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 5	6	<1	<1
Calcium	ppm	ASTM D5185m 5	0	0	17
Phosphorus	ppm	ASTM D5185m 100	3	0	10
Zinc	ppm	ASTM D5185m 25	28	10	11
Sulfur	ppm	ASTM D5185m 1500	17	36	141

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	1	<1	2
Sodium	ppm	ASTM D5185m	1	0	0
Potassium	ppm	ASTM D5185m >20	<1	1	0


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		---	23224	33931
Particles >6µm	ASTM D7647	>1300	---	▲ 4011	▲ 1841
Particles >14µm	ASTM D7647	>160	---	▲ 185	19
Particles >21µm	ASTM D7647	>40	---	33	4
Particles >38µm	ASTM D7647	>10	---	3	0
Particles >71µm	ASTM D7647	>3	---	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	---	▲ 22/19/15	▲ 22/18/11

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.08	0.092	0.07	0.066


OIL ANALYSIS REPORT

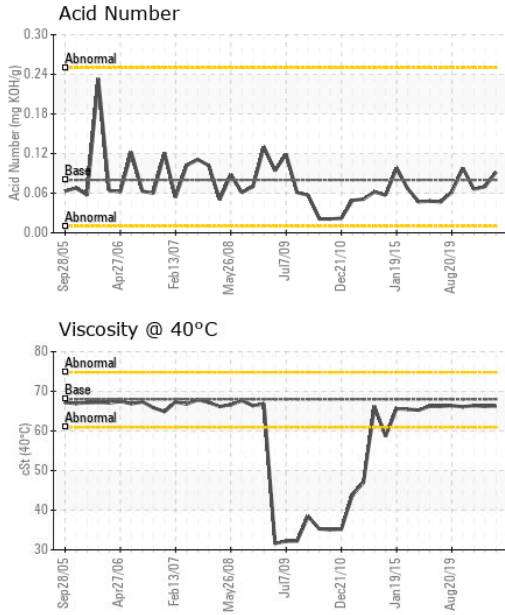



VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	▲ MODER	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	68	66.3	66.2	66.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

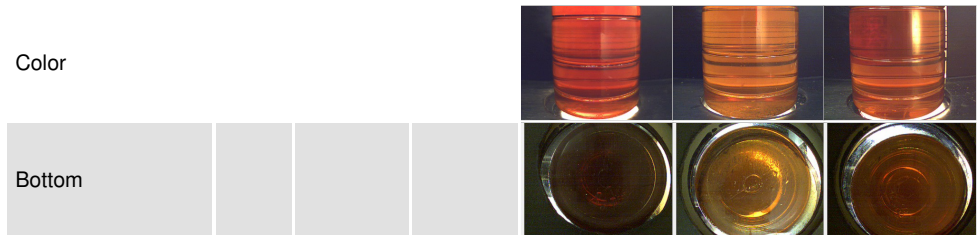

GRAPHS

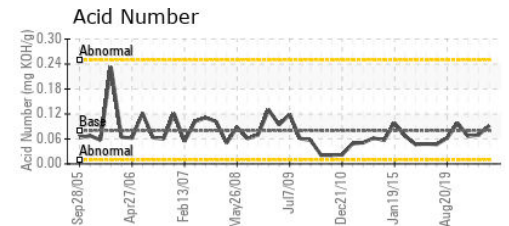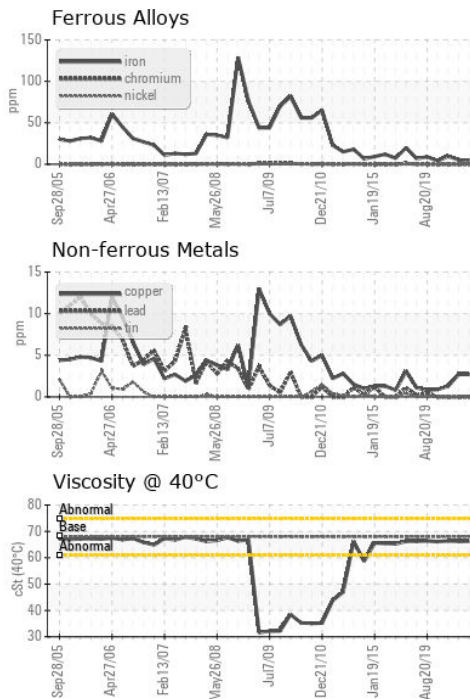

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0813260
 Lab Number : 05923383
 Unique Number : 10603330
 Test Package : IND 2

Received : 14 Aug 2023
 Diagnosed : 15 Aug 2023
 Diagnostician : Don Baldrige

AURIA SOLUTIONS
 P.O. Box 580
 Albemarle, NC
 US 28001

Contact: STEPHEN MOSS
 smoss@iacna.com
 T: (704)983-8334
 F: (704)983-8372

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)