




# OIL ANALYSIS REPORT

Sample Rating Trend

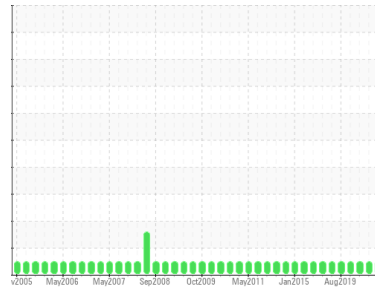

**NORMAL**



Machine Id  
**29**  
 Component  
**Turbine**  
 Fluid  
**R&O OIL ISO 68 (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0813272</b>	WC0700743	WC0577565
Sample Date	Client Info	<b>13 Aug 2023</b>	14 Sep 2022	16 Nov 2021
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >15	<b>5</b>	7	8
Chromium ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum ppm	ASTM D5185m >10	<b>&lt;1</b>	1	0
Lead ppm	ASTM D5185m	<b>0</b>	0	0
Copper ppm	ASTM D5185m >5	<b>2</b>	2	2
Tin ppm	ASTM D5185m >5	<b>0</b>	0	0
Antimony ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium ppm	ASTM D5185m 5	<b>&lt;1</b>	0	0
Molybdenum ppm	ASTM D5185m 5	<b>0</b>	0	0
Manganese ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium ppm	ASTM D5185m 5	<b>6</b>	0	0
Calcium ppm	ASTM D5185m 5	<b>0</b>	0	0
Phosphorus ppm	ASTM D5185m 100	<b>3</b>	<1	2
Zinc ppm	ASTM D5185m 25	<b>33</b>	13	1
Sulfur ppm	ASTM D5185m 1500	<b>121</b>	115	186

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >15	<b>3</b>	2	2
Sodium ppm	ASTM D5185m	<b>1</b>	0	0
Potassium ppm	ASTM D5185m >20	<b>&lt;1</b>	2	0





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>2811</b>	12382	8375
Particles >6µm	ASTM D7647 >1300	<b>73</b>	301	167
Particles >14µm	ASTM D7647 >160	<b>5</b>	2	5
Particles >21µm	ASTM D7647 >40	<b>2</b>	0	1
Particles >38µm	ASTM D7647 >10	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/14	<b>19/13/10</b>	21/15/9	20/15/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 0.08	<b>0.088</b>	0.063	0.06

# OIL ANALYSIS REPORT

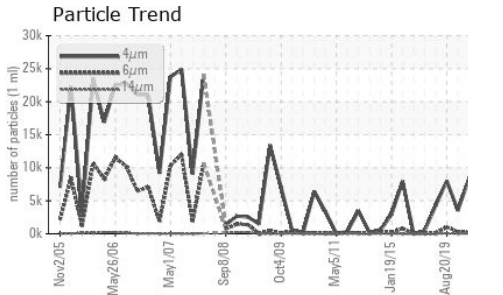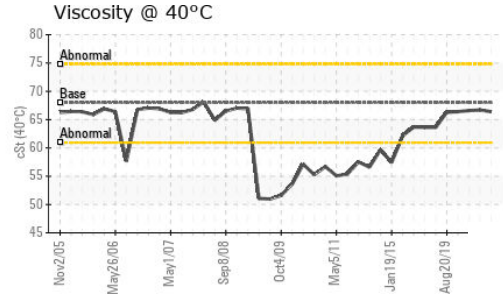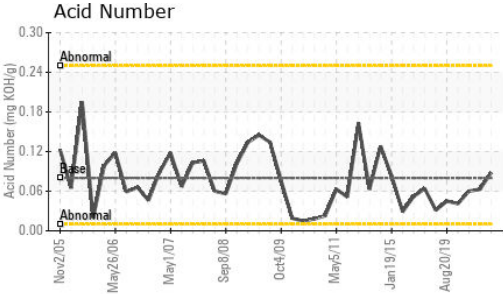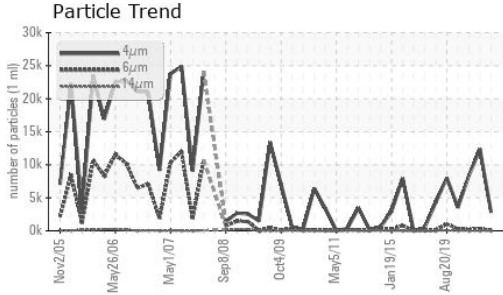




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>66.4</b>	66.7	66.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

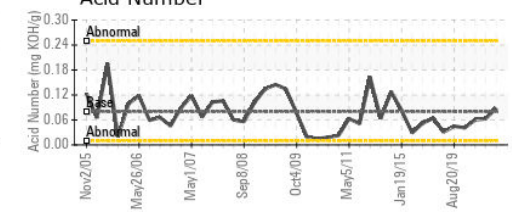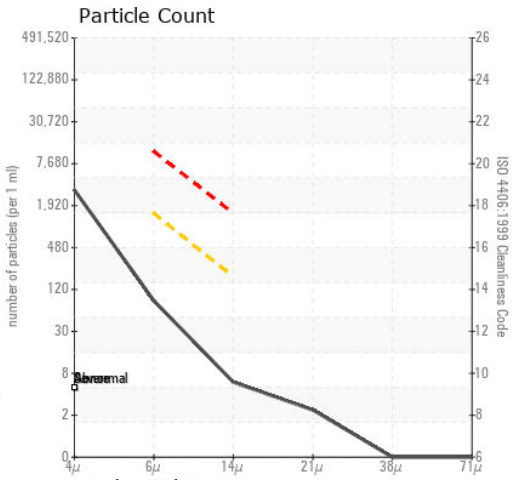

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0813272 **Received** : 14 Aug 2023  
**Lab Number** : **05923410** **Diagnosed** : 15 Aug 2023  
**Unique Number** : 10603357 **Diagnostician** : Don Baldrige

**AURIA SOLUTIONS**  
P.O. Box 580  
Albemarle, NC  
US 28001  
Contact: STEPHEN MOSS  
smoss@iacna.com  
T: (704)983-8334  
F: (704)983-8372

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)