




PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
Recovery
 Machine Id
Lightnin FHG15AB01 Harvest Tank, Agitator
 Component
Gearbox
 Fluid
JAX FGG-AW ISO 150 (--- GAL)

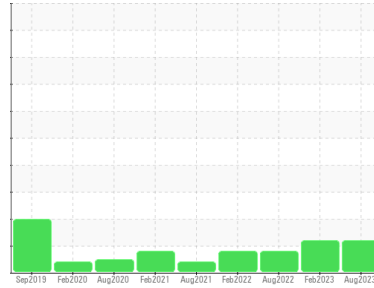

COMPONENT CONDITION SUMMARY

▲ Particle Trend

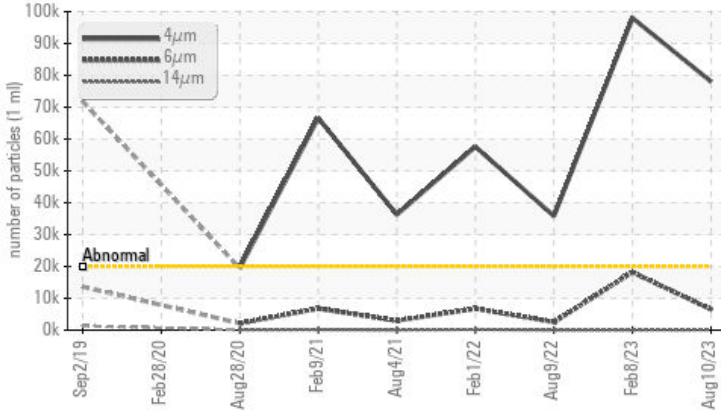

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | ABNORMAL | ATTENTION |
|-----------------|--------------|-----------|------------|------------|------------|
| Particles >4µm | ASTM D7647 | >20000 | ▲ 78029 | ▲ 98007 | ▲ 35823 |
| Particles >6µm | ASTM D7647 | >5000 | ▲ 6501 | ▲ 18202 | 2494 |
| Oil Cleanliness | ISO 4406 (c) | >21/19/16 | ▲ 23/20/13 | ▲ 24/21/13 | ▲ 22/18/13 |

Customer Id: NOVFRANC
 Sample No.: WC0808206
 Lab Number: 05923442
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

08 Feb 2023 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Aug 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Feb 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

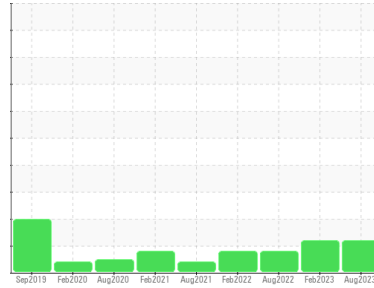

ISO



Area

Recovery

Machine Id

Lightnin FHG15AB01 Harvest Tank, Agitator

Component

Gearbox

Fluid

JAX FGG-AW ISO 150 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | WC0808206 | WC0753874 | WC0709662 |
| Sample Date | Client Info | 10 Aug 2023 | 08 Feb 2023 | 09 Aug 2022 |
| Machine Age | hrs | Client Info | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | ABNORMAL | ABNORMAL | ATTENTION |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|----------|------------|------------------|--------------|----------|-----|
| Iron | ppm | ASTM D5185m >200 | 9 | 7 | 4 |
| Chromium | ppm | ASTM D5185m >15 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >15 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m >25 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185m >100 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >200 | <1 | 0 | 0 |
| Tin | ppm | ASTM D5185m >25 | <1 | 0 | 0 |
| Antimony | ppm | ASTM D5185m >5 | --- | --- | --- |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|-------------|--------------|----------|-----|
| Boron | ppm | ASTM D5185m | 37 | 28 | 0 |
| Barium | ppm | ASTM D5185m | 2 | 2 | 2 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 8 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 475 | 388 | 86 |
| Phosphorus | ppm | ASTM D5185m | 598 | 563 | 571 |
| Zinc | ppm | ASTM D5185m | 129 | 98 | 23 |
| Sulfur | ppm | ASTM D5185m | 894 | 943 | 719 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon | ppm | ASTM D5185m >50 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185m | 2 | 1 | <1 |
| Potassium | ppm | ASTM D5185m >20 | <1 | 0 | 0 |
| Water | % | ASTM D6304 >0.2 | 0.008 | 0.016 | 0.008 |
| ppm Water | ppm | ASTM D6304 >2000 | 85.9 | 167.8 | 83.6 |

FLUID CLEANLINESS






| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|-------------------|------------|------------|
| Particles >4µm | ASTM D7647 >20000 | ▲ 78029 | ▲ 98007 | ▲ 35823 |
| Particles >6µm | ASTM D7647 >5000 | ▲ 6501 | ▲ 18202 | 2494 |
| Particles >14µm | ASTM D7647 >640 | 62 | 77 | 49 |
| Particles >21µm | ASTM D7647 >160 | 10 | 6 | 6 |
| Particles >38µm | ASTM D7647 >40 | 1 | 0 | 0 |
| Particles >71µm | ASTM D7647 >10 | 1 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) >21/19/16 | ▲ 23/20/13 | ▲ 24/21/13 | ▲ 22/18/13 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | |
|------------------|------------|------------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.28 | 0.29 | 0.40 |




OIL ANALYSIS REPORT

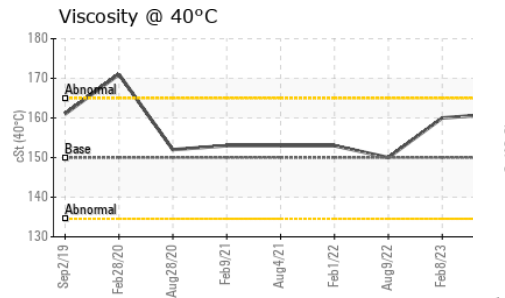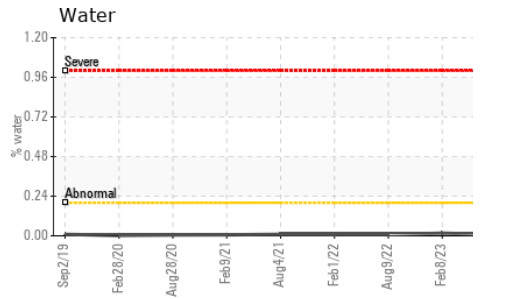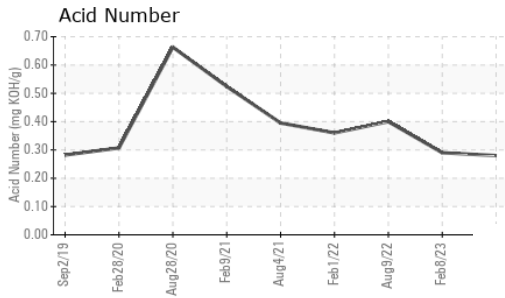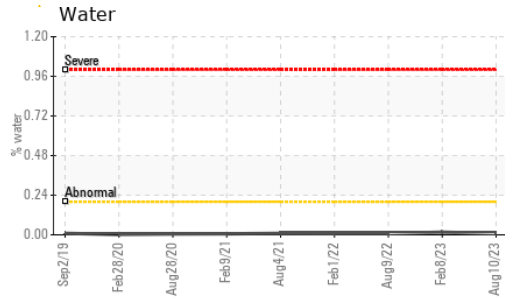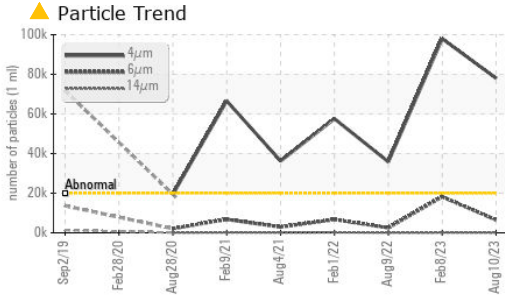





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 150 | 161 | 160 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

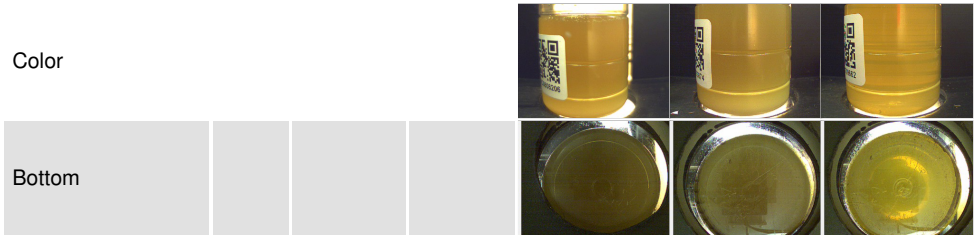

GRAPHS

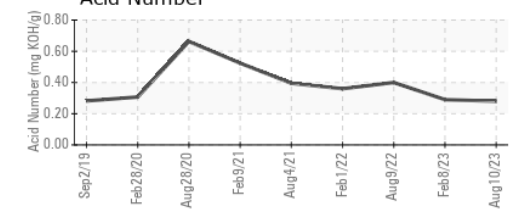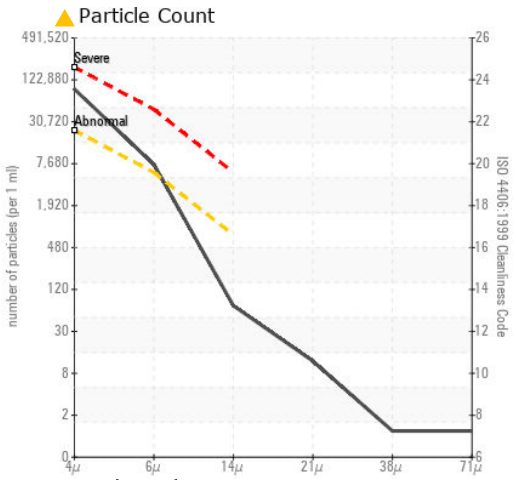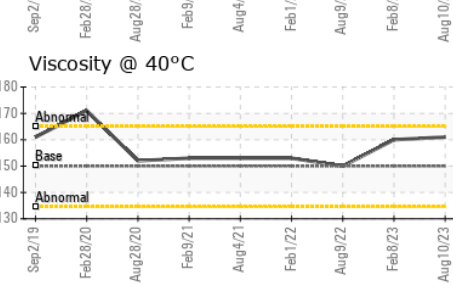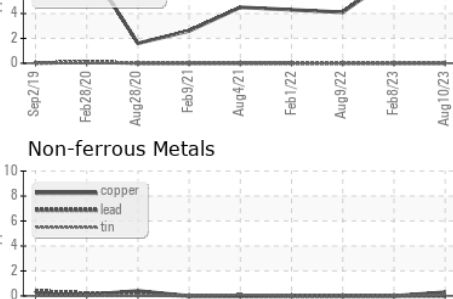

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0808206 **Received** : 14 Aug 2023
Lab Number : 05923442 **Diagnosed** : 15 Aug 2023
Unique Number : 10603389 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

NOVOZYMES
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD
 FRANKLINTON, NC
 US 27525
 Contact: BRUCE THOMAS
 brct@novozymes.com
 T: (919)494-3146
 F: (919)494-3456

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)