




OIL ANALYSIS REPORT

Sample Rating Trend

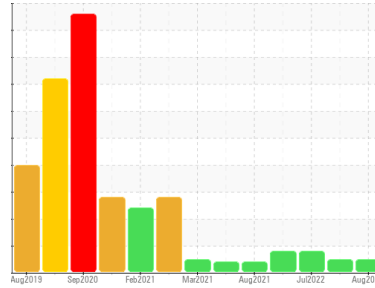

NORMAL



Area
Recovery
 Machine Id
Lightnin FFI57BB01 Standardization Tank, Agitator
 Component
Gearbox
 Fluid
JAX FGG-AW ISO 150 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0808207 | WC0697844 | WC0718044 |
| Sample Date | Client Info | | 10 Aug 2023 | 07 Mar 2023 | 28 Jul 2022 |
| Machine Age | mths | Client Info | 2 | 2 | 2 |
| Oil Age | mths | Client Info | 2 | 0 | 2 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | NORMAL | NORMAL | ATTENTION |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|----------|--------|-------------|---------|----------|----------|-----|
| Iron | ppm | ASTM D5185m | >200 | <1 | 3 | 2 |
| Chromium | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >15 | 0 | 0 | 1 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m | >25 | <1 | <1 | 2 |
| Lead | ppm | ASTM D5185m | >100 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >200 | <1 | 0 | 0 |
| Tin | ppm | ASTM D5185m | >25 | 0 | 0 | 1 |
| Antimony | ppm | ASTM D5185m | >5 | --- | --- | --- |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|-------------|---------|----------|----------|-----|
| Boron | ppm | ASTM D5185m | | 0 | 1 | |
| Barium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | | 7 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | | 11 | 21 | 7 |
| Phosphorus | ppm | ASTM D5185m | | 467 | 450 | 462 |
| Zinc | ppm | ASTM D5185m | | 20 | 2 | 0 |
| Sulfur | ppm | ASTM D5185m | | 709 | 737 | 817 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|-------------|---------|----------|----------|-------|
| Silicon | ppm | ASTM D5185m | >50 | <1 | 1 | <1 |
| Sodium | ppm | ASTM D5185m | | 1 | <1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | 0 |
| Water | % | ASTM D6304 | >0.2 | 0.007 | 0.008 | 0.010 |
| ppm Water | ppm | ASTM D6304 | >2000 | 79.1 | 88.7 | 103.8 |

FLUID CLEANLINESS






| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|----------|----------|------------|
| Particles >4µm | ASTM D7647 | >20000 | 4829 | 19191 | ▲ 21296 |
| Particles >6µm | ASTM D7647 | >5000 | 409 | 1468 | 1074 |
| Particles >14µm | ASTM D7647 | >640 | 18 | 32 | 34 |
| Particles >21µm | ASTM D7647 | >160 | 5 | 8 | 6 |
| Particles >38µm | ASTM D7647 | >40 | 0 | 2 | 0 |
| Particles >71µm | ASTM D7647 | >10 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >21/19/16 | 19/16/11 | 21/18/12 | ▲ 22/17/12 |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|------------|---------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.32 | 0.30 | 0.31 |




OIL ANALYSIS REPORT

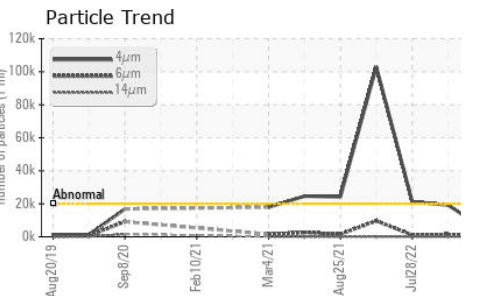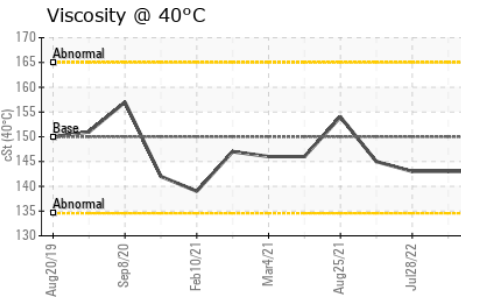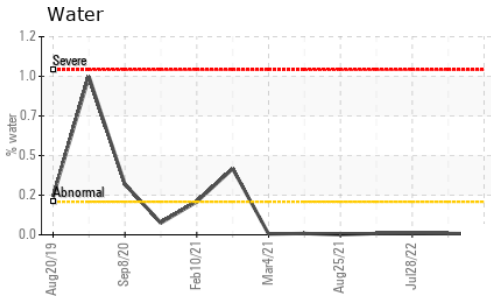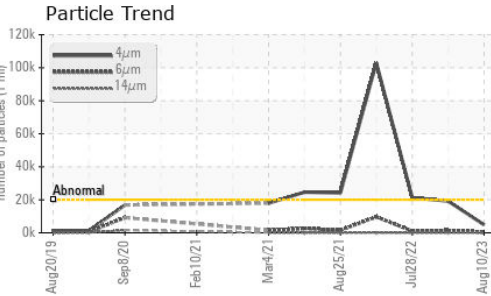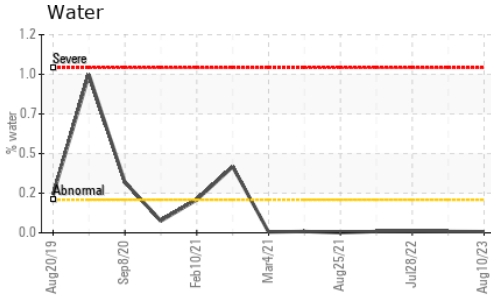






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 150 | 143 | 143 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

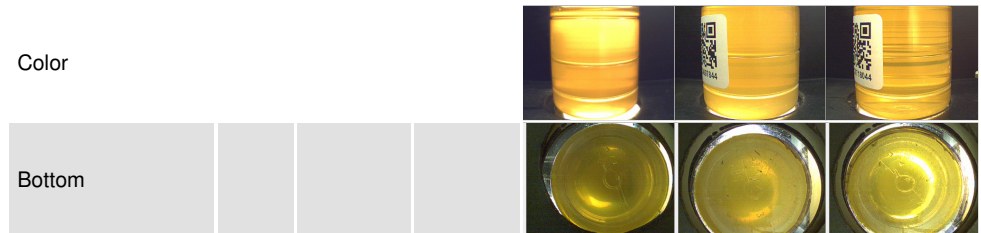

GRAPHS

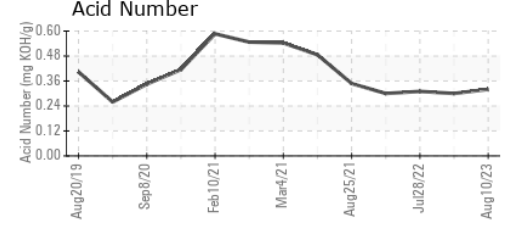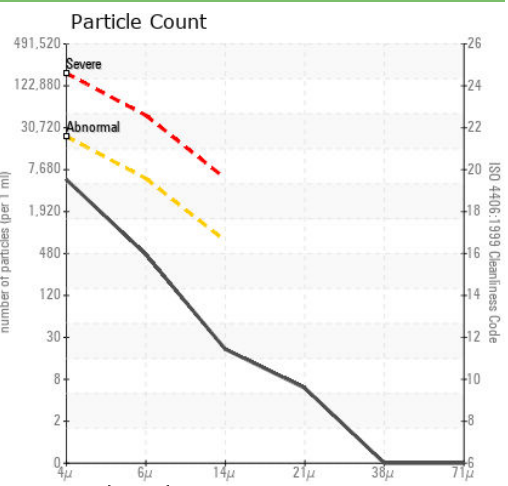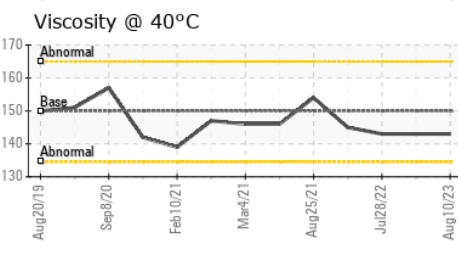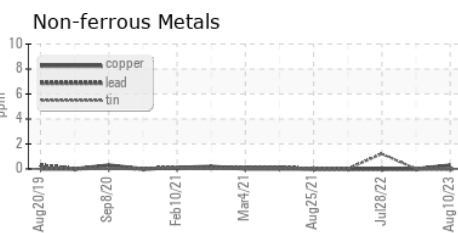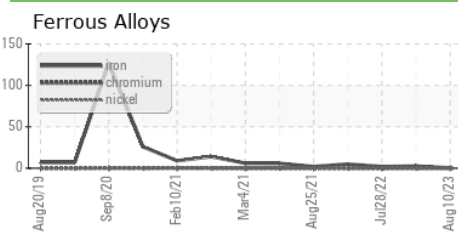

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0808207 **Received** : 14 Aug 2023
Lab Number : 05923443 **Diagnosed** : 15 Aug 2023
Unique Number : 10603390 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

NOVOZYMES
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD
 FRANKLINTON, NC
 US 27525
 Contact: BRUCE THOMAS
 brct@novozymes.com
 T: (919)494-3146
 F: (919)494-3456

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)