




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**ULTRA COOLANT [55110]**  
 Machine Id  
**INGERSOLL RAND CBV261787 - JOHN VOLPI & CO**  
 Component  
**Compressor**

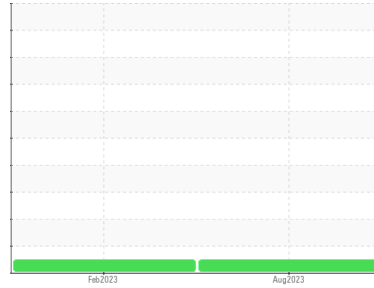

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05923495</b>	UCH05779022	---
Sample Date	Client Info		<b>04 Aug 2023</b>	10 Feb 2023	---
Machine Age	hrs	Client Info	<b>31168</b>	25606	---
Oil Age	hrs	Client Info	<b>2210</b>	4000	---
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 500	<b>795</b>	645	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	4	---
Calcium	ppm	ASTM D5185m 0	<b>3</b>	11	---
Phosphorus	ppm	ASTM D5185m 20	<b>2</b>	9	---
Zinc	ppm	ASTM D5185m 0	<b>114</b>	234	---
Sulfur	ppm	ASTM D5185m 200	<b>432</b>	436	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>27</b>	60	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	4	---

## FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.28</b>	0.51	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	NEG	---




# OIL ANALYSIS REPORT



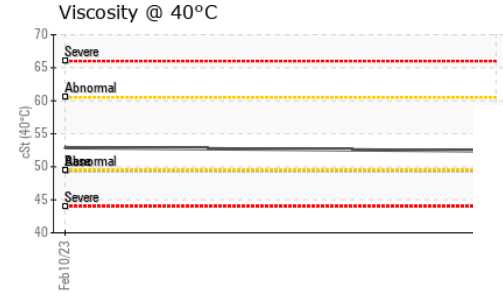
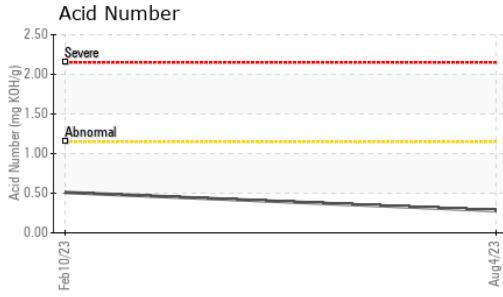


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	<b>52.4</b>	52.9	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

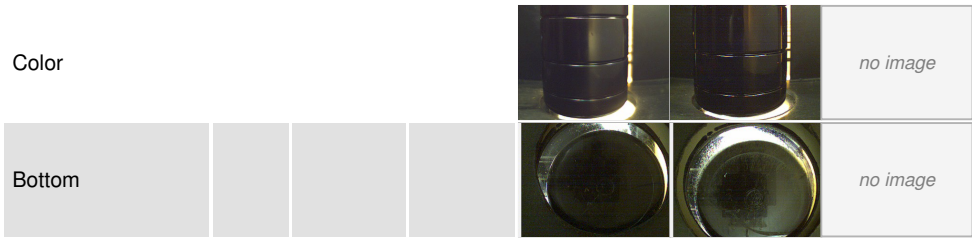

## GRAPHS

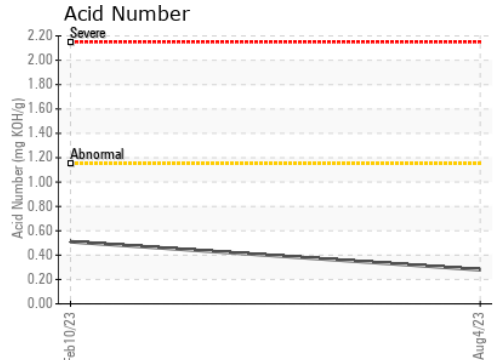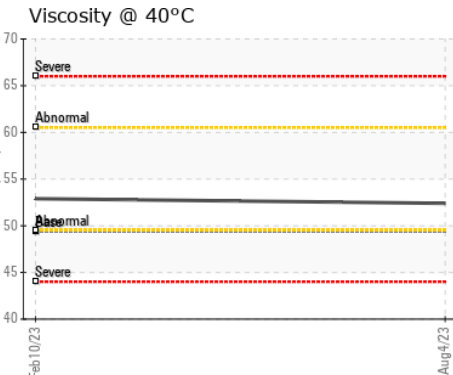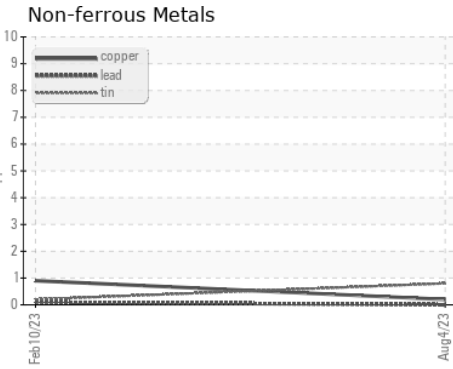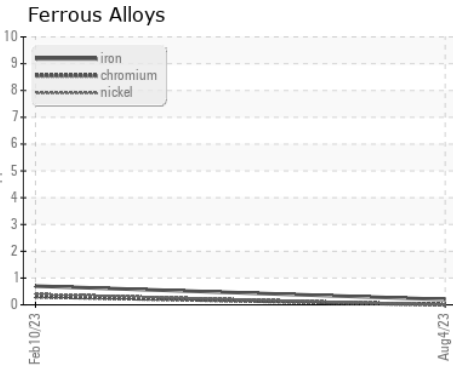

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05923495 **Received** : 14 Aug 2023  
**Lab Number** : **05923495** **Diagnosed** : 15 Aug 2023  
**Unique Number** : 10603442 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhf.com  
 T: (314)593-1267  
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)