


OIL ANALYSIS REPORT

Sample Rating Trend

SAMPLE INFORMATION method limit/base current

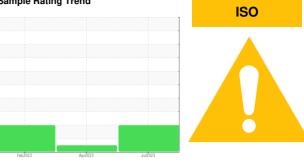

history1

history2

Machine Id 27248 Component **Diesel Engine** NOT GIVEN (--- QTS)

DIAGNOSIS

A Recommendation

We recommend you service the filters on this component. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.


SAMPLE INFORM	ATION	method	iimit/base	current	nistory i	nistory2
Sample Number		Client Info		KL0012053	KLM2339466	KLM2339342
Sample Date		Client Info		28 Jul 2023	08 Apr 2023	12 Feb 2023
Machine Age	mls	Client Info		102793	100170	95664
Oil Age	mls	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	ABNORMAL
CONTAMINATION	I	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Glycol		WC Method		NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	14	48	32
Chromium	ppm	ASTM D5185m		<1	2	1
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	8	10
Lead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m	>330	0	1	<1
Tin	ppm	ASTM D5185m	>15	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		72	49	34
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		68	61	60
Manganese	ppm	ASTM D5185m		<1	<1	2
Magnesium	ppm	ASTM D5185m		1127	1057	957
Calcium	ppm	ASTM D5185m		1030	1007	1098
Phosphorus	ppm	ASTM D5185m		1098	1077	988
Zinc	ppm	ASTM D5185m		1336	1336	1339
Sulfur	ppm	ASTM D5185m		4199	3933	3692
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	8	8
Sodium	ppm	ASTM D5185m		3	5	5
Potassium	ppm	ASTM D5185m	>20	3	13	14
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.4	0.8	0.7
Nitration	Abs/cm	*ASTM D7624	>20	8.1	11.3	11.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.9	25.4	25.3



OIL ANALYSIS REPORT

Particle Trend



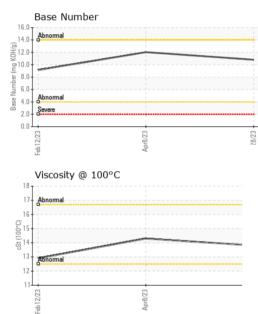

FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		23802	2488	14633
Particles >6µm		ASTM D7647	>5000	12966	1355	A 7971
Particles >14µm		ASTM D7647	>640	2207	231	🔺 1357
Particles >21µm		ASTM D7647	>160	743	78	4 57
Particles >38µm		ASTM D7647	>40	115	12	A 71
Particles >71µm		ASTM D7647	>10	12	1	7
Dil Cleanliness		ISO 4406 (c)	>19/16	21/18	18/15	▲ 20/18
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Dxidation	Abs/.1mm	*ASTM D7414	>25	18.2	23.4	25.3
ase Number (BN)	mg KOH/g	ASTM D2896		10.80	12.03	9.14
VISUAL		method	limit/base	current	history1	history2
Vhite Metal	scalar	*Visual	NONE	NONE	NONE	NONE
ellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
recipitate	scalar	*Visual	NONE	NONE	NONE	NONE
iilt	scalar	*Visual	NONE	NONE	NONE	NONE
ebris	scalar	*Visual	NONE	NONE	NONE	NONE
and/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
ppearance	scalar	*Visual	NORML	NORML	NORML	NORML
)dor	scalar	*Visual	NORML	NORML	NORML	NORML
mulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
ree Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
∕isc @ 100°C	cSt	ASTM D445		13.8	14.3	12.9
GRAPHS						
Ferrous Alloys				Particle Count	t	
im			491,520]		T ²⁶
chromium			122,880			-24
nickel			30,720			-22
			€ = 7,680			20
Feb 1 2/2 3	Apr8/23		Jul28/23 (per 1 ml) 1'800		-	
Feb	Aŗ		[]미 _ Bd, 1,920 Sa	† · · · · ·		+18
Non-ferrous Metal	S		Jul28/23 0261 ml) 10128/23 10		1	+20 +18 +16 +14
copper			120 la			14
nananananan lead			30			12
• ••••••••••••••••••••••••••••••••••••						10
			8	Sever enal		110
tin	23			Berever mal		
tin	Apr8/23		ul28/23	-		-8
			8 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2	-	14µ 21µ	

Ê 10.0

Feb12/23

Base Number 0.0

Jul28/23 -

: 14 Aug 2023

: 16 Aug 2023

Diagnostician : Angela Borella



 Certificate 12367
 Test Package
 : MOB 2 (Additional Tests: PrtCount)

 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 *

 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Apr8/23 -

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received

Diagnosed

°001) 14 12

10

Unique Number : 10603517

Feb12/23

: KL0012053

: 05923570

Report Id: CITAIE [WUSCAR] 05923570 (Generated: 08/16/2023 08:48:21) Rev: 1

Laboratory Sample No.

Lab Number

Contact/Location: CLYDE OMIJA - CITAIE

Apr8/23 -

CITY & COUNTY HONOLULU

99-999 IWAENA RD

Contact: CLYDE OMIJA

comija@honolulu.gov

T: (575)623-9952

Page 2 of 2

ul28/23

AIEA, HI

F:

US 96701