




OIL ANALYSIS REPORT

Sample Rating Trend

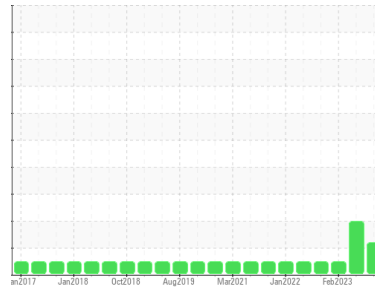

ISO



Machine Id
27256

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0011938	KLM2339425	KLM2340527
Sample Date	Client Info		27 Jul 2023	08 Apr 2023	10 Feb 2023
Machine Age	mls	Client Info	54447	52370	50246
Oil Age	mls	Client Info	0	0	20447
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	10	36	54
Chromium	ppm	ASTM D5185m >20	<1	<1	2
Nickel	ppm	ASTM D5185m >4	0	0	<1
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >20	1	3	13
Lead	ppm	ASTM D5185m >40	0	0	<1
Copper	ppm	ASTM D5185m >330	<1	1	4
Tin	ppm	ASTM D5185m >15	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	95	59	18
Barium	ppm	ASTM D5185m 10	0	0	0
Molybdenum	ppm	ASTM D5185m 100	67	60	55
Manganese	ppm	ASTM D5185m	<1	<1	2
Magnesium	ppm	ASTM D5185m 450	1160	1101	999
Calcium	ppm	ASTM D5185m 3000	1005	1013	1249
Phosphorus	ppm	ASTM D5185m 1150	1098	1072	978
Zinc	ppm	ASTM D5185m 1350	1337	1331	1342
Sulfur	ppm	ASTM D5185m 4250	4223	4077	3691

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	6	6	11
Sodium	ppm	ASTM D5185m >158	2	3	5
Potassium	ppm	ASTM D5185m >20	1	5	17


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.4	2.8	1.6
Nitration	Abs/cm	*ASTM D7624 >20	7.3	12.4	12.5
Sulfation	Abs./1mm	*ASTM D7415 >30	20.1	29.0	27.5




OIL ANALYSIS REPORT


▲ Particle Trend

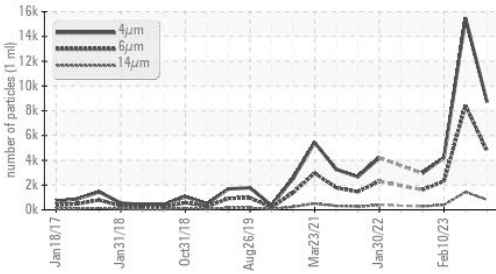


▲ Particle Trend

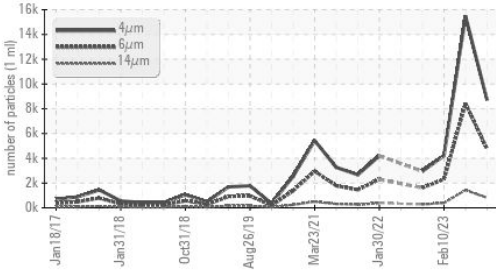

Base Number

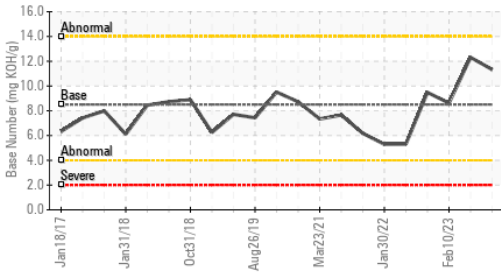

Viscosity @ 100°C

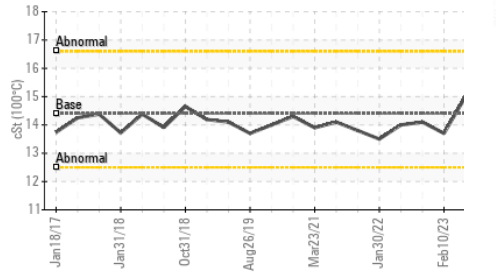

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8708	15468	4219
Particles >6µm	ASTM D7647	>5000	4744	▲ 8426	2299
Particles >14µm	ASTM D7647	>640	▲ 807	▲ 1434	391
Particles >21µm	ASTM D7647	>160	▲ 272	▲ 483	132
Particles >38µm	ASTM D7647	>40	42	▲ 75	20
Particles >71µm	ASTM D7647	>10	4	8	2
Oil Cleanliness	ISO 4406 (c)	>19/16	▲ 19/17	▲ 20/18	18/16


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	17.0	23.5	25.2
Base Number (BN)	mg KOH/g ASTM D2896	8.5	11.33	12.31	8.62

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445	14.4	14.0	15.0	13.7

GRAPHS


Ferrous Alloys

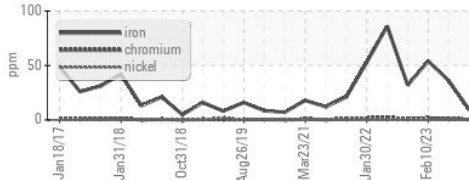


Non-ferrous Metals

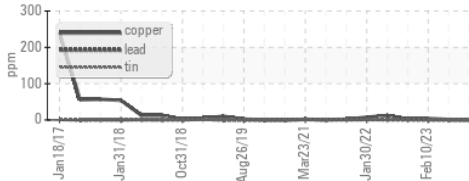


Viscosity @ 100°C

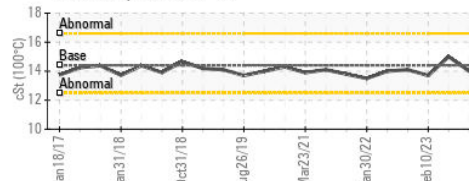

▲ Particle Count

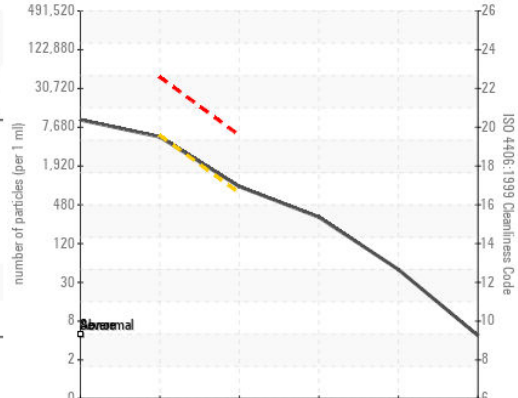

Base Number

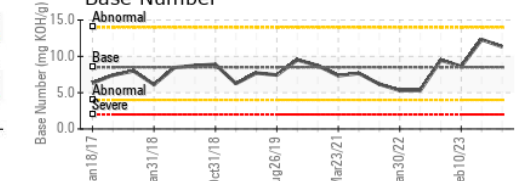

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0011938 **Received** : 14 Aug 2023
Lab Number : **05923587** **Diagnosed** : 16 Aug 2023
Unique Number : 10603534 **Diagnostician** : Angela Borella
Test Package : MOB 2 (Additional Tests: PrtCount)

CITY & COUNTY HONOLULU
 99-999 IWAENA RD
 AIEA, HI
 US 96701
 Contact: CLYDE OMIJA
 comija@honolulu.gov
 T: (575)623-9952
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)