




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
Grand Blanc New Oil Grand Blanc New Oil
 Component
New (Unused) Oil
 Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (--- GAL)

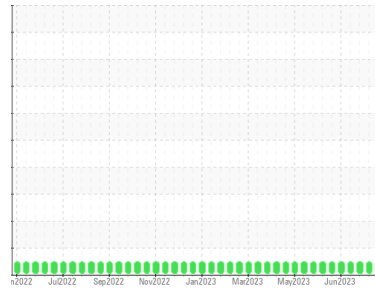

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. (Customer Sample Comment: Fresh oil sample)

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0824959	WC0824954	WC0824996
Sample Date	Client Info			08 Aug 2023	31 Jul 2023	13 Jul 2023
Machine Age	hrs Client Info			1	1	1
Oil Age	hrs Client Info			1	1	1
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	<1	<1	0
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>5	2	<1	<1
Lead	ppm	ASTM D5185m	>5	0	0	0
Copper	ppm	ASTM D5185m	>5	0	0	0
Tin	ppm	ASTM D5185m	>5	0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	<1	2
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		8	0	12
Calcium	ppm	ASTM D5185m		1669	1828	1708
Phosphorus	ppm	ASTM D5185m		249	264	250
Zinc	ppm	ASTM D5185m		298	298	291
Sulfur	ppm	ASTM D5185m		1540	1704	1728





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	6	7	8
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m	>20	1	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.2	0.84	0.141	0.48
Base Number (BN)	mg KOH/g	ASTM D2896	4.5	5.53	5.07	6.64

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual		NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG







OIL ANALYSIS REPORT

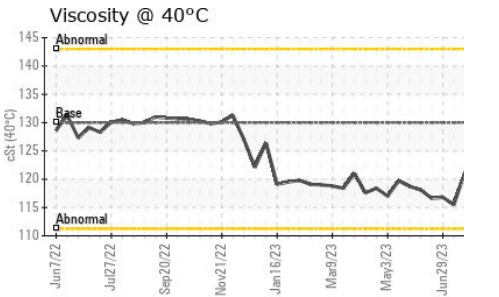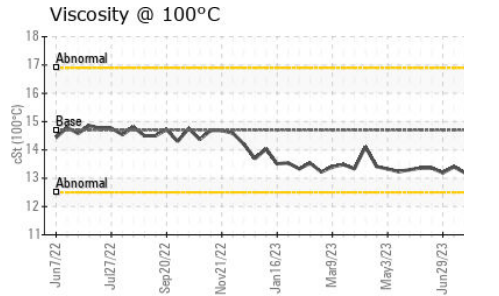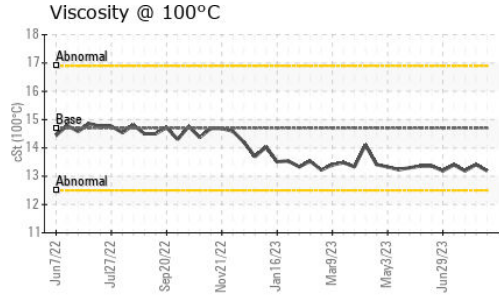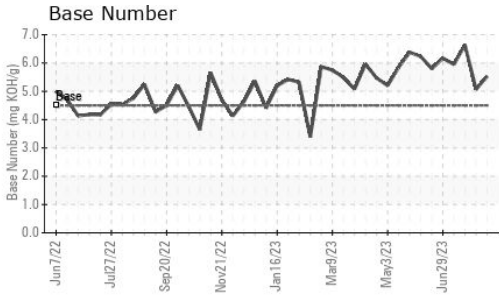

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 130	115.6	116.0	121.2
Visc @ 100°C	cSt	ASTM D445 14.7	13.19	13.41	13.19
Viscosity Index (VI)	Scale	ASTM D2270 114	109	111	102

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

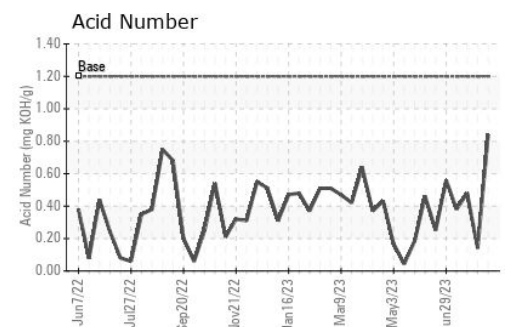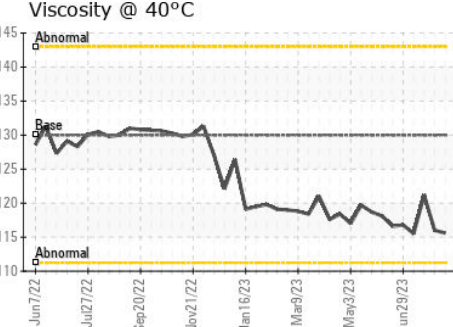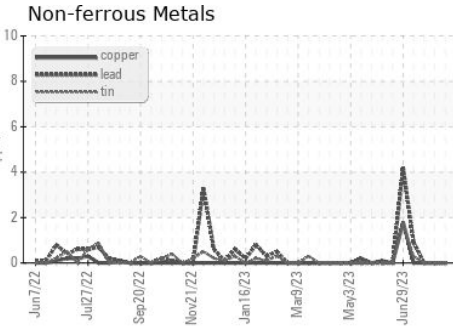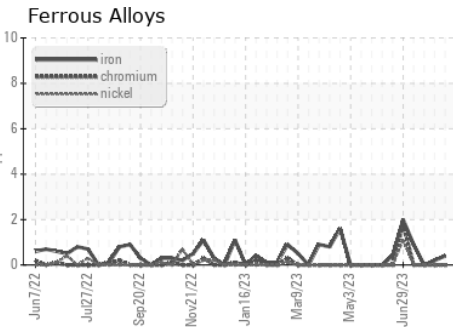

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0824959 **Received** : 14 Aug 2023
Lab Number : **05923858** **Diagnosed** : 15 Aug 2023
Unique Number : 10603805 **Diagnostician** : Doug Bogart
Test Package : MOB 2 (Additional Tests: FT-IR, ICP-NewOil, KF, KV100, PrtCount, TBN, VI)

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439
 Contact: Tony Saint Marie
 tony.saintmarie@edlenergy.com

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)