




# OIL ANALYSIS REPORT

## Sample Rating Trend

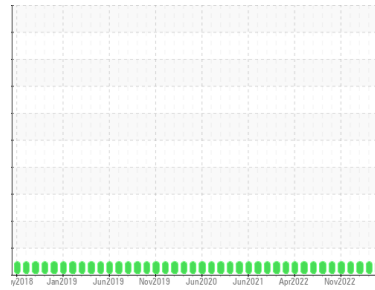

**NORMAL**



Machine Id  
**GT 0701 GT 0701**  
 Component  
**Turbine**  
 Fluid  
**MOBIL JET OIL II (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the sample is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>HLC0002616</b>	HLC0001944	HLC0001835
Sample Date	Client Info			<b>06 Aug 2023</b>	07 Apr 2023	02 Mar 2023
Machine Age	mls	Client Info		<b>0</b>	0	0
Oil Age	mls	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m		<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	4	0
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>2946</b>	2839	2706
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>2</b>	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	13
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>404</b>	408	594
Particles >6µm		ASTM D7647	>1300	<b>125</b>	122	122
Particles >14µm		ASTM D7647	>160	<b>10</b>	15	8
Particles >21µm		ASTM D7647	>40	<b>3</b>	3	2
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/14	<b>16/14/10</b>	16/14/11	16/14/10


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	<b>0.093</b>	0.162	0.06




Hilcorp Alaska, LLC

# OIL ANALYSIS REPORT


### Particle Trend

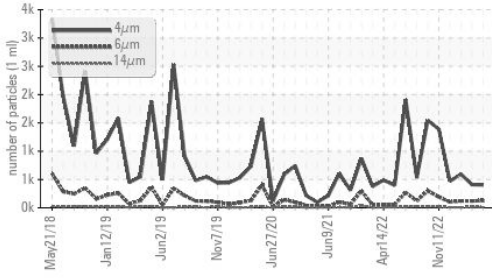


### Acid Number

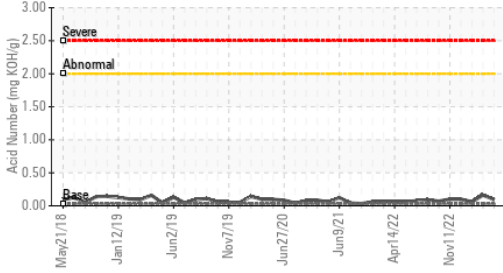

### Viscosity @ 40°C

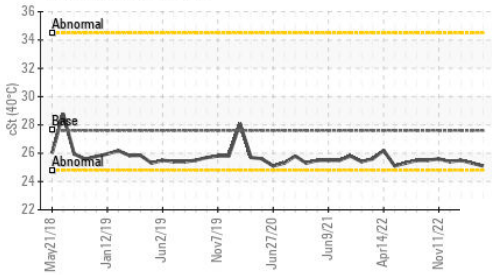


### Particle Trend

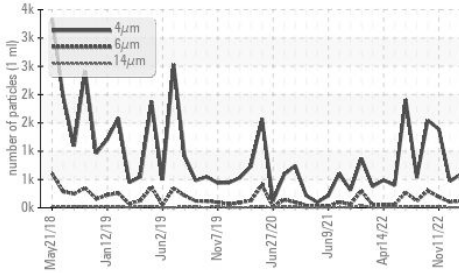






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	27.6	<b>25.1</b>	25.3	25.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

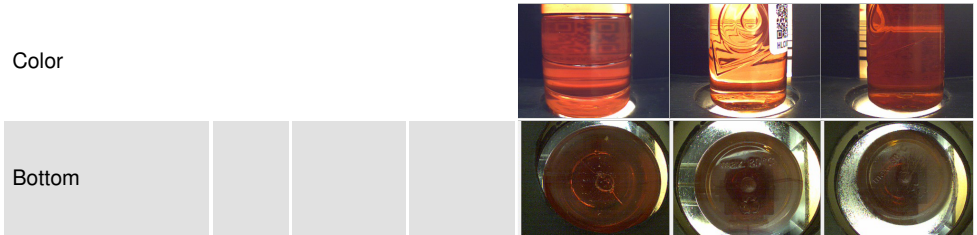

### GRAPHS

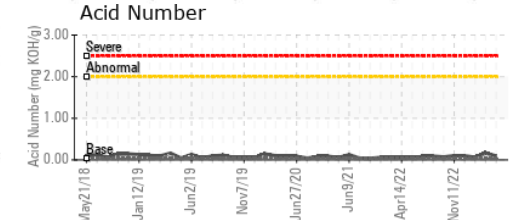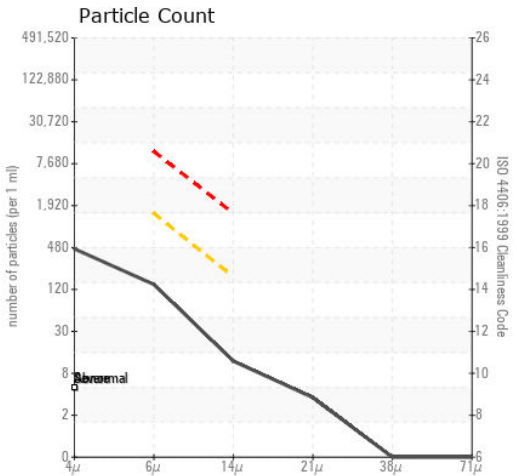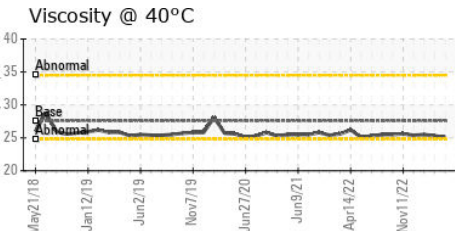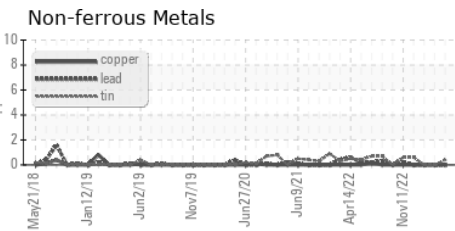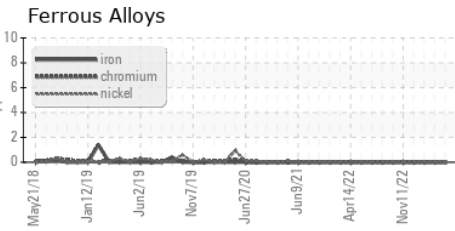

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002616 **Received** : 14 Aug 2023  
**Lab Number** : **05924183** **Diagnosed** : 15 Aug 2023  
**Unique Number** : 10604130 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)