PROBLEM SUMMARY

Sample Rating Trend

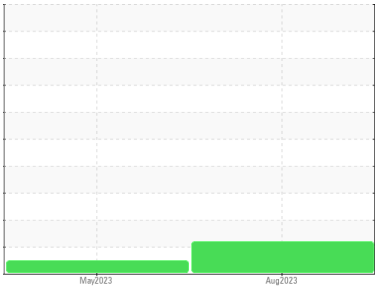

ISO

Machine Id
E-5 E-5
Component
Lube System
Fluid
MOBIL DTE OIL EXTRA HEAVY (--- GAL)

COMPONENT CONDITION SUMMARY

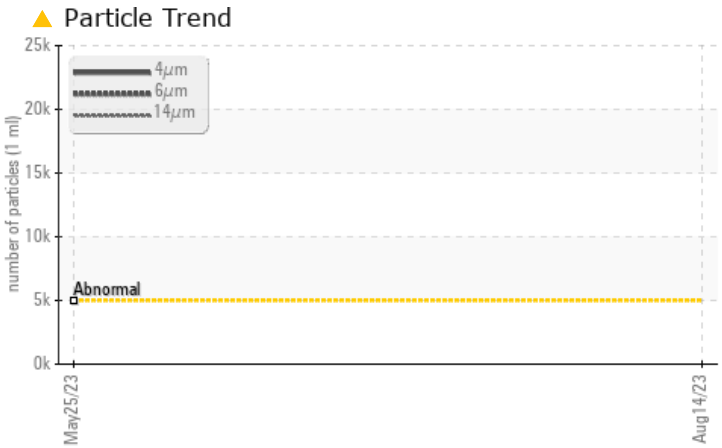

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	NORMAL	---
Particles >4µm		ASTM D7647	>5000	▲ **23390**	---	---
Particles >6µm		ASTM D7647	>1300	▲ **3251**	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ **22/19/13**	---	---

Customer Id: TESAUSTLC
Sample No.: TLC0001001
Lab Number: 05924185
Test Package: PLANT

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

25 May 2023 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

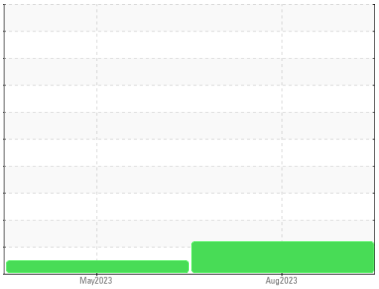

ISO

Machine Id
E-5 E-5
Component
Lube System
Fluid
MOBIL DTE OIL EXTRA HEAVY (--- GAL)

DIAGNOSIS

▲ Recommendation
We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

▲ Contamination
There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TLC0001001**	TLC0001160	---
Sample Date		Client Info		**14 Aug 2023**	25 May 2023	---
Machine Age	hrs	Client Info		**0**	0	---
Oil Age	hrs	Client Info		**0**	0	---
Oil Changed		Client Info		**N/A**	N/A	---
Sample Status				**ABNORMAL**	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	**<1**	2	---
Chromium	ppm	ASTM D5185m	>20	**0**	0	---
Nickel	ppm	ASTM D5185m	>20	**0**	0	---
Titanium	ppm	ASTM D5185m		**0**	0	---
Silver	ppm	ASTM D5185m		**0**	0	---
Aluminum	ppm	ASTM D5185m	>20	**0**	0	---
Lead	ppm	ASTM D5185m	>20	**0**	5	---
Copper	ppm	ASTM D5185m	>20	**1**	7	---
Tin	ppm	ASTM D5185m	>20	**0**	<1	---
Vanadium	ppm	ASTM D5185m		**0**	0	---
Cadmium	ppm	ASTM D5185m		**0**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	---
Barium	ppm	ASTM D5185m		**0**	3	---
Molybdenum	ppm	ASTM D5185m		**0**	<1	---
Manganese	ppm	ASTM D5185m		**0**	0	---
Magnesium	ppm	ASTM D5185m		**8**	<1	---
Calcium	ppm	ASTM D5185m		**107**	4	---
Phosphorus	ppm	ASTM D5185m		**416**	9	---
Zinc	ppm	ASTM D5185m		**520**	5	---
Sulfur	ppm	ASTM D5185m		**11000**	4795	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	**8**	12	---
Sodium	ppm	ASTM D5185m		**<1**	0	---
Potassium	ppm	ASTM D5185m	>20	**0**	1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ **23390**	---	---
Particles >6µm		ASTM D7647	>1300	▲ **3251**	---	---
Particles >14µm		ASTM D7647	>160	**48**	---	---
Particles >21µm		ASTM D7647	>40	**11**	---	---
Particles >38µm		ASTM D7647	>10	**1**	---	---
Particles >71µm		ASTM D7647	>3	**0**	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ **22/19/13**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.86**	0.34	---

OIL ANALYSIS REPORT

Particle Trend

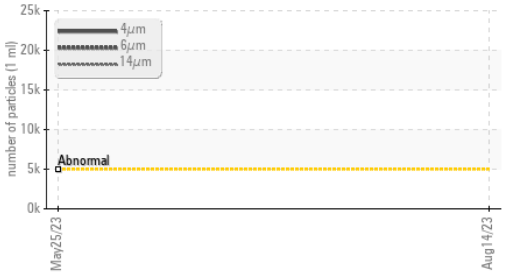

Particle Trend

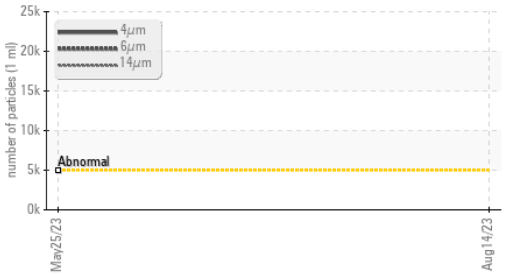

Acid Number

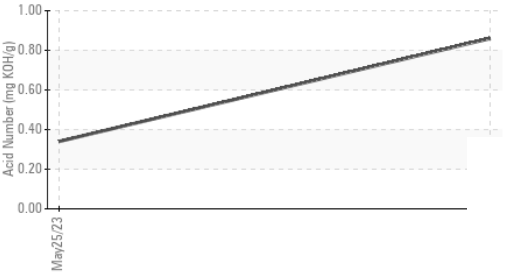

Viscosity @ 40°C

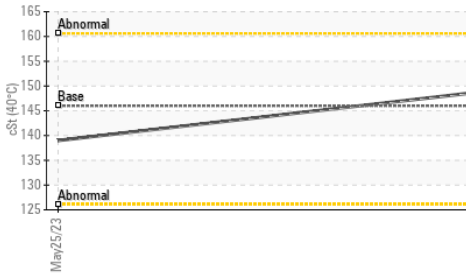

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	**NONE**	NONE	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	**NORML**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	146	**149**	139	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

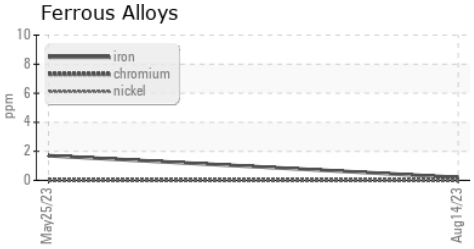

Non-ferrous Metals

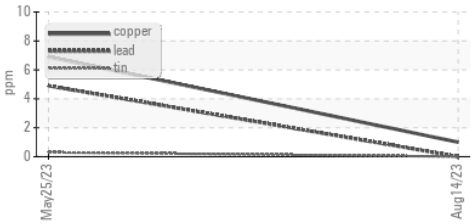

Viscosity @ 40°C

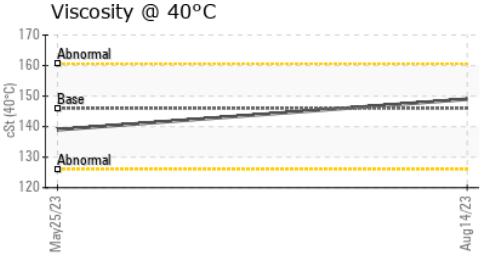

Particle Count

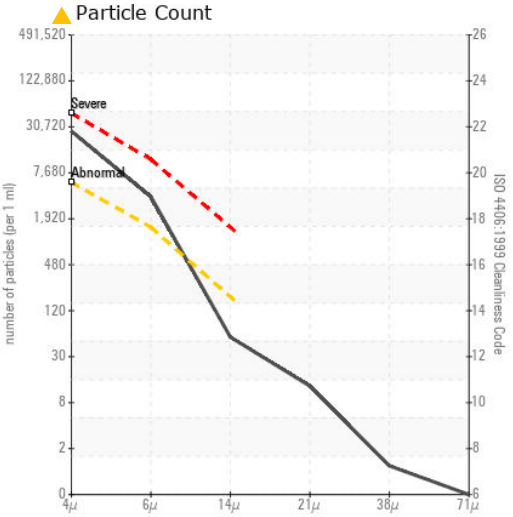

Acid Number

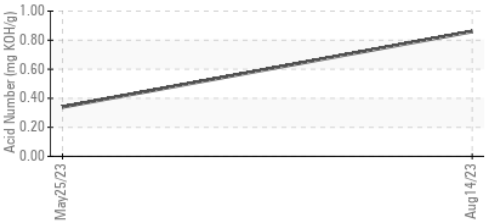

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TLC0001001
Lab Number : 05924185
Unique Number : 10604132
Test Package : PLANT

Received : 14 Aug 2023
Diagnosed : 15 Aug 2023
Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TESLA
1 Tesla Road, BIW E58
Austin, TX
US 78725
Contact: Dave Mitchell
davmitchell@tesla.com
T: (260)226-1968
F: