




# OIL ANALYSIS REPORT

## Sample Rating Trend

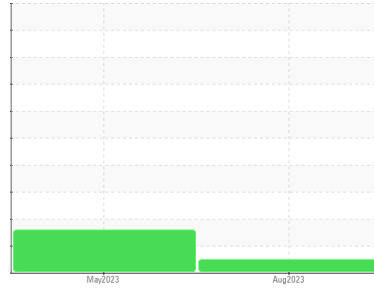

**NORMAL**



Machine Id  
**W-2 W-2**

Component  
**Hydraulic System**

Fluid  
**AW HYDRAULIC OIL ISO 46 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TLC0001005</b>	TLC0001155	---
Sample Date	Client Info			<b>14 Aug 2023</b>	10 May 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	25	<b>52</b>	54	---
Calcium	ppm	ASTM D5185m	200	<b>10</b>	12	---
Phosphorus	ppm	ASTM D5185m	300	<b>250</b>	251	---
Zinc	ppm	ASTM D5185m	370	<b>290</b>	300	---
Sulfur	ppm	ASTM D5185m	2500	<b>1021</b>	1120	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>1570</b>	▲ 22064	---
Particles >6µm		ASTM D7647	>1300	<b>439</b>	▲ 7607	---
Particles >14µm		ASTM D7647	>160	<b>31</b>	▲ 332	---
Particles >21µm		ASTM D7647	>40	<b>6</b>	29	---
Particles >38µm		ASTM D7647	>10	<b>0</b>	2	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>18/16/12</b>	▲ 22/20/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.29</b>	0.24	---




# OIL ANALYSIS REPORT

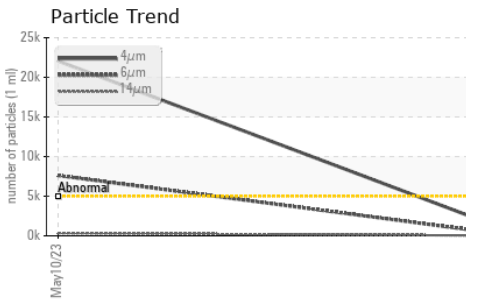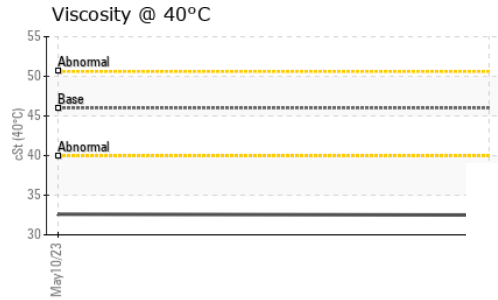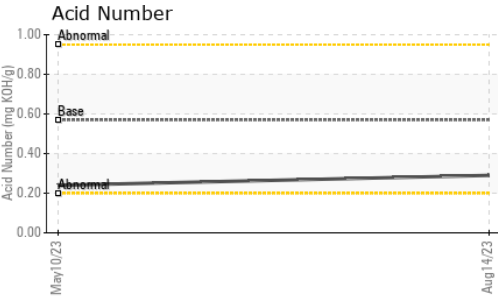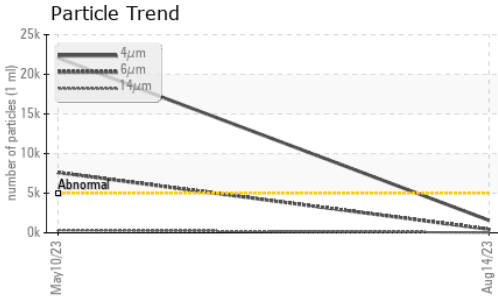






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	32.5	32.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

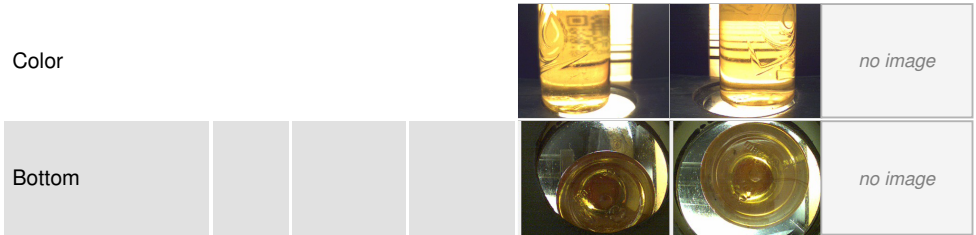

## GRAPHS

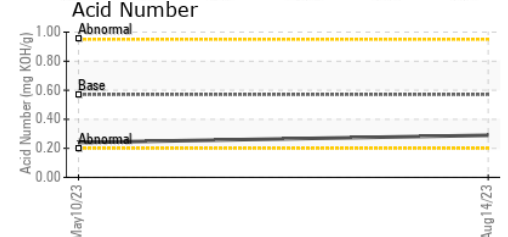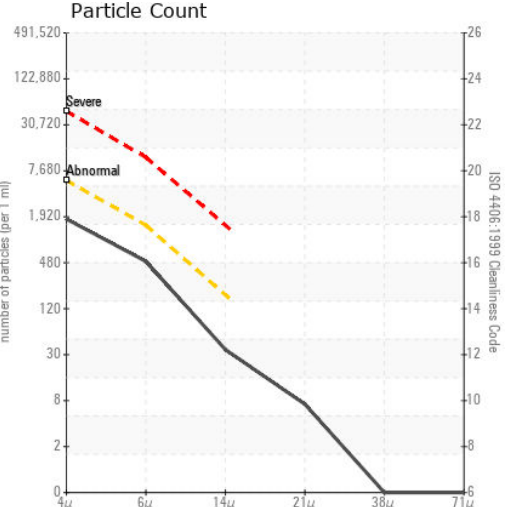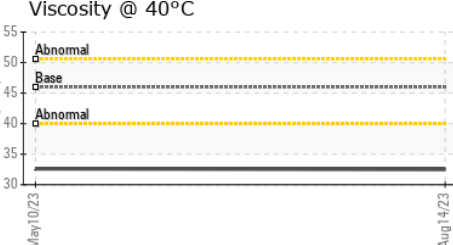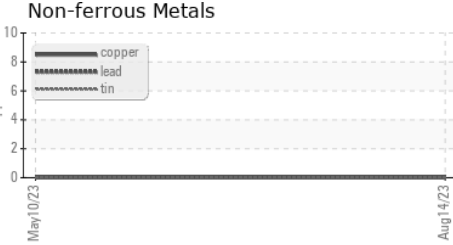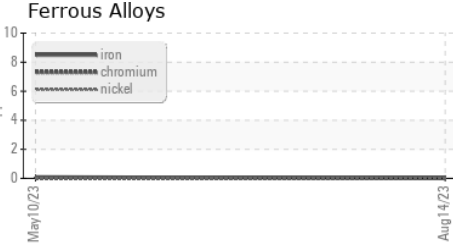

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : TLC0001005 Received : 14 Aug 2023  
 Lab Number : 05924193 Diagnosed : 15 Aug 2023  
 Unique Number : 10604140 Diagnostician : Doug Bogart  
 Test Package : PLANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**TESLA**  
 1 Tesla Road, BIW E58  
 Austin, TX  
 US 78725  
 Contact: Dave Mitchell  
 davmitchell@tesla.com  
 T: (260)226-1968  
 F: