




# OIL ANALYSIS REPORT

Sample Rating Trend

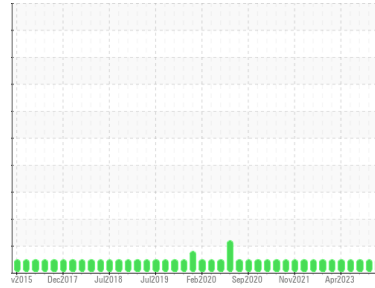

**NORMAL**



Machine Id  
**KAESER MR-AIRC-06 (S/N 1502)**

Component  
**Compressor**

Fluid  
**ULTRACHEM OMNILUBE 32/46 (--- Oz)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0799712</b>	WC0799705	WC0791929
Sample Date	Client Info		<b>07 Aug 2023</b>	10 Jul 2023	13 Jun 2023
Machine Age	hrs	Client Info	<b>59438</b>	59438	59436
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Changed</b>	N/A	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>1</b>	1	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.3	<b>0</b>	0	5
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	6
Calcium	ppm	ASTM D5185m 0.5	<b>0</b>	<1	8
Phosphorus	ppm	ASTM D5185m 536	<b>310</b>	327	354
Zinc	ppm	ASTM D5185m 0.2	<b>43</b>	47	83
Sulfur	ppm	ASTM D5185m 649	<b>490</b>	620	558

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>40000	<b>643</b>	7510	6058
Particles >6µm	ASTM D7647	>5000	<b>140</b>	2179	2098
Particles >14µm	ASTM D7647	>640	<b>9</b>	89	106
Particles >21µm	ASTM D7647	>160	<b>3</b>	19	17
Particles >38µm	ASTM D7647	>40	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>22/19/16	<b>17/14/10</b>	20/18/14	20/18/14


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.337	<b>0.54</b>	0.50	0.53




# OIL ANALYSIS REPORT


Particle Trend

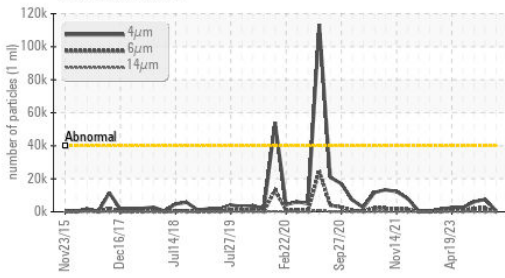


Acid Number

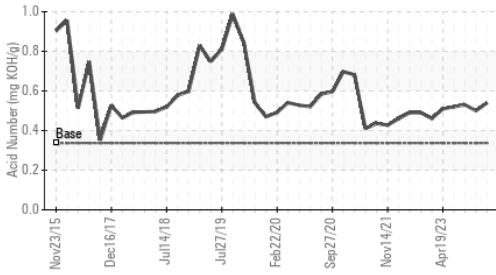

Viscosity @ 40°C

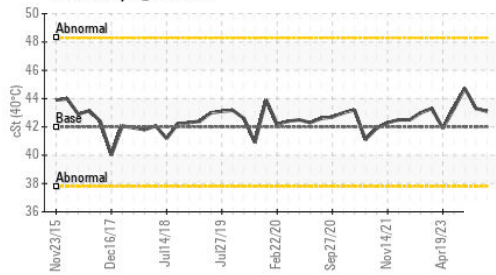

Particle Trend

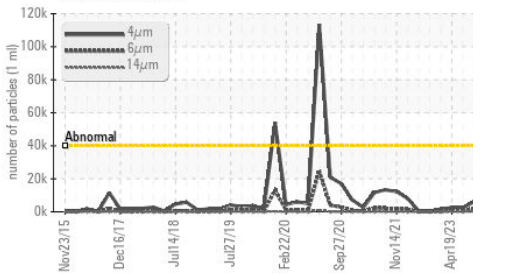


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.0	43.1	43.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

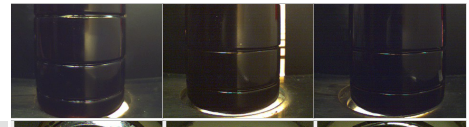


Bottom




## GRAPHS


Ferrous Alloys

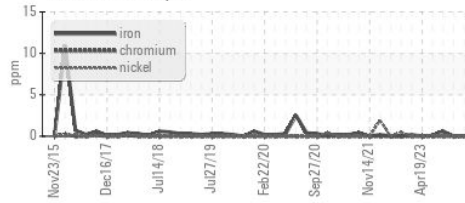


Non-ferrous Metals

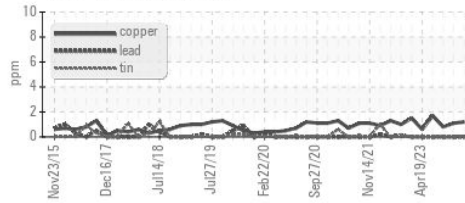


Viscosity @ 40°C

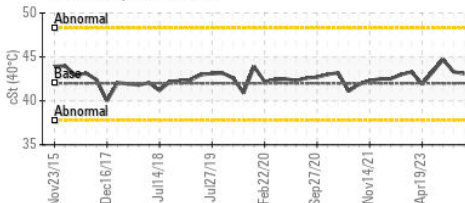

Particle Count

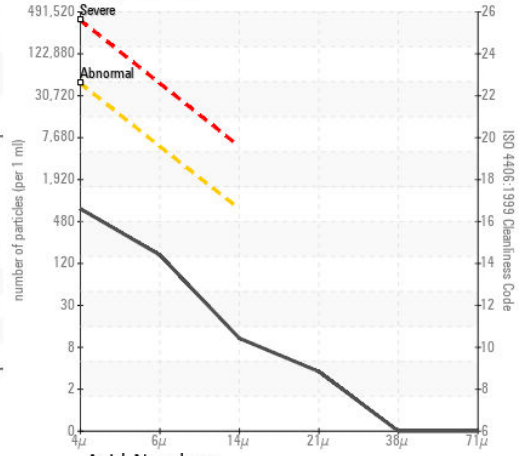

Acid Number

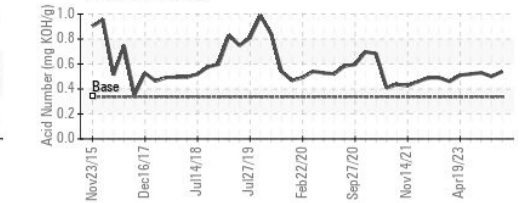

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0799712 Received : 14 Aug 2023  
 Lab Number : 05924199 Diagnosed : 15 Aug 2023  
 Unique Number : 10604146 Diagnostician : Don Baldrige  
 Test Package : IND 2 ( Additional Tests: PrtCount )

**BURKE CORPORATION.**  
 1516 SOUTH D AVE  
 NEVADA, IA  
 US 50201  
 Contact: EDUARDO COBIO  
 JECOBIO@BURKECORP.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: (515)382-3955