




PROBLEM SUMMARY

Sample Rating Trend

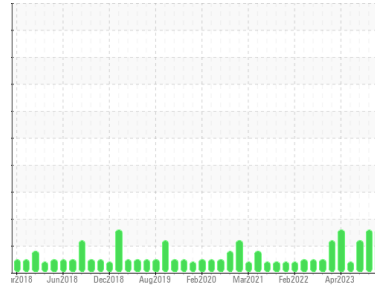

ISO




Machine Id
KAESER MR-AIRC-11 - B61275 (S/N 1223)

Component
Compressor

Fluid
ULTRACHEM OMNILUBE 32/46 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

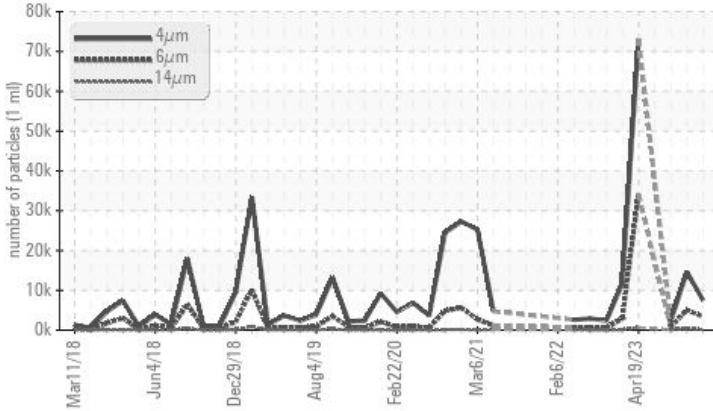

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | ABNORMAL | ATTENTION |
|-----------------|--------------|-----------|------------|------------|------------|
| Particles >6µm | ASTM D7647 | >1300 | ▲ 3349 | ▲ 5066 | 716 |
| Particles >14µm | ASTM D7647 | >80 | ▲ 143 | ▲ 362 | ▲ 89 |
| Particles >21µm | ASTM D7647 | >20 | ▲ 38 | ▲ 87 | ▲ 33 |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 20/19/14 | ▲ 21/20/16 | ▲ 18/17/14 |

Customer Id: BURNEV
Sample No.: WC0799710
Lab Number: 05924202
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Filter | --- | --- | ? | We recommend you service the filters on this component. |

HISTORICAL DIAGNOSIS

10 Jul 2023 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Jun 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 May 2023 Diag: Don Baldrige

VIS DEBRIS



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





OIL ANALYSIS REPORT

Sample Rating Trend


ISO



Machine Id
KAESER MR-AIRC-11 - B61275 (S/N 1223)

Component
Compressor

Fluid
ULTRACHEM OMNILUBE 32/46 (--- GAL)

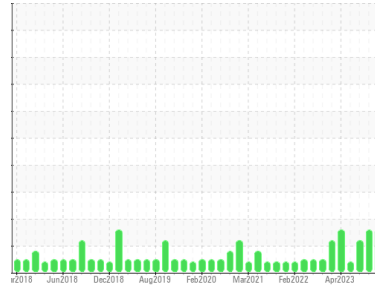

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0799710 | WC0799704 | WC0791927 |
| Sample Date | Client Info | | | 07 Aug 2023 | 10 Jul 2023 | 13 Jun 2023 |
| Machine Age | hrs | Client Info | | 57417 | 56891 | 56418 |
| Oil Age | hrs | Client Info | | 0 | 300 | 0 |
| Oil Changed | Client Info | | | Not Changed | Changed | Not Changed |
| Sample Status | | | | ABNORMAL | ABNORMAL | ATTENTION |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | <1 | <1 | <1 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | 2 | 0 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | <1 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|-------------|----------|----------|
| Boron | ppm | ASTM D5185m | 1 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 0.3 | 0 | 0 | 5 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | 0 | 6 |
| Calcium | ppm | ASTM D5185m | 0.5 | 0 | 2 | 6 |
| Phosphorus | ppm | ASTM D5185m | 536 | 71 | 105 | 115 |
| Zinc | ppm | ASTM D5185m | 0.2 | 36 | 22 | 56 |
| Sulfur | ppm | ASTM D5185m | 649 | 1937 | 2189 | 2153 |


| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | <1 | <1 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-------------------|------------|------------|
| Particles >4µm | | ASTM D7647 | | 7529 | 14599 | 2242 |
| Particles >6µm | | ASTM D7647 | >1300 | ▲ 3349 | ▲ 5066 | 716 |
| Particles >14µm | | ASTM D7647 | >80 | ▲ 143 | ▲ 362 | ▲ 89 |
| Particles >21µm | | ASTM D7647 | >20 | ▲ 38 | ▲ 87 | ▲ 33 |
| Particles >38µm | | ASTM D7647 | >4 | 3 | 3 | 1 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >--/17/13 | ▲ 20/19/14 | ▲ 21/20/16 | ▲ 18/17/14 |


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.337 | 0.25 | 0.36 | 0.38 |

OIL ANALYSIS REPORT


Particle Trend

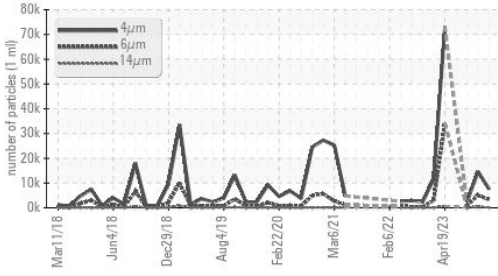


Particle Trend

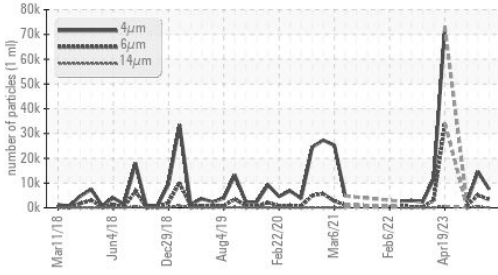

Acid Number

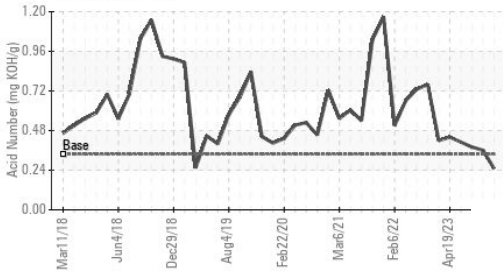

Viscosity @ 40°C

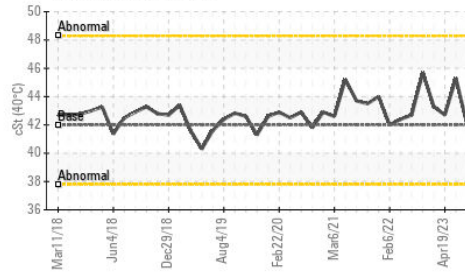

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 42.0 | 42.5 | 42.2 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color




Bottom




GRAPHS


Ferrous Alloys

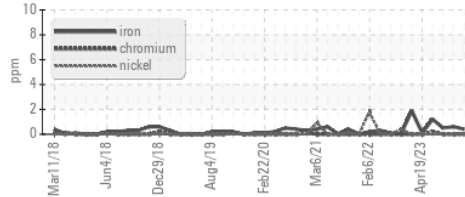


Non-ferrous Metals

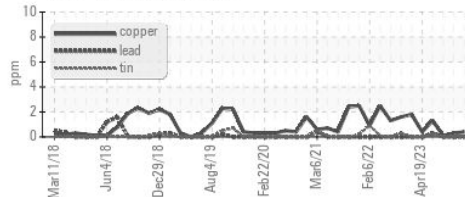


Viscosity @ 40°C

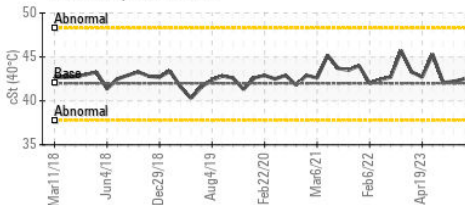

Particle Count

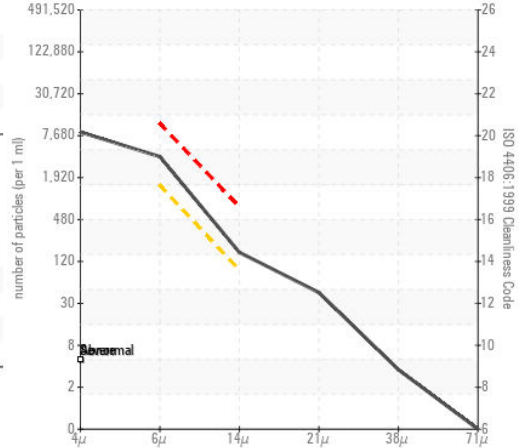

Acid Number

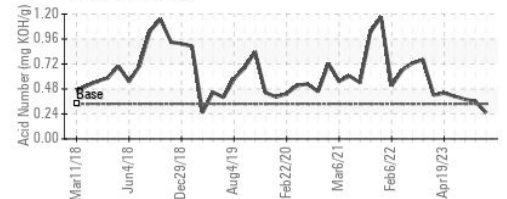

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0799710 **Received** : 14 Aug 2023
Lab Number : 05924202 **Diagnosed** : 15 Aug 2023
Unique Number : 10604149 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

BURKE CORPORATION.
 1516 SOUTH D AVE
 NEVADA, IA
 US 50201
 Contact: EDUARDO COBIO
 JECOBIO@BURKECORP.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (515)382-3955